

Update: Post-fire Water Quality Investigation

February 27, 2018



OUR FUTURE IN EVERY DRÖP


Overview


- Post-fire water quality Investigation targeting water services in the fire impacted areas.
- Nine investigative samples of water services to destroyed properties outside of Advisory Area found benzene above maximum contaminant level (MCL).
- All nine investigative samples were from burned properties and do not reflect water quality outside the advisory area.



OUR FUTURE IN EVERY DRÖP

Post Fire Water Quality Investigation

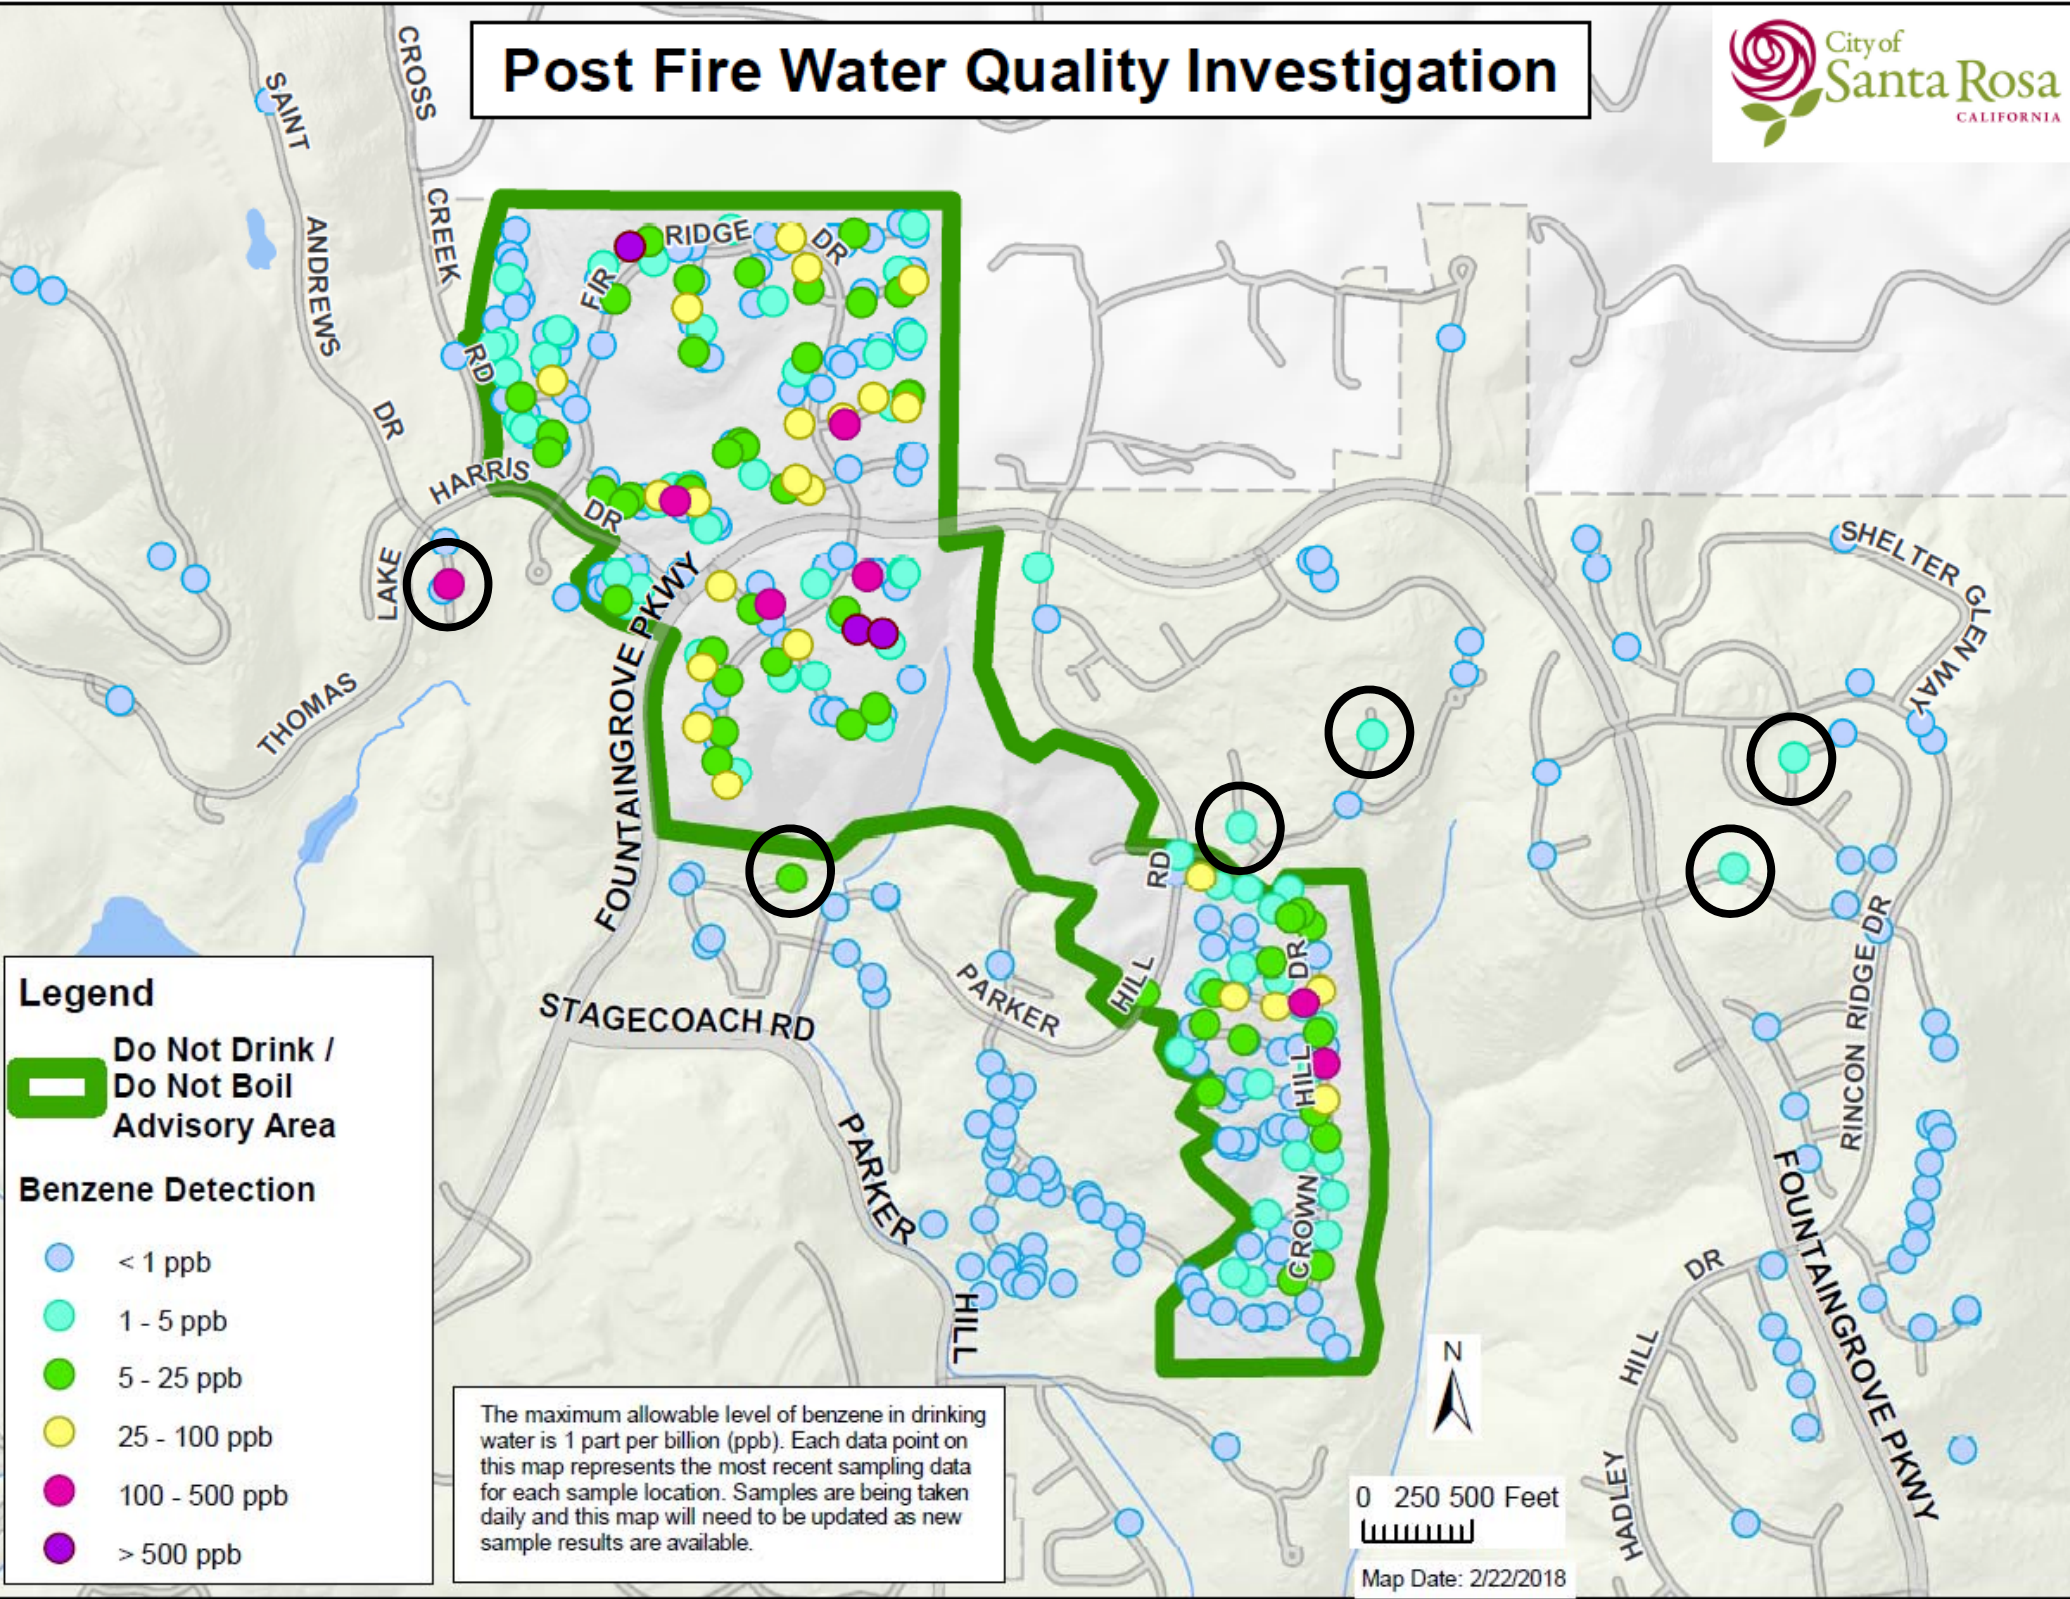

Legend
 Do Not Drink / Do Not Boil Advisory Area

Benzene Detection

-  < 1 ppb
-  1 - 5 ppb
-  5 - 25 ppb
-  25 - 100 ppb
-  100 - 500 ppb
-  > 500 ppb

The maximum allowable level of benzene in drinking water is 1 part per billion (ppb). Each data point on this map represents the most recent sampling data for each sample location. Samples are being taken daily and this map will need to be updated as new sample results are available.

0 250 500 Feet

Map Date: 2/22/2018

Expanding Investigation

- Continuing extensive sampling throughout the entire water system.
- Continue to flush, clean, replace, and monitor the water system.
- Replaced services where MCL was exceeded.
- Performing frequent sampling of water mains outside Advisory Area.
- Testing water pipes, services and meters with forensic chemist.

Investigation

Outside Advisory Area

- Collaborating with regulators and national experts
- Sampled outside Advisory Area within burn area
 - No evidence of benzene in water mains
 - No evidence of benzene in water services to remaining homes
 - Nine water services to destroyed properties showed benzene above 1 ppb
 - Both water quality and investigatory samples in Coffey Park are non-detect.
 - Water quality advisory area not expanding

Do-Not-Drink and Do-Not-Boil Advisory Notification

- Residents in the advisory area should not consume tap water. This includes:
 - Do not drink, cook, or brush teeth with tap water.
 - Do not let pets consume tap water.
- In addition, residents in the advisory area are advised to:
 - Limit shower time, use lukewarm water, and ventilate the area.
 - Limit use of hot water
 - Use a dishwasher to wash dishes
 - Wash clothing in cold water
 - Do not take baths
 - Do not use hot tubs or swimming pools



Customer Outreach

- Regular face-to-face interaction with customers
- Ongoing updates through door tags, emails, calls and letters
- Providing bottled drinking water for 13 homes



OUR FUTURE IN EVERY DROP

Next Steps – Restoring Water Quality

- Working with FEMA
 - Deadline - 60 days from February 15th to have project defined and authorized for reimbursement
- Conclude investigation by end of March
 - Finalize determination of source(s)
 - Finalize project approach, including schedule, for “fix”
- Working on funding options, assuming expedited funding from FEMA for upfront 40% of project cost

Contact Us with Any Questions

Visit our website: srcity.org/WQAdvisory

Water Quality hotline 707-543-3965



OUR FUTURE IN EVERY DRÖP