

Water Supply Update


Board of Public Utilities Meeting

October 18, 2018




OUR FUTURE IN EVERY DRÖP


Lake Mendocino Storage

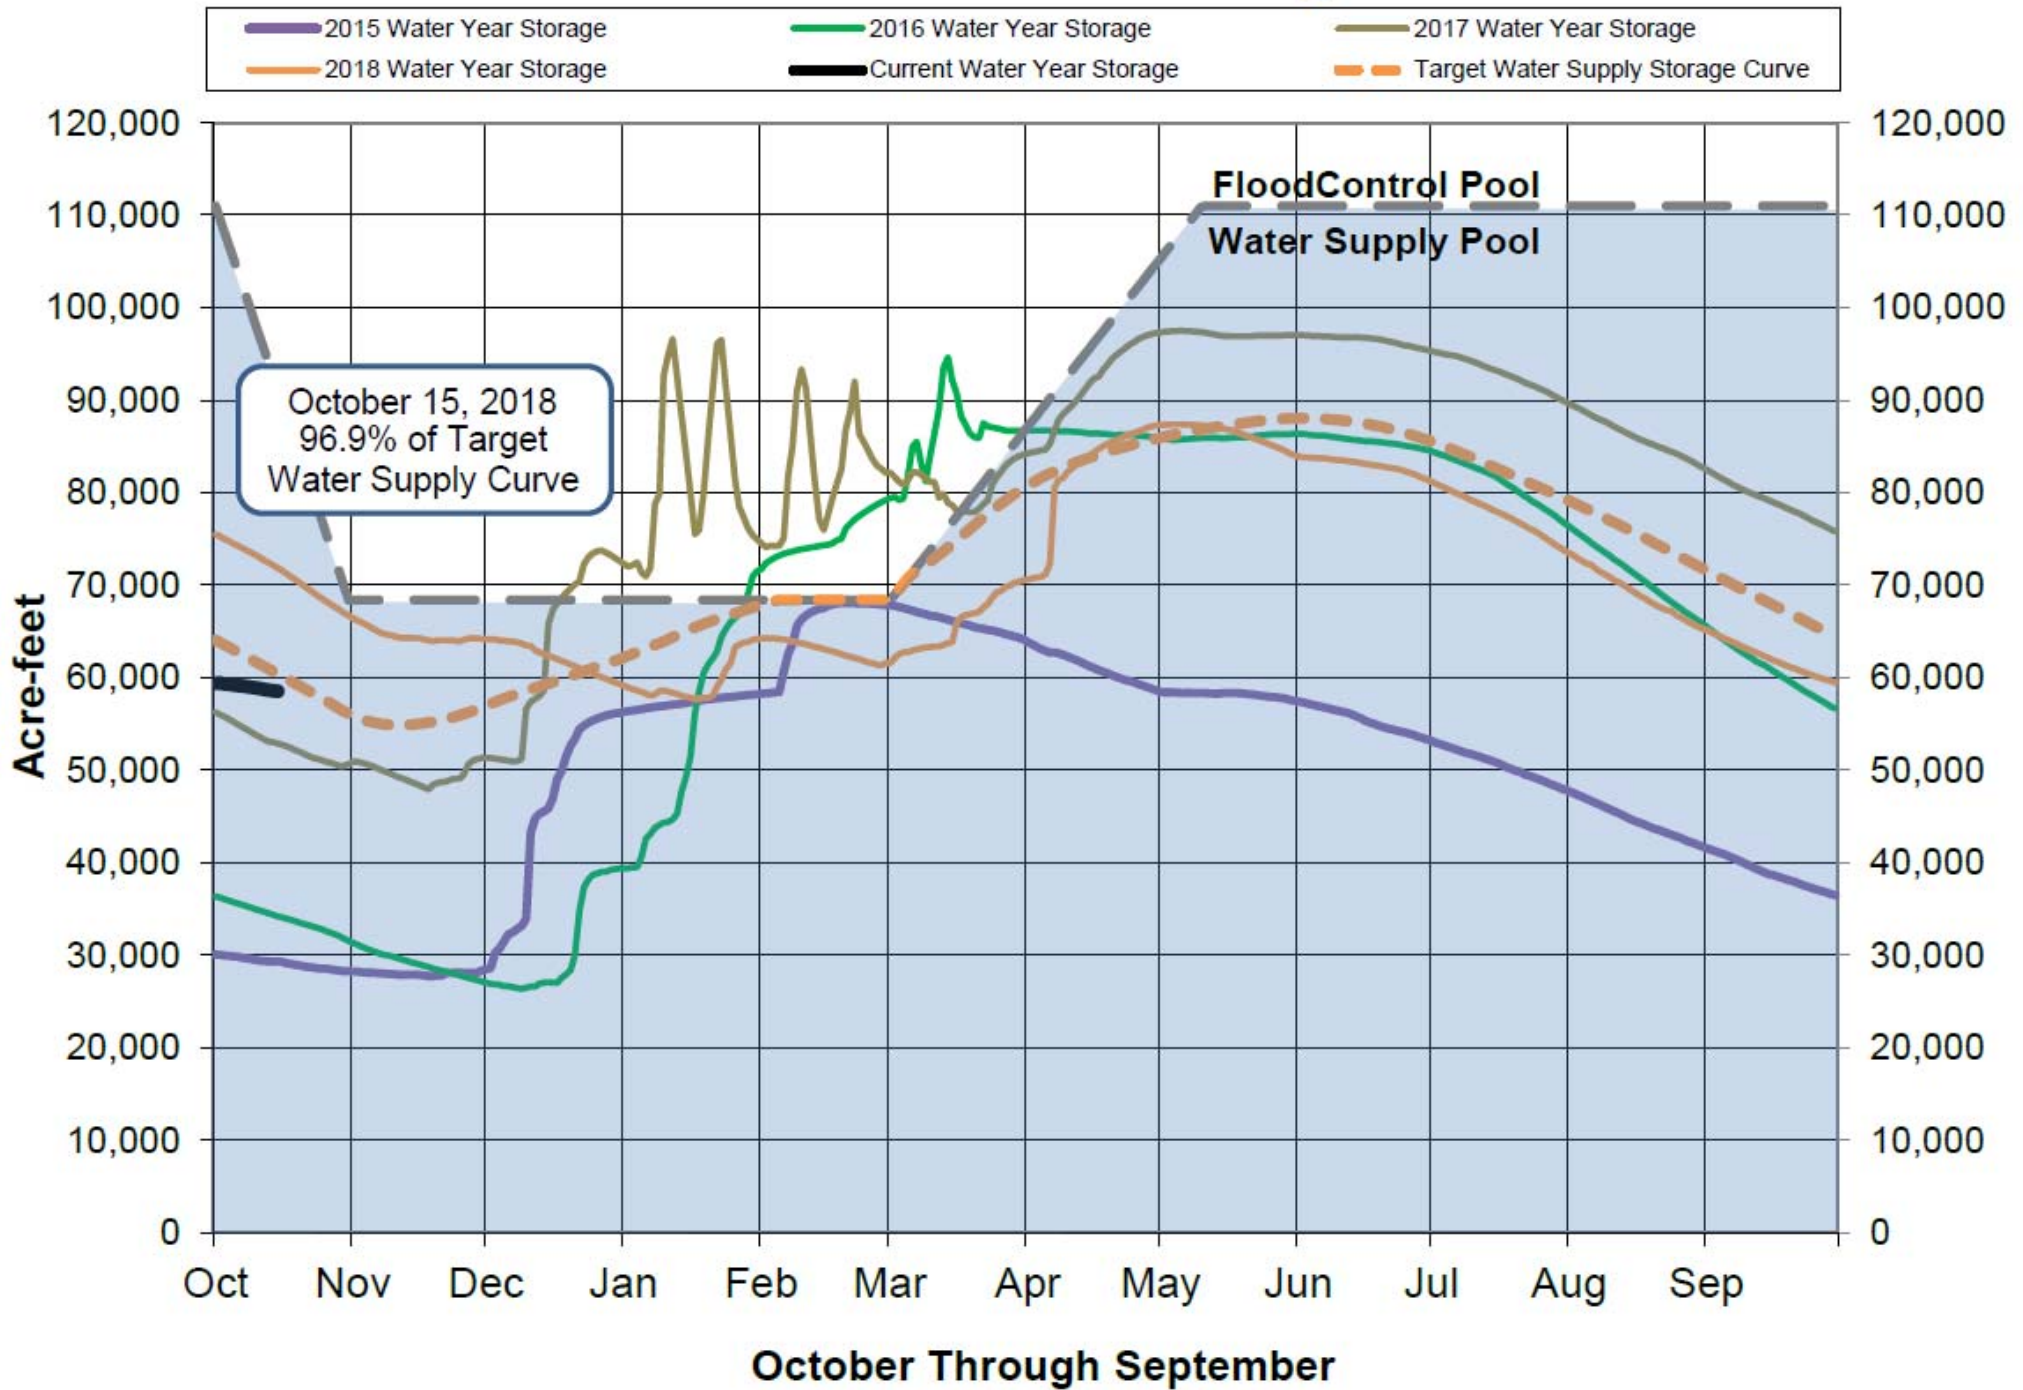

Lake Sonoma Storage

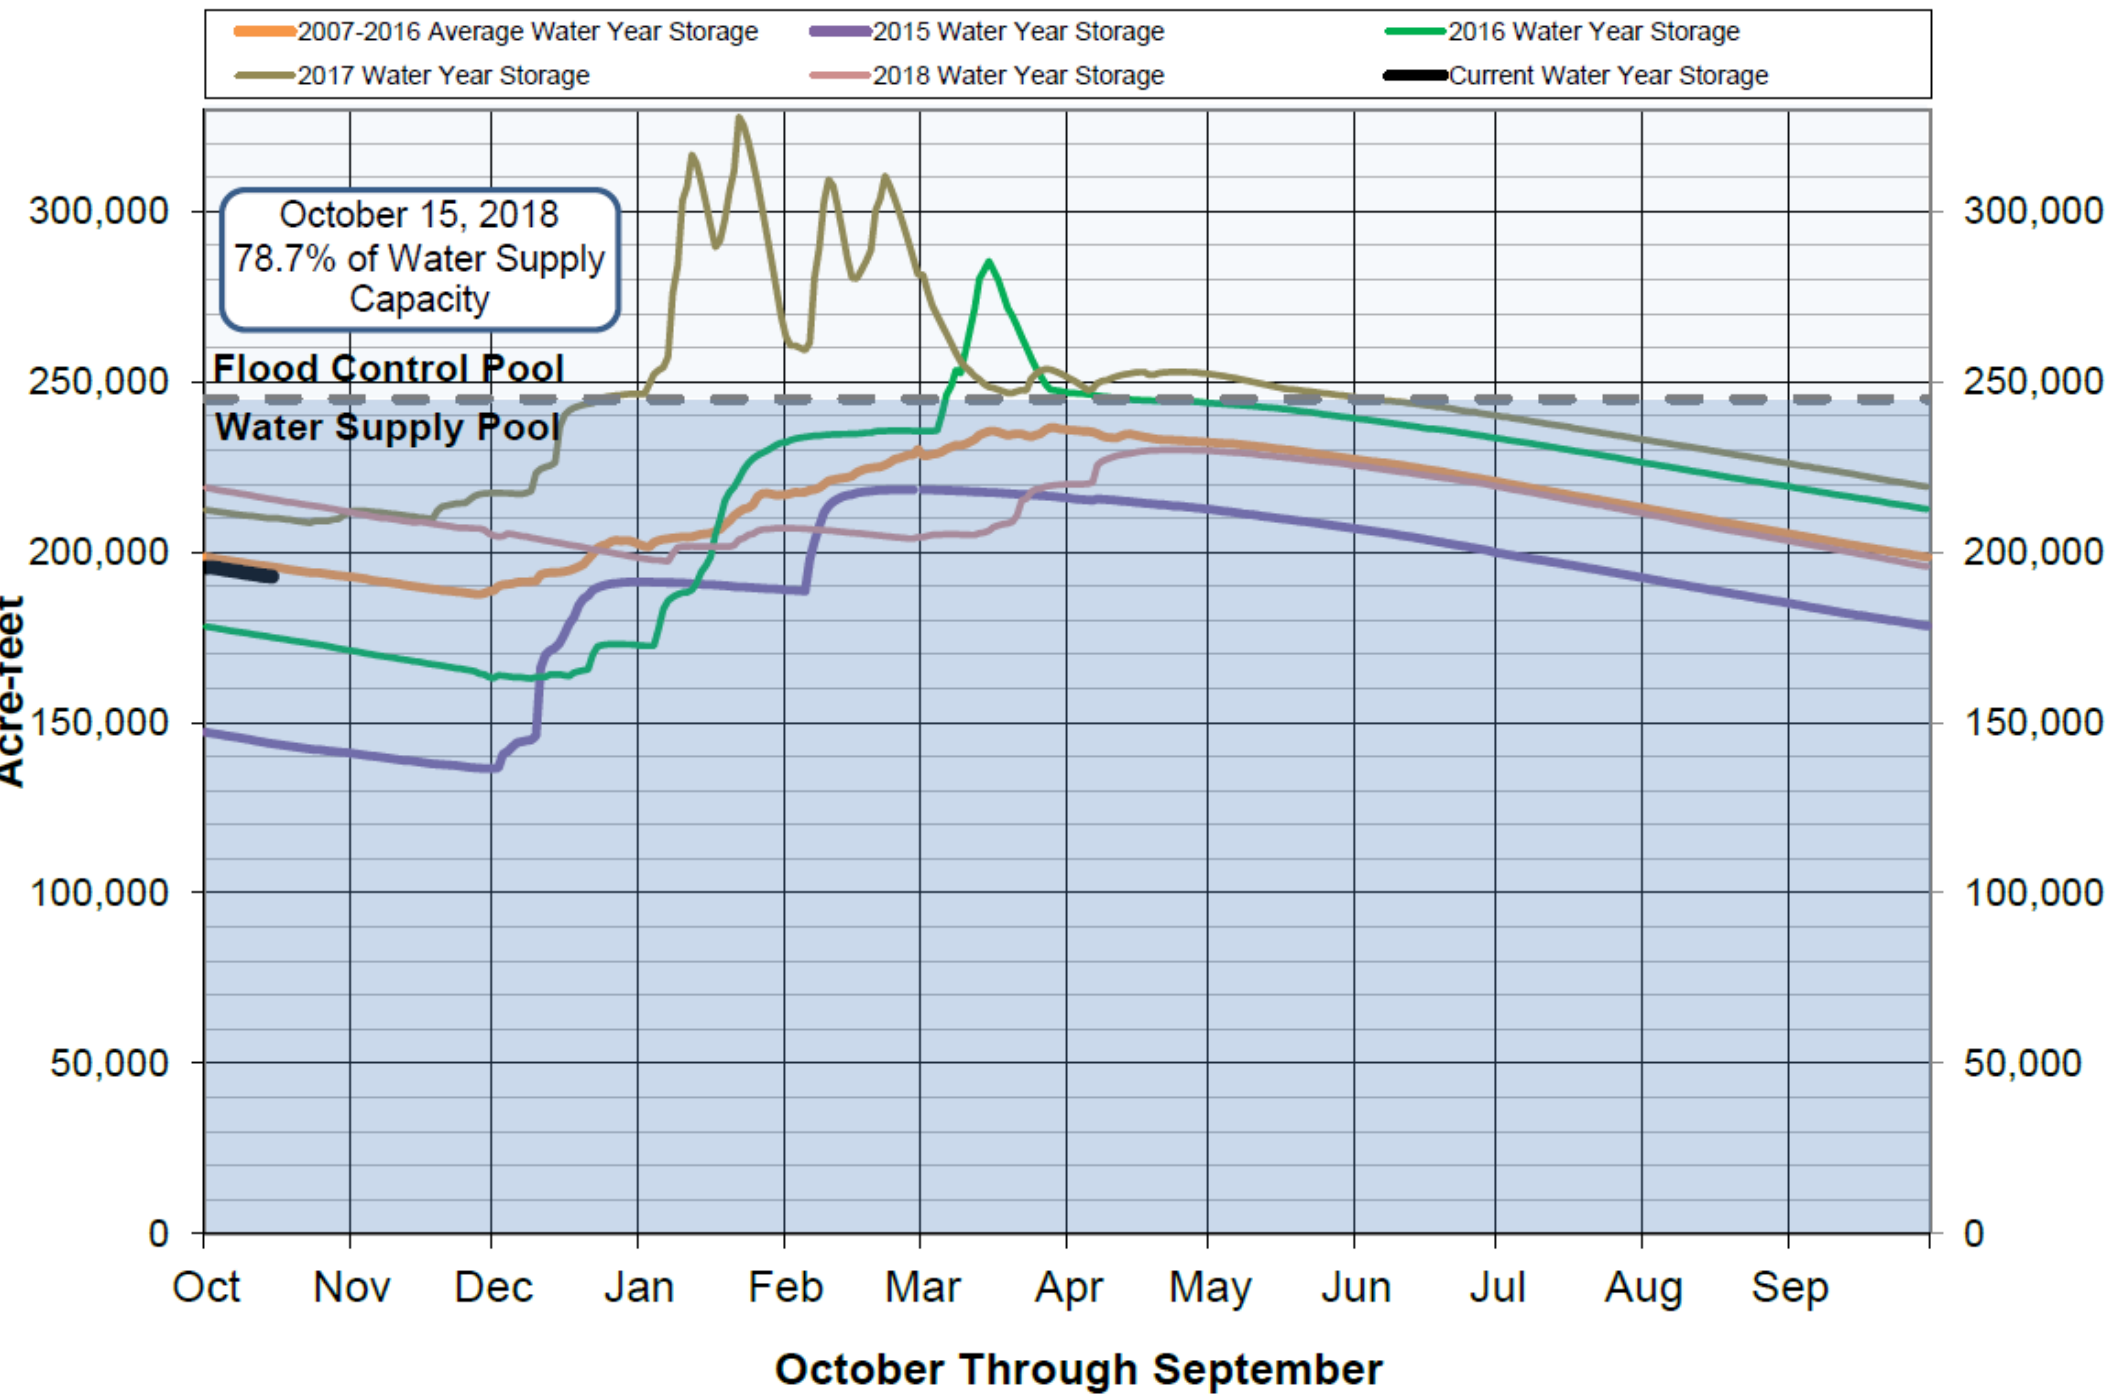

**Normal yr limits &
Min/Max/Average
2004-2018
and actual to date**

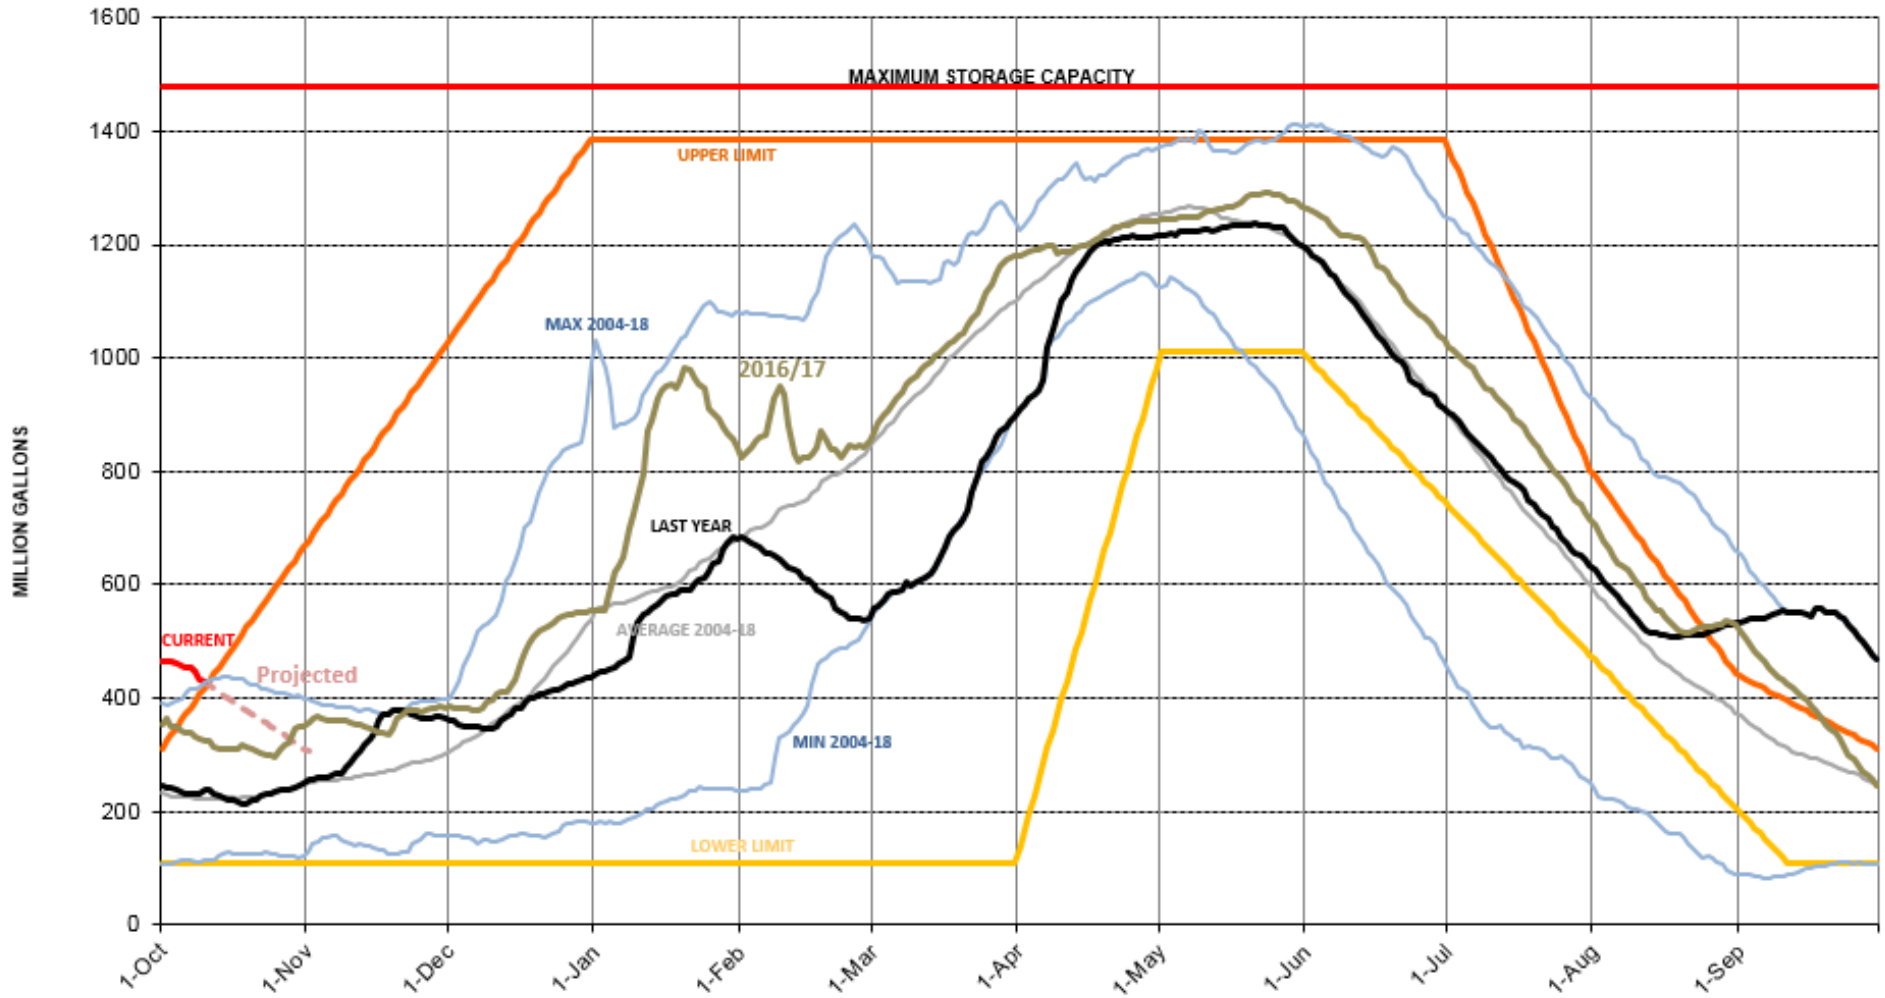









Geysers Pipeline Leak Repair

- Leak discovered during normal maintenance shutdown
 - JOC – emergency repair – contract obligation suspended temporarily
- 8/13 Start of Normal Shutdown
- 8/14 Pressure loss detected – 2 GPM leak
- 8/16 Leak located, commenced pipeline dewatering
- 8/20 Agricultural Customers notified of leak, irrigation encouraged
- 8/27 on-call contractor started repair work
- 9/5 Agricultural Customers notified of allotment suspension
- 9/18 Geysers operation returned to normal
- 40,000 gallon estimate at 2 gpm
- 1 of 5 expansion joints on Pine Flat Road
- Repair cost approximately \$60,000

Normal yr limits & Min/Max/Average 2004-2018 and actual to date

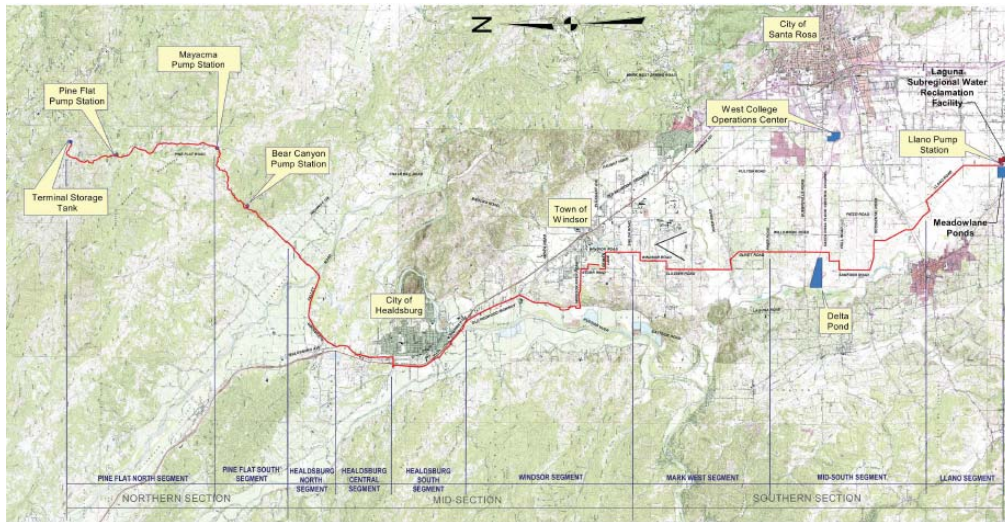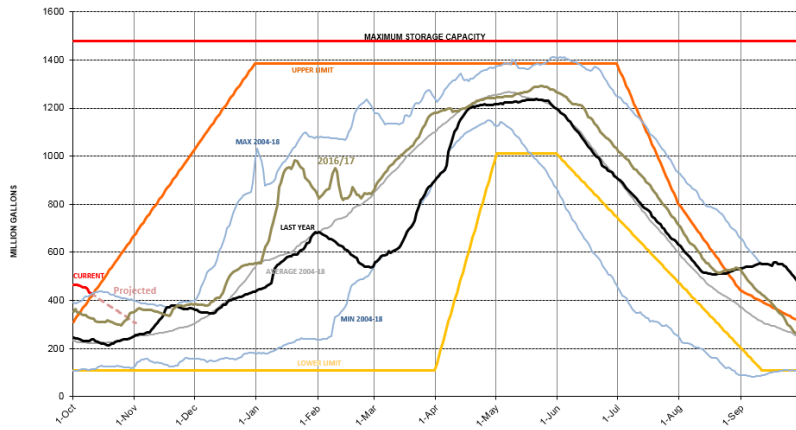

Questions...?