

Update to 2017 Water, Wastewater and Recycled Water Standards and Specifications


Board of Public Utilities Meeting
October 18, 2018



OUR FUTURE IN EVERY DRÖP

Background

- Design Standards
 - Framework for designing infrastructure
- Construction Standards
 - Specific construction details
- Construction Specifications
 - Testing procedures and installation methods

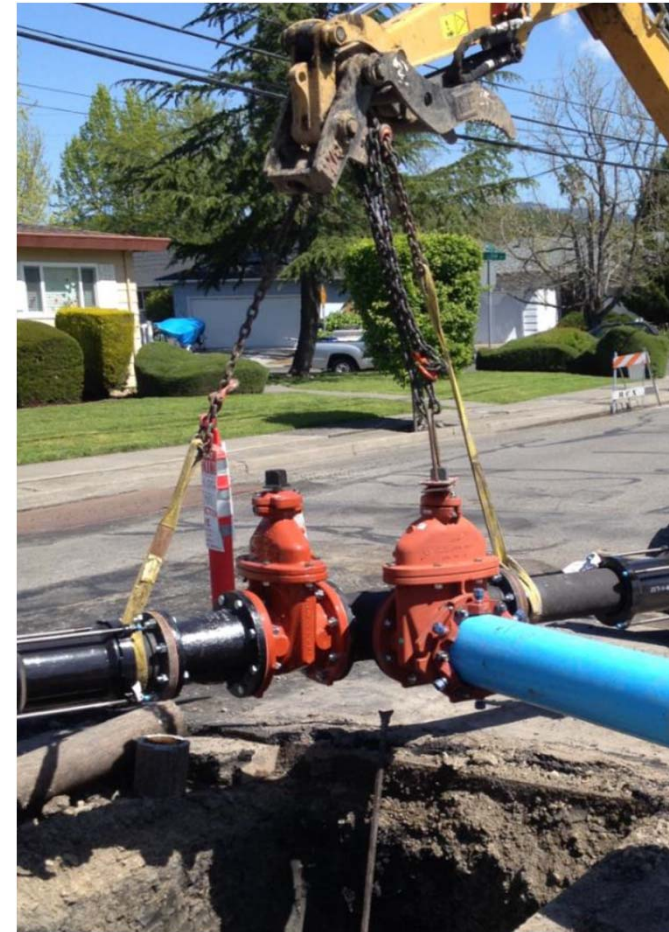

Background

- Last adopted by City Council in September 2017
 - Prior update was 2009
 - Incorporated updated regulations, new methods and materials
 - Majority was clarification and corrections
- Delegated authority to BPU to approve future updates


Proposed Changes

- Corrections to typographical errors
 - Water and Sewer Construction Standards and Specifications
 - Std 875 – mislabeled note in detail
 - Sewage Peak Load Factor graph
- Mislabeled Standards
 - Std 879 and Std 888 switched

New Standard


- 875F – Residential Fire Line Below Ground In Line Dual Check Valve Backflow Device
- Applies to fire rebuild area only
- Fire sprinklers
 - Less costly option
 - Better flow rate

ATTACHMENT 12

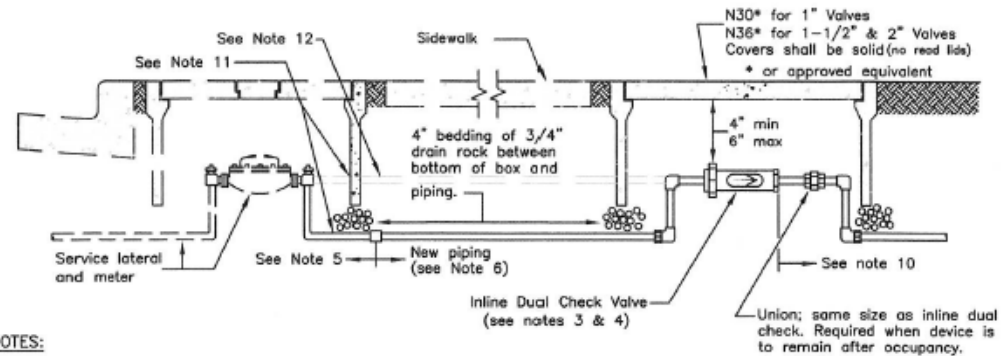

NOTES:

1. In circumstances where existing piping meets fire suppression needs, new piping is not required.
2. This City standard applies to residential connections where residential fire sprinkler systems are installed. Where residential fire sprinkler systems are fully looped without dead ends, designed to circulate water with the domestic systems and approved by Santa Rosa Fire, no backflow device is required at occupancy. Backflow protection is still required for water to be provided to property during construction.
3. Inline dual check valves shall be installed adjacent to and on the property side of the sidewalk where applicable. Where no sidewalk exists, the inline dual check valve shall be installed as close as possible to the water meter location. Any conflicts shall be resolved by the City Water Department.
4. Inline dual check valves shall meet ASSE 1024 standards and shall be equipped with an upstream union and F.I.P. connections on both ends. Although a 1" inline dual check valve is required as a minimum size, the City may require the installation of a larger device for specific installations. No 3/4" valves with 1" connections will be accepted. All proposed valves and installation material shall be submitted to the Water Department for review. Device shall be installed so the serial number faces up at the 12 o'clock position.
5. Piping shall be same size as the water meter. New piping, if required, shall be type "L" or "K" hard temper copper and/or threaded brass. Where existing piping is PVC, it shall be replaced as specified and in compliance with California Plumbing Code and all applicable City Standards. New PVC tubing and/or fittings are not allowed.
6. New piping shall be "same size as inline dual check valve" type "L" or "K" hard temper copper and/or threaded brass. Connection to piping, as specified in note 5 above, shall take place behind and outside of the water meter box unless the surface above this location is concrete. Where concrete planter strip and/or sidewalk is present, the connection shall take place on the horizontal portion of the service line inside the meter box. Connections at any other location must be approved by the Water Department and every effort shall take place to avoid joints below concrete surfaces. Where the meter and inline dual check valve is the same size and all piping must be replaced, this connection is not required. Compression fittings may only be used on piping to be buried and/or to connect property side tubing to back of downstream union. New PVC tubing and/or fittings are not allowed. New installation shall be in compliance with California Plumbing Code and all applicable City Standards.
7. All new piping shall be lead free per existing City Standards.

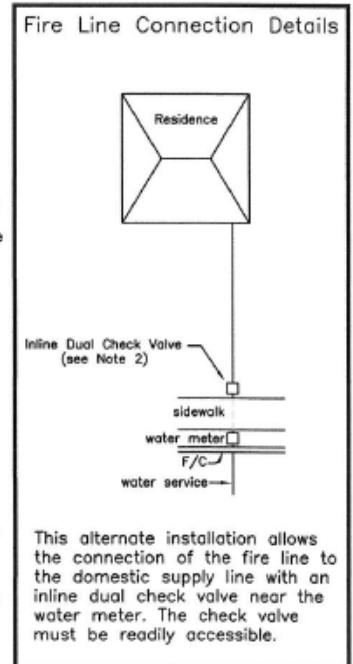

Recommendation

Recommended by Water Department that the Board, by Resolution, approve the update to the Water, Wastewater, Recycled Water Design and Construction Standards.



OUR FUTURE IN EVERY DRÖP

Questions?



OUR FUTURE IN EVERY DRÖP