

ACACIA VILLAGE PROJECT ENVIRONMENTAL NOISE ASSESSMENT

Santa Rosa, California

September 18, 2018

Prepared for:

**Robert Upton
Campus Properties, LLC
12555 Dunbar Road
Glen Ellen, CA 95442**

Prepared by:

**Carrie J. Janello and
Michael S. Thill**

ILLINGWORTH & RODKIN, INC.
/// Acoustics • Air Quality ///
1 Willowbrook Court, Suite 120
Petaluma, CA 94954
(707) 794-0400

Project: 18-126

INTRODUCTION

The project proposes the construction of 25 detached single-family residences on a 2.5-acre parcel, 19 of which would be one and two-story cottages, located at 746 Acacia Lane in Santa Rosa, California. The parcel of land is currently developed with an existing single-family residence constructed in 1953 and outbuildings. As part of the proposed project, the existing structures on the site would be demolished. The project site is surrounded by existing single-family residences.

This report evaluates the project's potential to result in significant noise and vibration impacts with respect to applicable California Environmental Quality Act (CEQA) guidelines. The report is divided into three sections: 1) the Setting Section provides a brief description of the fundamentals of environmental noise and summarizes applicable regulatory criteria; 2) the General Plan Consistency Section discusses the noise and land use compatibility of the project with respect to the City's General Plan; and, 3) the Impacts and Mitigation Measures Section describes the significance criteria used to evaluate project impacts to off-site receptors, provides a discussion of each project impact, and presents mitigation measures, where necessary, to reduce significant impacts to less-than-significant levels.

SETTING

Fundamentals of Environmental Noise

Noise may be defined as unwanted sound. Noise is usually objectionable because it is disturbing or annoying. The objectionable nature of sound could be caused by its *pitch* or its *loudness*. *Pitch* is the height or depth of a tone or sound, depending on the relative rapidity (frequency) of the vibrations by which it is produced. Higher pitched signals sound louder to humans than sounds with a lower pitch. *Loudness* is intensity of sound waves combined with the reception characteristics of the ear. Intensity may be compared with the height of an ocean wave in that it is a measure of the amplitude of the sound wave.

In addition to the concepts of pitch and loudness, there are several noise measurement scales which are used to describe noise in a particular location. A *decibel (dB)* is a unit of measurement which indicates the relative amplitude of a sound. The zero on the decibel scale is based on the lowest sound level that the healthy, unimpaired human ear can detect. Sound levels in decibels are calculated on a logarithmic basis. An increase of 10 decibels represents a ten-fold increase in acoustic energy, while 20 decibels is 100 times more intense, 30 decibels is 1,000 times more intense, etc. There is a relationship between the subjective noisiness or loudness of a sound and its intensity. Each 10 decibel increase in sound level is perceived as approximately a doubling of loudness over a fairly wide range of intensities. Technical terms are defined in Table 1.

There are several methods of characterizing sound. The most common in California is the *A-weighted sound level (dBA)*. This scale gives greater weight to the frequencies of sound to which the human ear is most sensitive. Representative outdoor and indoor noise levels in units of dBA are shown in Table 2. Because sound levels can vary markedly over a short period of time, a method for describing either the average character of the sound or the statistical behavior of the variations must be utilized. Most commonly, environmental sounds are described in terms of an

average level that has the same acoustical energy as the summation of all the time-varying events. This *energy-equivalent sound/noise descriptor* is called L_{eq} . The most common averaging period is hourly, but L_{eq} can describe any series of noise events of arbitrary duration.

The scientific instrument used to measure noise is the sound level meter. Sound level meters can accurately measure environmental noise levels to within about plus or minus 1 dBA. Various computer models are used to predict environmental noise levels from sources, such as roadways and airports. The accuracy of the predicted models depends upon the distance the receptor is from the noise source. Close to the noise source, the models are accurate to within about plus or minus 1 to 2 dBA.

Since the sensitivity to noise increases during the evening and at night -- because excessive noise interferes with the ability to sleep -- 24-hour descriptors have been developed that incorporate artificial noise penalties added to quiet-time noise events. The *Community Noise Equivalent Level (CNEL)* is a measure of the cumulative noise exposure in a community, with a 5 dB penalty added to evening (7:00 pm - 10:00 pm) and a 10 dB addition to nocturnal (10:00 pm - 7:00 am) noise levels. The *Day/Night Average Sound Level (L_{dn} or DNL)* is essentially the same as CNEL, with the exception that the evening time period is dropped and all occurrences during this three-hour period are grouped into the daytime period.

Fundamentals of Groundborne Vibration

Ground vibration consists of rapidly fluctuating motions or waves with an average motion of zero. Several different methods are typically used to quantify vibration amplitude. One method is the Peak Particle Velocity (PPV). The PPV is defined as the maximum instantaneous positive or negative peak of the vibration wave. In this report, a PPV descriptor with units of mm/sec or in/sec is used to evaluate construction generated vibration for building damage and human complaints. Table 3 displays the reactions of people and the effects on buildings that continuous or frequent intermittent vibration levels produce. The guidelines in Table 3 represent syntheses of vibration criteria for human response and potential damage to buildings resulting from construction vibration.

Construction activities can cause vibration that varies in intensity depending on several factors. The use of pile driving and vibratory compaction equipment typically generates the highest construction related groundborne vibration levels. Because of the impulsive nature of such activities, the use of the PPV descriptor has been routinely used to measure and assess groundborne vibration and almost exclusively to assess the potential of vibration to cause damage and the degree of annoyance for humans.

The two primary concerns with construction-induced vibration, the potential to damage a structure and the potential to interfere with the enjoyment of life, are evaluated against different vibration limits. Human perception to vibration varies with the individual and is a function of physical setting and the type of vibration. Persons exposed to elevated ambient vibration levels, such as people in an urban environment, may tolerate a higher vibration level.

Structural damage can be classified as cosmetic only, such as paint flaking or minimal extension of cracks in building surfaces; minor, including limited surface cracking; or major, that may threaten the structural integrity of the building. Safe vibration limits that can be applied to assess the potential for damaging a structure vary by researcher. The damage criteria presented in Table 3 include several categories for ancient, fragile, and historic structures, the types of structures most at risk to damage. Most buildings are included within the categories ranging from “Historic and some old buildings” to “Modern industrial/commercial buildings”. Construction-induced vibration that can be detrimental to the building is very rare and has only been observed in instances where the structure is at a high state of disrepair and the construction activity occurs immediately adjacent to the structure.

The annoyance levels shown in Table 3 should be interpreted with care since vibration may be found to be annoying at lower levels than those shown, depending on the level of activity or the sensitivity of the individual. To sensitive individuals, vibrations approaching the threshold of perception can be annoying. Low-level vibrations frequently cause irritating secondary vibration, such as a slight rattling of windows, doors, or stacked dishes. The rattling sound can give rise to exaggerated vibration complaints, even though there is very little risk of actual structural damage.

TABLE 1 Definition of Acoustical Terms Used in this Report

Term	Definition
Decibel, dB	A unit describing, the amplitude of sound, equal to 20 times the logarithm to the base 10 of the ratio of the pressure of the sound measured to the reference pressure. The reference pressure for air is 20 micro Pascals.
Sound Pressure Level	Sound pressure is the sound force per unit area, usually expressed in micro Pascals (or 20 micro Newtons per square meter), where 1 Pascal is the pressure resulting from a force of 1 Newton exerted over an area of 1 square meter. The sound pressure level is expressed in decibels as 20 times the logarithm to the base 10 of the ratio between the pressures exerted by the sound to a reference sound pressure (e. g., 20 micro Pascals). Sound pressure level is the quantity that is directly measured by a sound level meter.
Frequency, Hz	The number of complete pressure fluctuations per second above and below atmospheric pressure. Normal human hearing is between 20 Hz and 20,000 Hz. Infrasonic sound are below 20 Hz and Ultrasonic sounds are above 20,000 Hz.
A-Weighted Sound Level, dBA	The sound pressure level in decibels as measured on a sound level meter using the A-weighting filter network. The A-weighting filter de-emphasizes the very low and very high frequency components of the sound in a manner similar to the frequency response of the human ear and correlates well with subjective reactions to noise.
Equivalent Noise Level, L_{eq}	The average A-weighted noise level during the measurement period.
L_{max} , L_{min}	The maximum and minimum A-weighted noise level during the measurement period.
L_{01} , L_{10} , L_{50} , L_{90}	The A-weighted noise levels that are exceeded 1%, 10%, 50%, and 90% of the time during the measurement period.
Day/Night Noise Level, L_{dn} or DNL	The average A-weighted noise level during a 24-hour day, obtained after addition of 10 decibels to levels measured in the night between 10:00 p.m. and 7:00 a.m.
Community Noise Equivalent Level, CNEL	The average A-weighted noise level during a 24-hour day, obtained after addition of 5 decibels in the evening from 7:00 p.m.to 10:00 p.m. and after addition of 10 decibels to sound levels measured in the night between 10:00 p.m. and 7:00 a.m.
Ambient Noise Level	The composite of noise from all sources near and far. The normal or existing level of environmental noise at a given location.
Intrusive	That noise which intrudes over and above the existing ambient noise at a given location. The relative intrusiveness of a sound depends upon its amplitude, duration, frequency, and time of occurrence and tonal or informational content as well as the prevailing ambient noise level.

Source: Handbook of Acoustical Measurements and Noise Control, Harris, 1998.

TABLE 2 Typical Noise Levels in the Environment

Common Outdoor Activities	Noise Level (dBA)	Common Indoor Activities
	110 dBA	Rock band
Jet fly-over at 1,000 feet		
	100 dBA	
Gas lawn mower at 3 feet		
	90 dBA	
Diesel truck at 50 feet at 50 mph		Food blender at 3 feet
	80 dBA	Garbage disposal at 3 feet
Noisy urban area, daytime		
Gas lawn mower, 100 feet	70 dBA	Vacuum cleaner at 10 feet
Commercial area		Normal speech at 3 feet
Heavy traffic at 300 feet	60 dBA	
		Large business office
Quiet urban daytime	50 dBA	Dishwasher in next room
Quiet urban nighttime	40 dBA	Theater, large conference room
Quiet suburban nighttime	30 dBA	
		Library
Quiet rural nighttime		Bedroom at night, concert hall (background)
	20 dBA	
		Broadcast/recording studio
	10 dBA	
	0 dBA	

Source: Technical Noise Supplement (TeNS), California Department of Transportation, September 2013.

TABLE 3 Reaction of People and Damage to Buildings from Continuous or Frequent Intermittent Vibration Levels

Velocity Level, PPV (in/sec)	Human Reaction	Effect on Buildings
0.01	Barely perceptible	No effect
0.04	Distinctly perceptible	Vibration unlikely to cause damage of any type to any structure
0.08	Distinctly perceptible to strongly perceptible	Recommended upper level of the vibration to which ruins and ancient monuments should be subjected
0.1	Strongly perceptible	Threshold at which there is a risk of damage to fragile buildings with no risk of damage to most buildings
0.25	Strongly perceptible to severe	Threshold at which there is a risk of damage to historic and some old buildings.
0.3	Strongly perceptible to severe	Threshold at which there is a risk of damage to older residential structures
0.5	Severe - Vibrations considered unpleasant	Threshold at which there is a risk of damage to new residential and modern commercial/industrial structures

Source: Transportation and Construction Vibration Guidance Manual, California Department of Transportation, September 2013.

Regulatory Background - Noise

The State of California and the City of Santa Rosa have established regulatory criteria that are applicable in this assessment. The California Environmental Quality Act (CEQA) Guidelines, Appendix G, are used to assess the potential significance of impacts pursuant to local General Plan policies, Municipal Code standards, or the applicable standards of other agencies. A summary of the applicable regulatory criteria is provided below.

State CEQA Guidelines. CEQA contains guidelines to evaluate the significance of noise and vibration impacts attributable to a proposed project. Under CEQA, impacts would be considered significant if the project would result in:

- (a) Exposure of persons to or generation of noise levels in excess of standards established in the local General Plan or Noise Ordinance, or applicable standards of other agencies;
- (b) Exposure of persons to or generation of excessive groundborne vibration or groundborne noise levels;
- (c) A substantial permanent increase in ambient noise levels in the project vicinity above levels existing without the project;

- (d) A substantial temporary or periodic increase in ambient noise levels in the project vicinity above levels existing without the project;
- (e) For a project located within an airport land use plan or where such a plan has not been adopted within two miles of a public airport or public use airport, if the project would expose people residing or working in the project area to excessive noise levels; or
- (f) For a project within the vicinity of a private airstrip, if the project would expose people residing or working in the project area to excessive noise levels.

City of Santa Rosa General Plan 2035. The City of Santa Rosa's General Plan¹ includes the Noise and Safety Element, which provides guidelines to achieve the goal of maintaining an acceptable community noise level. The following goals and policies are applicable to the proposed project:

NS-B Maintain an acceptable community noise level to protect the health and comfort of people living, working and/or visiting in Santa Rosa, while maintaining a visually appealing community.

NS-B-1 Do not locate noise-sensitive uses in proximity to major noise sources, except residential is allowed near rail to promote future ridership.

NS-B-2 Encourage residential developers to provide buffers other than sound walls, where practical. Allow sound walls only when projected noise levels at a site exceed land use compatibility standards in Figure 12-1.

In some established neighborhoods and subdivisions, sound walls may provide the only alternative to reduce noise to acceptable community standards. The Design Review process shall evaluate sound wall aesthetics and landscaping to ensure attractiveness along with functionality.

NS-B-3 Prevent new stationary and transportation noise sources from creating a nuisance in existing developed areas. Use a comprehensive program of noise prevention through planning and mitigation, and consider noise impacts as a crucial factor in project approval.

The Land Use Compatibility Standards specify normally acceptable levels for community noise in various land use areas.

NS-B-4 Require new projects in the following categories to submit an acoustical study, prepared by a qualified acoustical consultant:

- All new projects proposed for areas with existing noise above 60 dBA DNL. Mitigation shall be sufficient to reduce noise levels below 45 dBA DNL in

¹ Santa Rosa General Plan 2035, November 3, 2009.

habitable rooms and 60 dBA DNL in private and shared recreational facilities. Additions to existing housing units are exempt.

- All new projects that could generate noise whose impacts on other existing uses would be greater than those normally acceptable (as specified in the Land Use Compatibility Standards).

NS-B-5 Pursue measures to reduce noise impacts primarily through site planning. Engineering solutions for noise mitigation, such as sound walls, are the least desirable alternative.

NS-B-6 Do not permit existing uses to generate new noises exceeding normally acceptable levels unless:

- Those noises are mitigated to acceptable levels; or
- The activities are specifically exempted by the City Council on the basis of community health, safety, and welfare.


NS-B-8 Adopt mitigations, including reduced speed limits, improved paving texture, and traffic controls, to reduce noise to normally acceptable levels in areas where noise standards may be exceeded (e.g., where homes front regional/arterial streets and in areas of mixed use development.)

NS-B-9 Encourage developers to incorporate acoustical site planning into their projects. Recommended measures include:

- Incorporating buffers and/or landscaped earth berms;
- Orienting windows and outdoor living areas away from unacceptable noise exposure;
- Using reduced-noise pavement (rubberized-asphalt);
- Incorporating traffic calming measures, alternative intersection designs, and lower speed limits; and
- Incorporating state-of-the-art structural sound attenuation and setbacks.

NS-B-14 Discourage new projects that have potential to create ambient noise levels more than 5 dBA DNL above existing background, within 250 feet of sensitive receptors.

Figure 12-1
Land Use Compatibility Standards

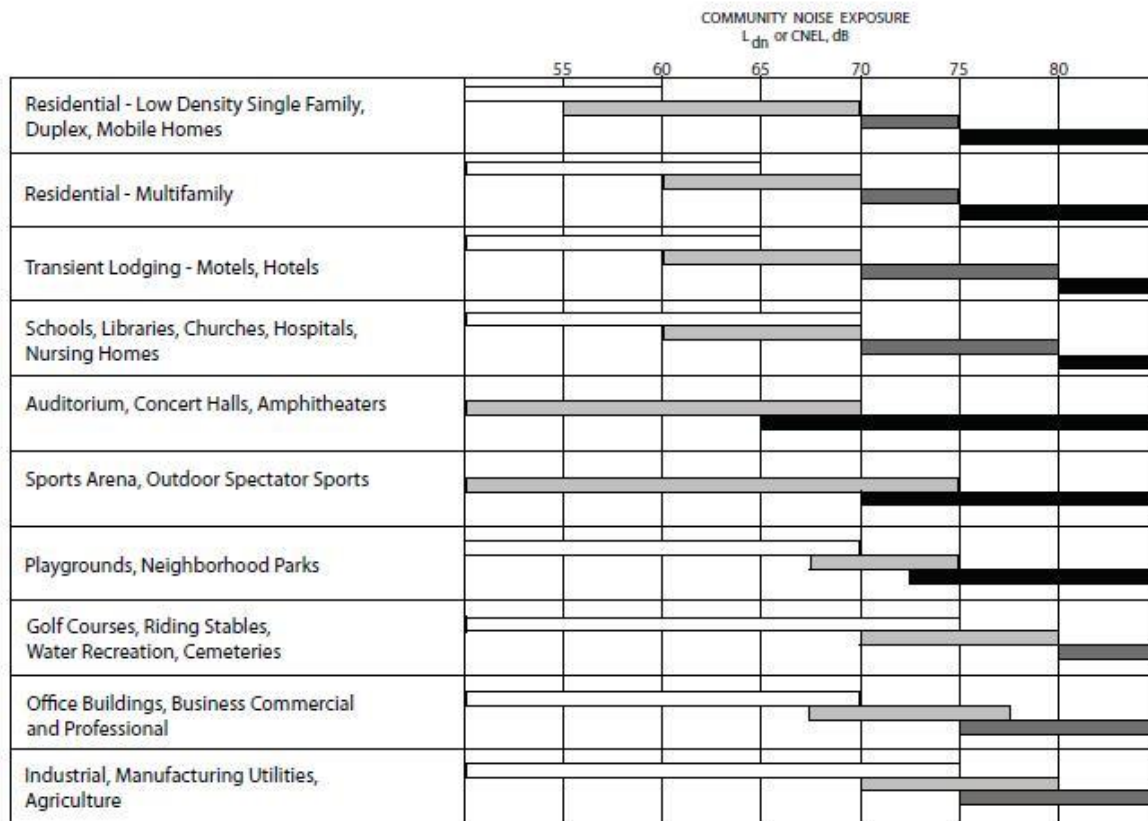

LEGEND:



NORMALLY ACCEPTABLE

Specified land use is satisfactory, based upon the assumption that any building involved is of normal conventional construction, without any special noise insulation requirements.



CONDITIONALLY ACCEPTABLE

New construction or development should be undertaken only after a detailed analysis of the noise reduction requirements is made and needed noise insulation features included in the design. Conventional construction, but with closed windows and fresh air supply systems or air conditioning will normally suffice.



NORMALLY UNACCEPTABLE

New construction or development should generally be discouraged. If new construction or development does proceed, a detailed analysis of the noise reduction requirements must be made and needed noise insulation features included in the design.



CLEARLY UNACCEPTABLE

New construction or development should generally not be undertaken.

Source: Environmental Science Associates, 2001

Source: Santa Rosa General Plan 2035, 2009.

Santa Rosa Noise Ordinance. The City of Santa Rosa has adopted a quantitative noise ordinance in Chapter 17-16 of the Santa Rosa Noise Ordinance. Section 17-16.120 regulates noise from stationary machinery and equipment:

“It is unlawful for any person to operate any machinery, equipment, pump, fan, air conditioning apparatus, or similar mechanical device in any manner so as to create any noise which would cause the noise level at the property line of any property to exceed the ambient base noise level by more than five decibels.”

The ambient base noise levels for residential, office, commercial, and industrial areas are established in Section 17-16.030. The applicable ambient noise level criteria are shown in Table 4.

TABLE 4 Santa Rosa Noise Ordinance Ambient Base Noise Levels

Land Use Zone	Daytime Level (7:00 a.m. to 7:00 p.m.)	Evening Level (7:00 p.m. to 10:00 p.m.)	Nighttime Level (10:00 p.m. to 7:00 a.m.)
Single-Family Residential (R1 and R2)	55 dBA	50 dBA	45 dBA
Multi-Family Residential	55 dBA	55 dBA	50 dBA
Office and Commercial	60 dBA	60 dBA	55 dBA
Intensive Commercial	65 dBA	65 dBA	55 dBA
Industrial	70 dBA	70 dBA	70 dBA

Source: Santa Rosa Noise Ordinance 17-16.030.

The Noise Ordinance defines ambient noise as follows:

“Ambient noise is the all-encompassing noise associated with a given environment usually a composite of sounds from many sources near and far. For the purpose of this chapter, ambient noise level is the level obtained when the noise level is averaged over a period of 15 minutes without inclusion of noise from isolated identifiable sources at the location and time of day near that at which a comparison is to be made.”

GENARL PLAN CONSISTENCY ANALYSIS

Noise and Land Use Compatibility

The compatibility of the proposed residential project is assessed against the Land Use Compatibility Standards established in the City of Santa Rosa General Plan. The City of Santa Rosa considers residential exterior use areas in single-family residential developments “normally acceptable” in noise environments of 60 dBA DNL or less. Interior noise levels shall be maintained so as not to exceed 45 dB DNL.

Future Exterior Noise Environment

The project site is located along Acacia Lane, north of Highway 12, which is the dominant noise source at the site. Highway 12 is expected to remain the dominant noise source under future

conditions. Local neighborhood traffic along Acacia Lane and the other surrounding roadways would also affect the noise environment at the site. In addition to backyards at each of the single-family units, the proposed project would include a covered community facility with an outdoor kitchen and seating area and a community garden.

The future 2035 noise contour figure provided in the City of Santa Rosa General Plan² indicates that the noise environment at the project site would fall in the 60 to 65 dBA DNL range under future conditions. A traffic study was conducted for the proposed project in March 2018 by W-Trans.³ According to the traffic study, a total of 18 AM peak hour trips and 24 PM peak hour trips would be generated by the proposed project. These additional project trips would be insignificant compared to the future traffic volumes along Highway 12 and would not result in a further noise level increase.

While the 2035 noise contours indicate that noise levels would range from 60 to 65 dBA DNL in the future, these contours do not take into account shielding provided by existing intervening buildings located between the project site and Highway 12. With a setback of approximately 830 feet or more from the centerline of Highway 12 and several rows of buildings providing at least partial shielding, at least 5 dBA of noise reduction would be expected. Therefore, future exterior noise levels at the project site would be at or below 60 dBA DNL, and each of the backyards and common outdoor use areas would have exterior noise levels that would satisfy the City's "normally acceptable" noise and land compatibility standard. The proposed residential development is expected to be compatible with the future noise environment at the site.

Future Interior Noise Environment

Standard residential construction provides approximately 15 dBA of exterior-to-interior noise reduction, assuming the windows are partially open for ventilation. Standard construction with the windows closed provides approximately 20 to 25 dBA of noise reduction in interior spaces. Where exterior noise levels range from 60 to 65 dBA DNL, the inclusion of adequate forced-air mechanical ventilation is often the method selected to reduce interior noise levels to acceptable levels by closing the windows to control noise. Where noise levels exceed 65 dBA DNL, forced-air mechanical ventilation systems and sound-rated construction methods are normally required. Such methods or materials may include a combination of smaller window and door sizes as a percentage of the total building façade facing the noise source, sound-rated windows and doors, sound-rated exterior wall assemblies, and mechanical ventilation so windows may be kept closed at the occupant's discretion.

With future exterior noise levels at or below 60 dBA DNL, future interior noise levels would be at or below 45 dBA DNL, assuming windows to be partially open. The City's interior noise requirements of 45 dBA DNL would be satisfied, and the proposed project would be compatible with the interior noise environment at the project site.

² City of Santa Rosa, "Santa Rosa General Plan 2035," November 3, 2009.

³ W-Trans, "Focused Traffic Study for the Acacia Village," March 26, 2018.

Aircraft Noise

Charles M. Schulz Sonoma County Airport is a public airport located over 7.6 miles northwest of the project site. According to the Sonoma County General Plan 2020 Air Transportation Element, the project site lies outside the 55 dBA CNEL noise contour for this airport. Noise from aircraft would not substantially increase traffic noise levels expected at the project site, and interior noise levels resulting from aircraft would be compatible with the proposed project.

NOISE IMPACTS AND MITIGATION MEASURES

Significance Criteria

The following criteria were used to evaluate the significance of environmental noise resulting from the project:

- A significant noise impact would be identified if the project would expose persons to or generate noise levels that would exceed applicable noise standards presented in the General Plan or Municipal Code.
- A significant impact would be identified if the construction of the project would expose persons to excessive vibration levels. Groundborne vibration levels exceeding 0.3 in/sec PPV would have the potential to result in cosmetic damage to normal buildings.
- A significant impact would be identified if traffic generated by the project or project improvements/operations would substantially increase noise levels at sensitive receivers in the vicinity. The City of Santa Rosa discourages new projects that have potential to create ambient noise levels more than 5 dBA DNL above existing background, within 250 feet of sensitive receptors.
- A significant noise impact would be identified if construction-related noise would temporarily increase ambient noise levels at sensitive receptors. Hourly average noise levels exceeding 60 dBA L_{eq} , and the ambient by at least 5 dBA L_{eq} , for a period of more than one year would constitute a significant temporary noise increase at adjacent residential land uses.

Impact 1: Noise Levels in Excess of Standards. The proposed project could potentially generate noise in excess of standards established in the City's Municipal Code at the nearby sensitive receptors. **This is a potentially significant impact.**

Section 17-16.120 of the City's Noise Ordinance limits noise levels produced by stationary mechanical equipment to 60 dBA during daytime hours (7:00 a.m. to 7:00 p.m.), to 55 dBA during evening hours (7:00 p.m. to 10:00 p.m.), and to 50 dBA at night (10:00 p.m. to 7:00 a.m.) at single-family residential property lines.

The proposed project is expected to generate typical noise associated with residential developments, which would not be regulated by the City's Noise Ordinance limits, such as barking

dogs, children playing, etc. However, the proposed residences may include mechanical equipment such as heating, ventilation, and air conditioning systems, which would be enforced by the City's Noise Ordinance thresholds.

Information regarding the location, number, type, and size of the mechanical equipment units to be used in the proposed project was not available at the time of this study. While the site plan does not show the location of the air conditioning units, this type of equipment is typically located on the ground floor around the perimeter of the residential structures. Typically, air conditioning units are located on the sides or back of the residences.

Typical air conditioning units and heat pumps for single-family residences generate noise levels of about 60 dBA L_{eq} at a distance of 8 feet. This type of equipment could run continuously during the daytime and nighttime but more often runs intermittently. The nearest distance from the rear property line to a residential building façade would be 11 feet. It is reasonable to assume an air conditioning unit or heat pump could be within about 8 feet of the property line. An 8 foot high property line fence is planned, with the bottom six feet of the fence being solid. Such a noise barrier would provide at least a 5 dBA reduction in the noise level on the neighboring property. Therefore, mechanical equipment noise would be up to 55 dBA, potentially exceeding the City's nighttime noise limit by up to 5 dBA. This would conservatively be considered a significant impact.

Mitigation Measure 1:

Outdoor air conditioning units shall be selected and located so as to comply with the limits set forth in the City of Santa Rosa Noise Ordinance. (Note: A typical residential air conditioning unit located at least 15 feet from a property line would be satisfactory assuming the noise reduction provided by the proposed barrier.)

Impact 2: Exposure to Excessive Groundborne Vibration. Construction-related vibration caused by some types of construction activity is not expected to exceed 0.3 in/sec PPV at the existing residences located adjacent to the project site. **This is a less-than-significant impact.**

The construction of the project may generate perceptible vibration when heavy equipment or impact tools (e.g. jackhammers, hoe rams) are used. Construction activities would include site demolition, preparation work, foundation work, and new building framing and finishing. The proposed project would not require pile driving, which can cause excessive vibration.

For structural damage, the California Department of Transportation recommends a vibration limit of 0.5 in/sec PPV for buildings structurally sound and designed to modern engineering standards, which typically consist of buildings constructed since the 1990s. A conservative vibration limit of 0.3 in/sec PPV has been used for buildings that are found to be structurally sound but where structural damage is a major concern (see Table 3 above for further explanation). For historical buildings or buildings that are documented to be structurally weakened, a conservative limit of 0.08 in/sec PPV is often used to provide the highest level of protection. While no historical buildings or buildings that are documented to be structurally weakened adjoin the project site, details regarding the residences surrounding the project site were not provided at the time of this

study. For the purposes of this study, therefore, groundborne vibration levels exceeding the conservative 0.3 in/sec PPV limit would have the potential to result in a significant vibration impact.

Table 4 presents typical vibration levels that could be expected from construction equipment at a distance of 25 feet. Construction activities, such as drilling, the use of jackhammers, rock drills and other high-power or vibratory tools, and rolling stock equipment (tracked vehicles, compactors, etc.) may generate substantial vibration in the immediate vicinity. Vibration levels would vary depending on soil conditions, construction methods, and equipment used.

According to the site plan, heavy construction equipment is not expected to operate within 23 feet any surrounding residential structure. Therefore, vibration levels due to construction activities would be 0.23 in/sec PPV or less at existing noise-sensitive structures surrounding the site. Construction activity for the proposed project is not expected to result in “architectural” damage to the residences adjacent to the site. This is a less-than-significant impact.

TABLE 4 Vibration Source Levels for Construction Equipment

Equipment		PPV at 25 ft. (in/sec)	Approximate L_v at 25 ft. (VdB)
Pile Driver (Impact)	upper range	1.158	112
	typical	0.644	104
Pile Driver (Sonic)	upper range	0.734	105
	typical	0.170	93
Clam shovel drop		0.202	94
Hydromill (slurry wall)	in soil	0.008	66
	in rock	0.017	75
Vibratory Roller		0.210	94
Hoe Ram		0.089	87
Large bulldozer		0.089	87
Caisson drilling		0.089	87
Loaded trucks		0.076	86
Jackhammer		0.035	79
Small bulldozer		0.003	58

Source: Transit Noise and Vibration Impact Assessment, United States Department of Transportation, Office of Planning and Environment, Federal Transit Administration, May 2006.

Mitigation Measure 2: None required.

Impact 3: Permanent Noise Level Increase. The proposed project is not expected to result in a substantial permanent noise level increase due to project-generated traffic at the existing noise-sensitive land uses in the project vicinity. **This is a less-than-significant impact.**

Based on Policy NS-B-14 of the City of Santa Rosa General Plan, a significant impact would occur if the proposed project would result in a permanent noise level increase due to project-generated traffic of 5 dBA DNL or greater at sensitive receptors located within 250 feet of the project site.

For reference, a 5 dBA DNL noise increase would be expected if the project would triple existing traffic volumes along a roadway.

The project trips included in the traffic study completed by *W-Trans* of 18 peak hour AM trips and 24 peak hour PM trips would be insignificant compared to the traffic volumes along Highway 12. With the inclusion of the proposed project, the resulting noise level increase would be less than 1 dBA DNL. This impact is a less-than-significant impact.

Mitigation Measure 3: None required.

Impact 4: Temporary Construction Noise. Existing noise-sensitive land uses would be exposed to a temporary increase in ambient noise levels due to project construction activities. The incorporation of construction best management practices as project conditions of approval would result in a **less-than-significant** temporary noise impact.

Noise impacts resulting from construction depend upon the noise generated by various pieces of construction equipment, the timing and duration of noise-generating activities, and the distance between construction noise sources and noise-sensitive areas. Construction noise impacts primarily result when construction activities occur during noise-sensitive times of the day (e.g., early morning, evening, or nighttime hours), the construction occurs in areas immediately adjoining noise-sensitive land uses, or when construction lasts over extended periods of time.

The City of Santa Rosa does not define allowable construction hours in the General Plan or Municipal Code, but assuming that construction would be limited to daytime hours only, temporary construction noise would be considered a significant impact where noise from construction activities exceeds 60 dBA L_{eq} and exceeds the ambient noise environment by at least 5 dBA L_{eq} at noise-sensitive uses in the project vicinity for a period exceeding one year.

Construction activities generate considerable amounts of noise, especially during earth-moving activities when heavy equipment is used. The highest maximum noise levels generated by project construction would typically range from about 80 to 90 dBA L_{max} at a distance of 50 feet from the noise source (Table 5). Typical hourly average construction-generated noise levels for residential developments are about 81 to 88 dBA L_{eq} measured at a distance of 50 feet from the center of the site during busy construction periods (e.g., earth moving equipment, impact tools, etc.), as shown in Table 6. Construction-generated noise levels drop off at a rate of about 6 dBA per doubling of the distance between the source and receptor. Shielding by buildings or terrain can provide an additional 5 to 10 dBA noise reduction at distant receptors.

The total duration for project construction was not available at the time of this study; however, the nearest residences surrounding the site would be approximately 100 feet from the center of the project site. Based on the noise levels shown in Table 6, noise levels would range from 75 to 82 dBA L_{eq} at 100 feet when all pertinent equipment is being used and from 59 to 77 dBA L_{eq} when the minimum required equipment is being used. Therefore, at times throughout project construction, noise levels would exceed 60 dBA L_{eq} and would be expected to exceed ambient conditions by 5 dBA L_{eq} or more.

Reasonable regulation of the hours of construction, as well as regulation of the arrival and operation of heavy equipment and the delivery of construction material, are necessary to protect the health and safety of persons, promote the general welfare of the community, and maintain the quality of life. The City of Santa Rosa requires contractors to adhere to the following construction best management practices to reduce construction noise levels emanating from the site and minimize disruption and annoyance at existing noise-sensitive receptors in the project vicinity.

Construction Best Management Practices

Develop a construction noise control plan, including, but not limited to, the following available controls:

- Limit construction hours to between 7:00 a.m. and 7:00 p.m., Monday through Friday.
- Avoid overlapping construction phases, where feasible.
- Construct temporary noise barriers, where feasible, to screen stationary noise-generating equipment. Temporary noise barrier fences would provide a 5 dBA noise reduction if the noise barrier interrupts the line-of-sight between the noise source and receiver and if the barrier is constructed in a manner that eliminates any cracks or gaps.
- Equip all internal combustion engine-driven equipment with intake and exhaust mufflers that are in good condition and appropriate for the equipment.
- Unnecessary idling of internal combustion engines should be strictly prohibited.
- Locate stationary noise-generating equipment, such as air compressors or portable power generators, as far as possible from sensitive receptors as feasible. If they must be located near receptors, adequate muffling (with enclosures where feasible and appropriate) shall be used to reduce noise levels at the adjacent sensitive receptors. Any enclosure openings or venting shall face away from sensitive receptors.
- Utilize "quiet" air compressors and other stationary noise sources where technology exists.
- Construction staging areas shall be established at locations that will create the greatest distance between the construction-related noise sources and noise-sensitive receptors nearest the project site during all project construction.
- Locate material stockpiles, as well as maintenance/equipment staging and parking areas, as far as feasible from residential receptors.
- Control noise from construction workers' radios to a point where they are not audible at existing residences bordering the project site.
- The contractor shall prepare a detailed construction schedule for major noise-generating construction activities. The construction plan shall identify a procedure for coordination

with adjacent residential land uses so that construction activities can be scheduled to minimize noise disturbance.

- Designate a "disturbance coordinator" who would be responsible for responding to any complaints about construction noise. The disturbance coordinator will determine the cause of the noise complaint (e.g., bad muffler, etc.) and will require that reasonable measures be implemented to correct the problem. Conspicuously post a telephone number for the disturbance coordinator at the construction site and include in it the notice sent to neighbors regarding the construction schedule.

The implementation of the reasonable and feasible controls outlined above would reduce construction noise levels emanating from the site in order to minimize disruption and annoyance. With the implementation of these controls, and considering that construction is temporary, the impact would be reduced to a less-than-significant level.

TABLE 5 Construction Equipment, 50-foot Noise Emission Limits

Equipment Category	L_{max} Level (dBA)^{1,2}	Impact/Continuous
Arc Welder	73	Continuous
Auger Drill Rig	85	Continuous
Backhoe	80	Continuous
Bar Bender	80	Continuous
Boring Jack Power Unit	80	Continuous
Chain Saw	85	Continuous
Compressor ³	70	Continuous
Compressor (other)	80	Continuous
Concrete Mixer	85	Continuous
Concrete Pump	82	Continuous
Concrete Saw	90	Continuous
Concrete Vibrator	80	Continuous
Crane	85	Continuous
Dozer	85	Continuous
Excavator	85	Continuous
Front End Loader	80	Continuous
Generator	82	Continuous
Generator (25 KVA or less)	70	Continuous
Gradall	85	Continuous
Grader	85	Continuous
Grinder Saw	85	Continuous
Horizontal Boring Hydro Jack	80	Continuous
Hydra Break Ram	90	Impact
Impact Pile Driver	105	Impact
Insitu Soil Sampling Rig	84	Continuous
Jackhammer	85	Impact
Mounted Impact Hammer (hoe ram)	90	Impact
Paver	85	Continuous
Pneumatic Tools	85	Continuous
Pumps	77	Continuous
Rock Drill	85	Continuous
Scraper	85	Continuous

Equipment Category	L _{max} Level (dBA) ^{1,2}	Impact/Continuous
Slurry Trenching Machine	82	Continuous
Soil Mix Drill Rig	80	Continuous
Street Sweeper	80	Continuous
Tractor	84	Continuous
Truck (dump, delivery)	84	Continuous
Vacuum Excavator Truck (vac-truck)	85	Continuous
Vibratory Compactor	80	Continuous
Vibratory Pile Driver	95	Continuous
All other equipment with engines larger than 5 HP	85	Continuous

Notes: ¹ Measured at 50 feet from the construction equipment, with a “slow” (1 sec.) time constant.

² Noise limits apply to total noise emitted from equipment and associated components operating at full power while engaged in its intended operation.

³ Portable Air Compressor rated at 75 cfm or greater and that operates at greater than 50 psi.

TABLE 6 Typical Ranges of Construction Noise Levels at 50 Feet, L_{eq} (dBA)

	Domestic Housing		Office Building, Hotel, Hospital, School, Public Works		Industrial Parking Garage, Religious Amusement & Recreations, Store, Service Station		Public Works Roads & Highways, Sewers, and Trenches	
	I	II	I	II	I	II	I	II
Ground Clearing	83	83	84	84	84	83	84	84
Excavation	88	75	89	79	89	71	88	78
Foundations	81	81	78	78	77	77	88	88
Erection	81	65	87	75	84	72	79	78
Finishing	88	72	89	75	89	74	84	84
I - All pertinent equipment present at site.								
II - Minimum required equipment present at site.								

Source: U.S.E.P.A., Legal Compilation on Noise, Vol. 1, p. 2-104, 1973.

Mitigation Measure 5: No further mitigation required.