

Kincade Fire's Impacts to Regional Water Reuse Operations

Board of Public Utilities

December 19, 2019

Joe Schwall
Deputy Director
Regional Water Reuse Operations



OUR FUTURE IN EVERY DRÖP




Kincade Fire Damaged Power Poles and Electrical Infrastructure

- Eight power poles were destroyed.
- Power could not be delivered to Geysers pump stations.
- Calpine and City staff worked diligently to restore power and operations to the Geysers pipeline.



Recycled Water Storage Assuming Average Monthly Flows

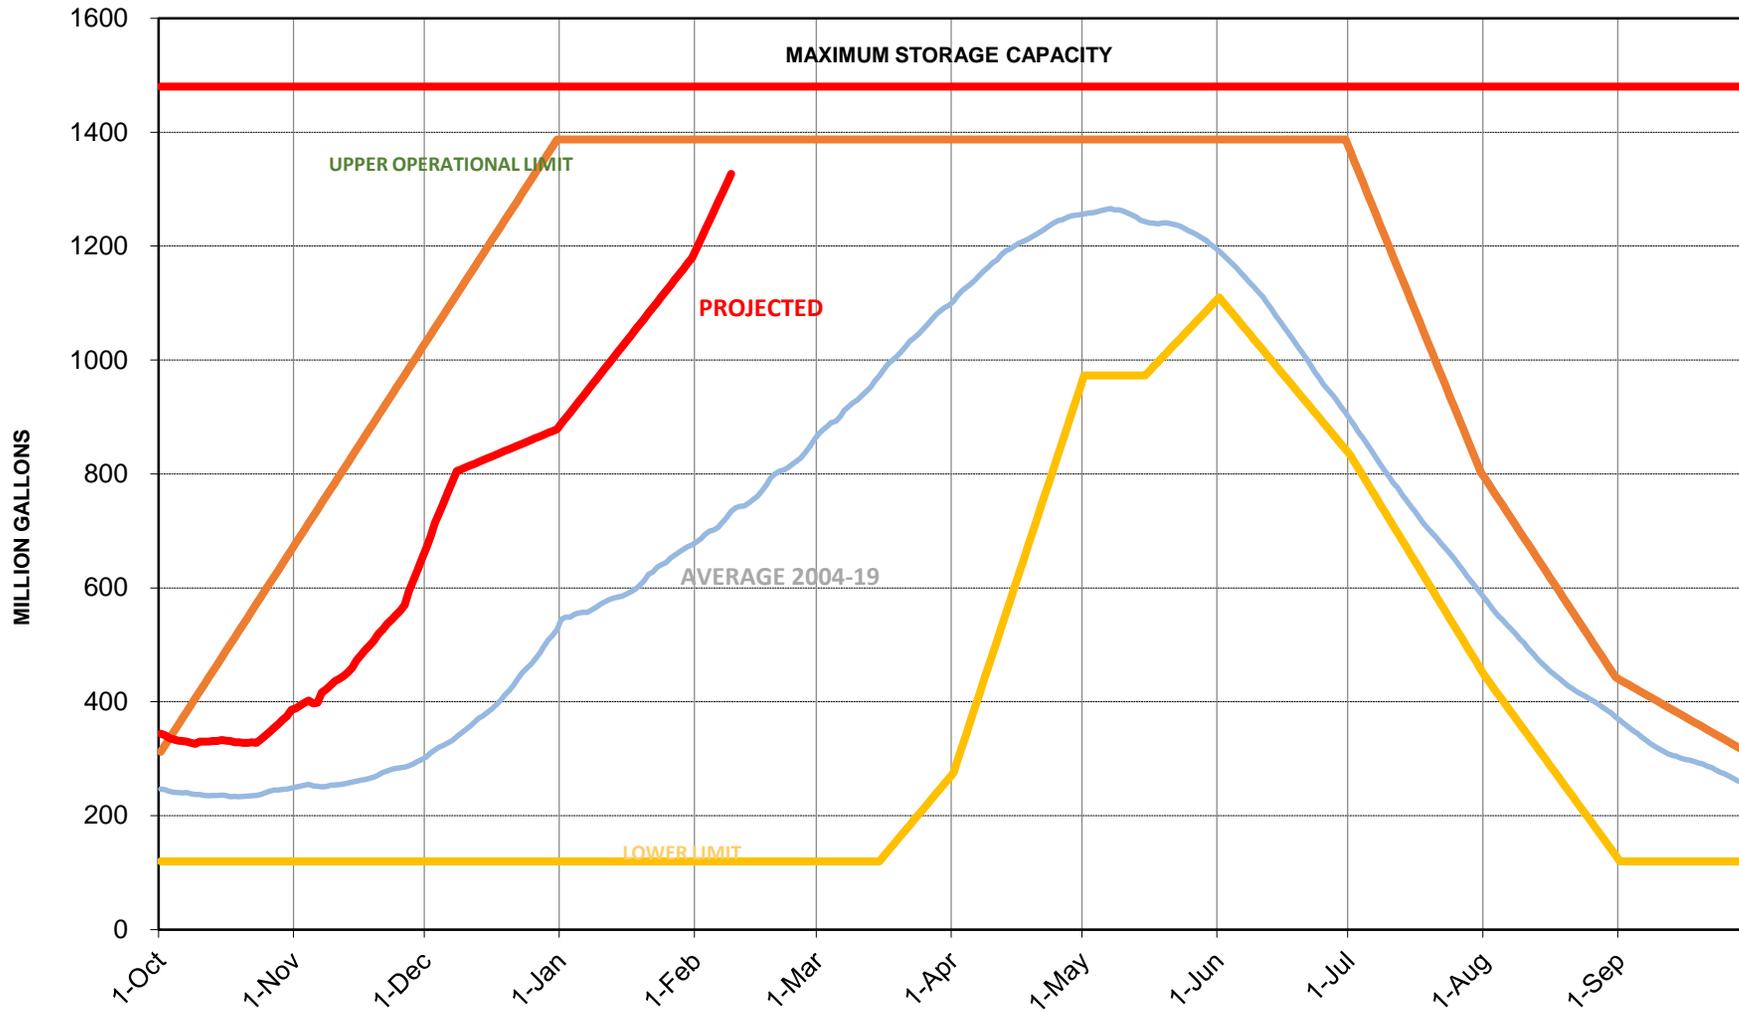

Mitigating Fire Impacts through the Winter



Managing Recycled Water Supply and Demand

Communication
with North Coast
Regional Water
Quality Control
Board

Indoor Winter
WaterSmart
Campaign Launch

