

LLANO TRUNK REHABILITATION MITIGATED NEGATIVE DECLARATION

Board of Public Utilities Meeting

April 3, 2025


Richela Maeda, Associate Civil Engineer
Transportation and Public Works



Presentation Outline

- Project Development
- Location & Scope
- Cured-in-Place Pipe Lining
- Bypass Pumping System
- California Environmental Quality Act
- Recommendation

Project Development

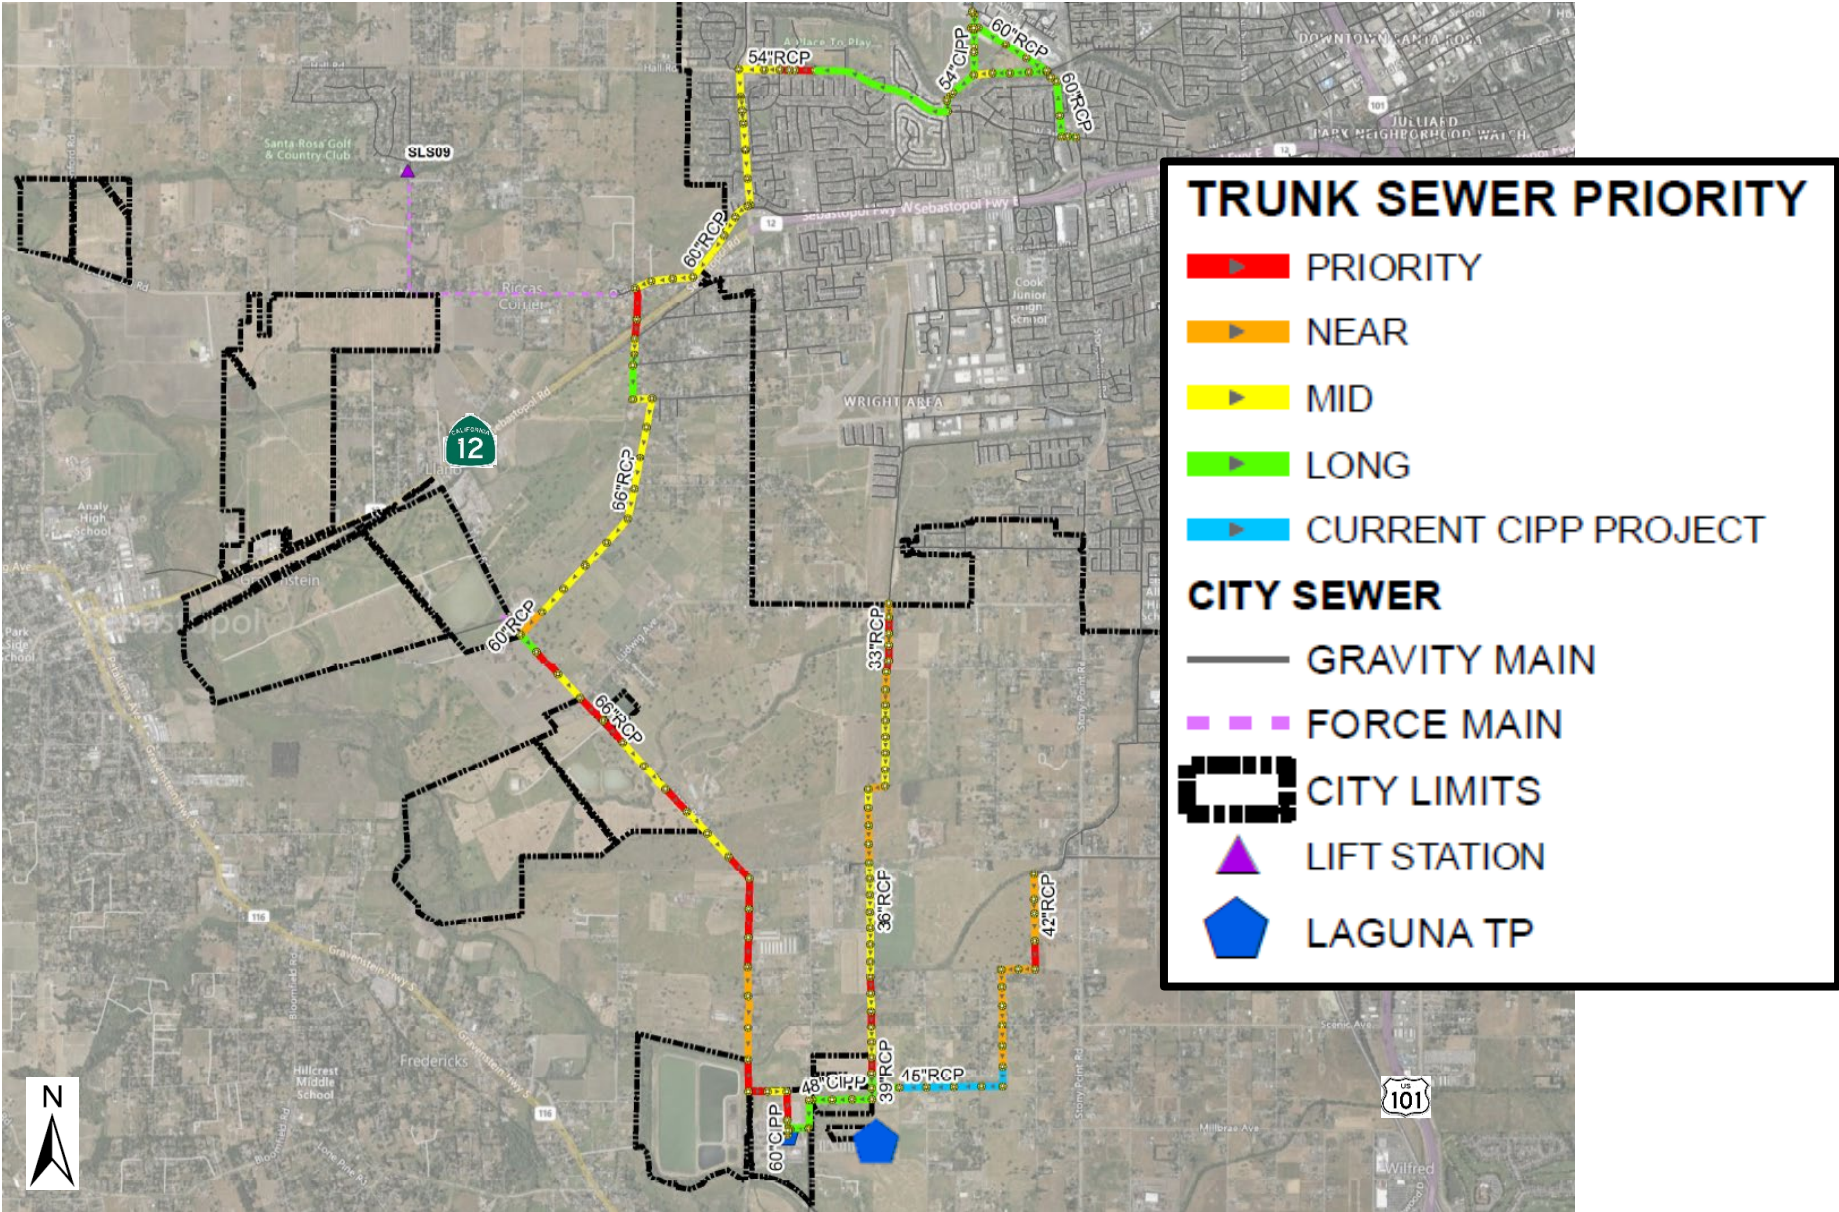


Location & Scope



- 8,100 linear feet of 66" sewer pipe
- 12 manholes
- Bypass system

Cured-in-Place Pipe Lining

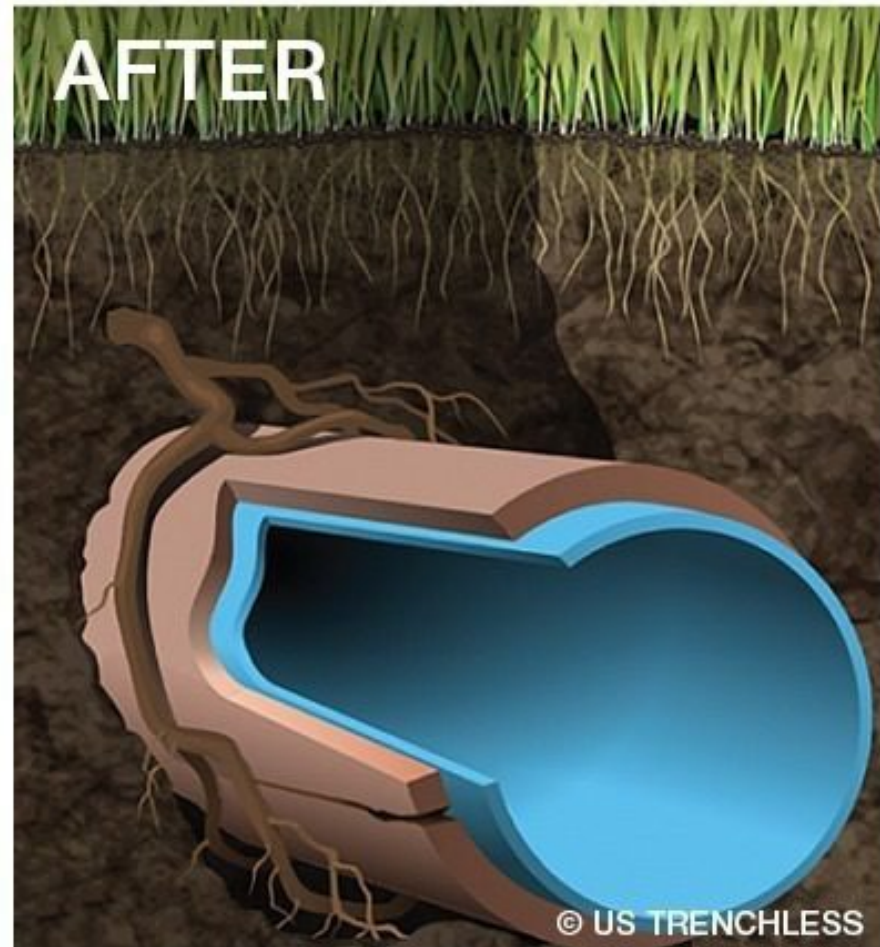

Cured-in-Place Pipe Lining



LINER

Bypass Pumping & Piping



CEQA Process

1. Preparation of Initial Study/Mitigated Negative Declaration (IS/MND)
2. Public review period
3. Response to Comments
4. Mitigation Monitoring and Reporting Program
5. Adoption of MND
6. File Notice of Determination

CEQA Noticing & Public Review

- Assembly Bill 52 Tribal Notifications
- Public Comment Period: 2/13/25 - 3/17/25
- Noticing in The Press Democrat and at County Clerk
- Distribution to State Clearinghouse and Agencies
- Public review copies (online & at City TPW)

CEQA Key Mitigation Measures

- Wildlife exclusion fencing
- Biological monitoring
- June 15 - October 15
- Mitigation credits



CEQA Summary

- Project evaluated in accordance with CEQA guidelines
- Potential impacts can be reduced to less-than-significant levels
- No significant unavoidable impacts identified
- Analysis supports Mitigated Negative Declaration
- Mitigation Monitoring and Reporting Program developed for compliance

Recommendation

It is recommended by Santa Rosa Water and the Transportation and Public Works Department that the Board of Public Utilities, by resolution adopt the Mitigated Negative Declaration for the Llano Road Trunk Rehabilitation Project, adopt the Mitigation Monitoring and Reporting Program, approve the Llano Road Trunk Rehabilitation Project, and direct staff to file a Notice of Determination.

Questions?

