


For manhole cover and frame see STD. 512. Cover to be Labeled "STORM DRAIN". Pick holes may be open or closed

See note 3

Concrete collar required per STD-410.

Grout all voids between manhole and pipes and seal joints with 1:3 mortar.

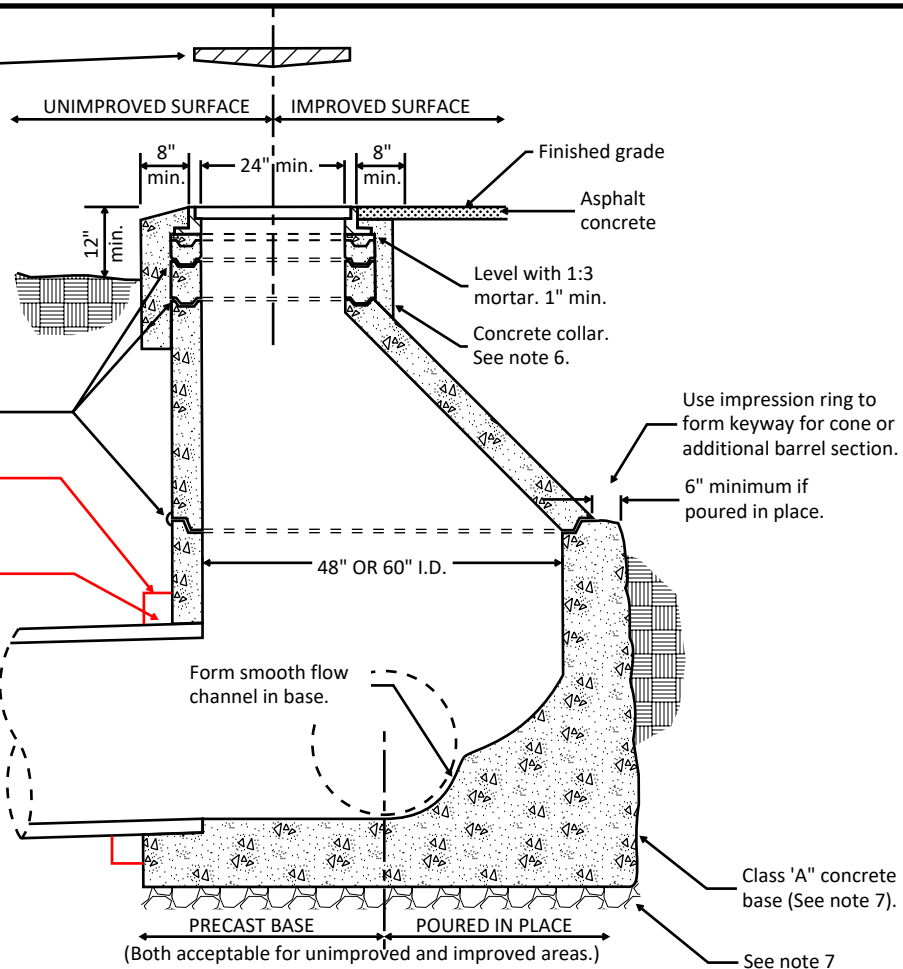

## NOTES:

- When manholes are installed in unimproved areas, the top of the cover shall be a min. of 1 foot above adjacent finished grade.
- Min. of one 3" grade adjustment ring. Max. height of grade adjustment ring=20". Alternatively, contractor may cast grade adjustment rings in place.
- Set all sections in 1:3 mortar bed. Wet both tongue and groove before applying mortar. Wipe inside of joint smooth and plaster outside of joint with 1/2" layer of mortar. Ram-nek gaskets or approved equal may be used instead of mortar.
- Cone section (taper) may be concentric or eccentric unless otherwise specified by the Engineer.
- All precast manhole sections per ASTM C478.
- Class "A" conc. collar shall be 2" below top of manhole cover in improved surface areas.
- Poured-in-place base shall be poured full thickness to undisturbed sides of excavation, sloped at 1:1 or shall be formed. Precast base shall be from City Engineer's approved list and be placed on 6" thick 3/4" drain rock sub-base installed against undisturbed earth.

APPROVED 48" & 60" PRECAST  
STORM DRAIN MANHOLE  
COMPONENTS

See Engineer's approved list

**CITY OF SANTA ROSA**

**PRECAST STANDARD CONCRETE  
STORM DRAIN MANHOLE**

Scale: NONE

DRAFT MARCH 2025

DWN: EDS


APPROVED:

FILE NO:

CHK:



STD - 400

#5 lifting eye (TOTAL 2). Lifting eye to be located at balance point

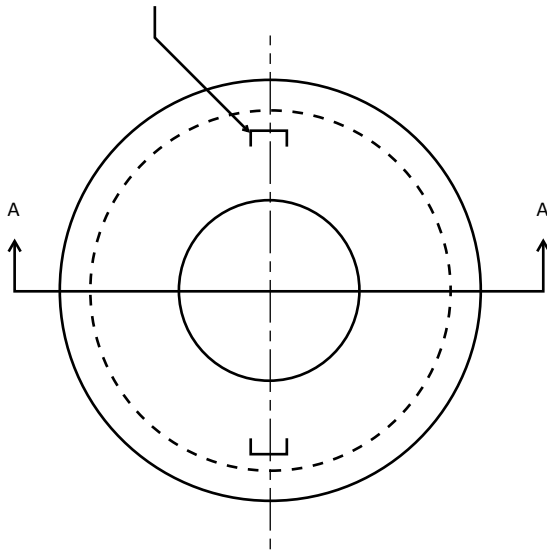

"CITY OF SANTA ROSA"

Standard 24" heavy duty, non rocking manhole frame and cover.

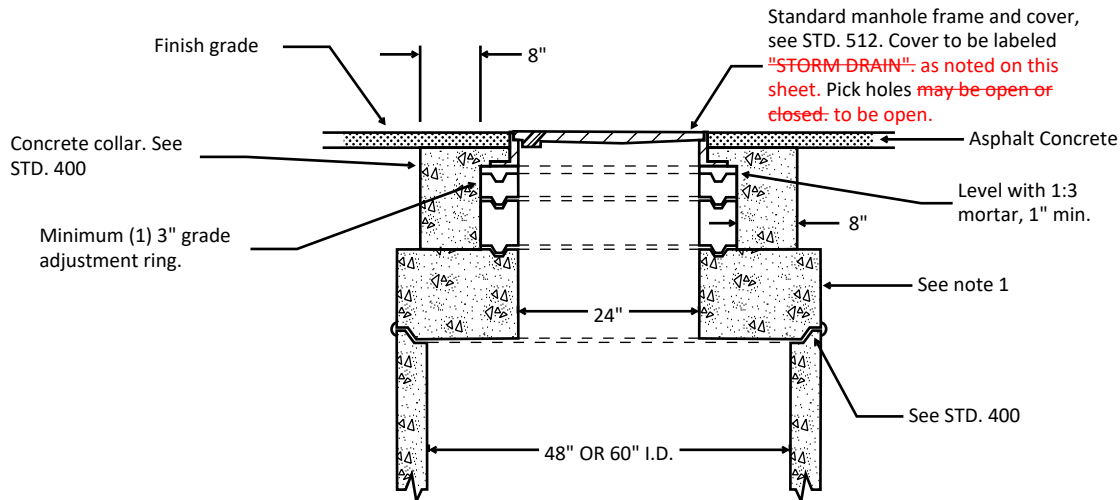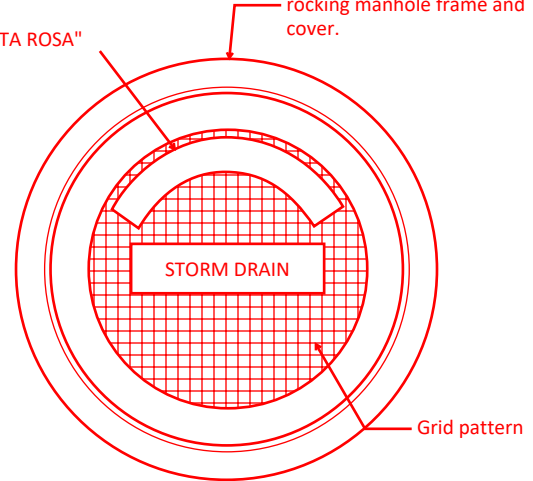

SECTION A-A

## NOTES:

1. Reducer slab shall be designed to withstand H20 loading and conform to ASTM C478.
2. All inside joints to be grouted smooth.
3. Class A concrete collar shall be poured to 2" below finished grade.
4. Reducers shall be concentric. Eccentric reducers can be used if it would place the opening in a more desirable location or improve access.

For detail and specifications of barrel section and base see City of Santa Rosa STD. 400

APPROVED 48" & 60" MANHOLE REDUCER SLAB  
See Engineer's approved list

## CITY OF SANTA ROSA PRECAST CONCRETE STORM DRAIN MANHOLE REDUCER SLABS




Scale: NONE

DRAFT MARCH 2025

DWN: EDS  
CHK:

APPROVED:

FILE NO:  
STD - 401

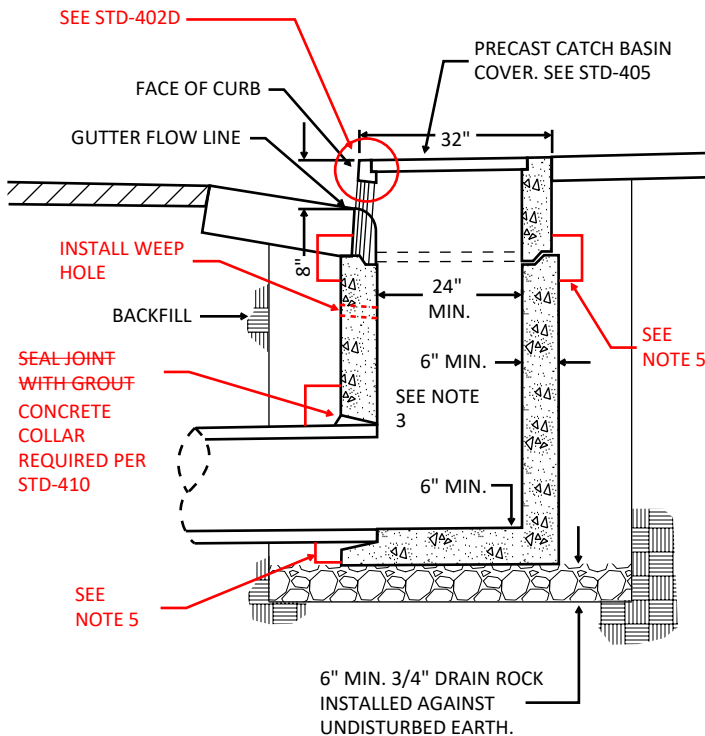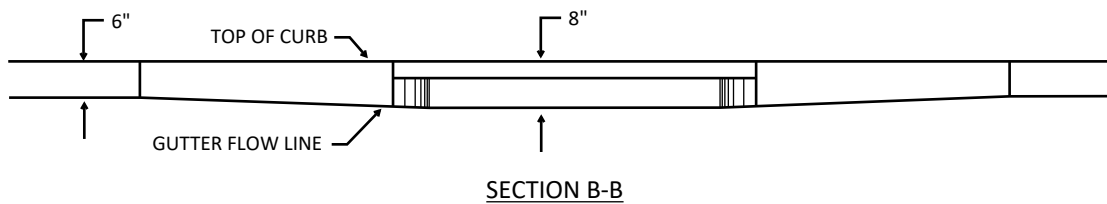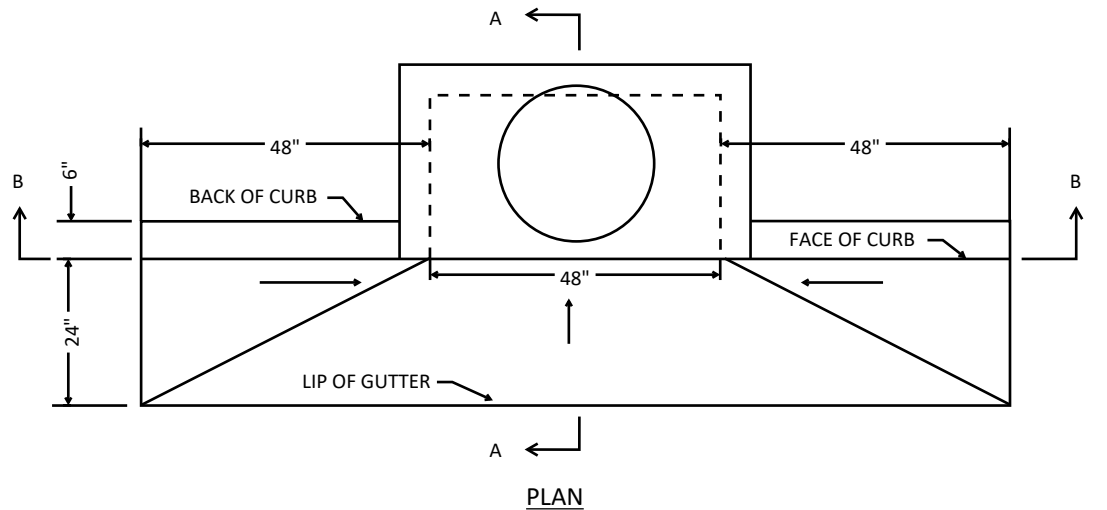

APPROVED TYPE II CATCH BASINS  
See Engineer's approved list

#### NOTES:

1. Catch basin box, and lid if not a **monolithic pour**, shall be constructed to withstand H2O loading. **Cover is not traffic rated.**
2. Concrete shall have a compressive strength of 4000 psi in 28 days.
3. Wall thickness shall be 6" unless depth is greater than 8', then wall thickness shall be 8".
4. Install label per City STD. 409 if cover is not a cast iron cover with the decal incorporated into the cast iron.
5. A concrete collar per STD-410 is required when a pre-cast lid is placed on a pre-cast box.

**CITY OF SANTA ROSA**

**TYPE II CATCH BASIN**




Scale: NONE

DRAFT MARCH 2025

DWN: EDS  
CHK:

APPROVED:

FILE NO:  
STD - 402A

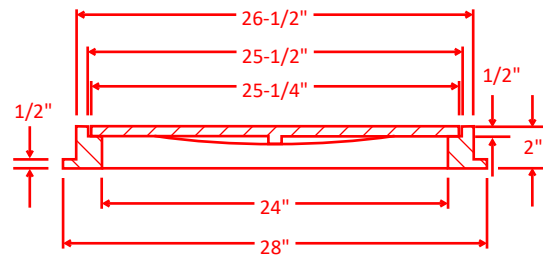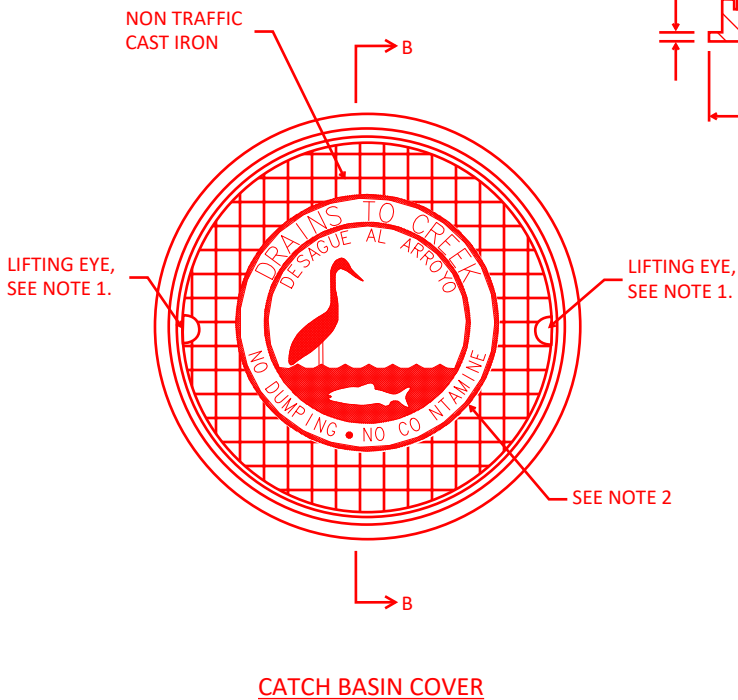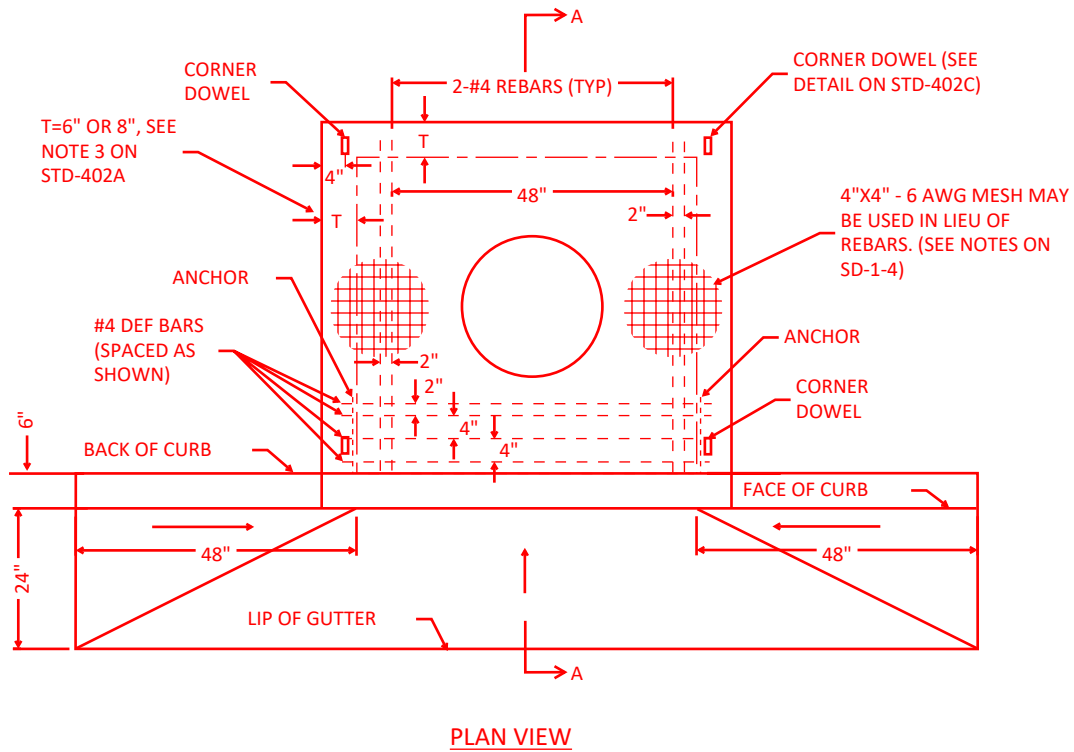

**SECTION B-B**

### NOTES:

1. Include total of two open #5 lifting eyes to be located at balance point. Lifting eyes shall not be blocked by the rim and shall pass through width of lid.
2. When "DRAINS TO CREEK" modification is not available, affix label per STD-409.

**CITY OF SANTA ROSA**

**TYPE II CATCH BASIN**

**Scale: NONE**

**DRAFT MARCH 2025**


**DWN: EDS**

**APPROVED:**


**FILE NO:**

**CHK:**

**STD - 402B**

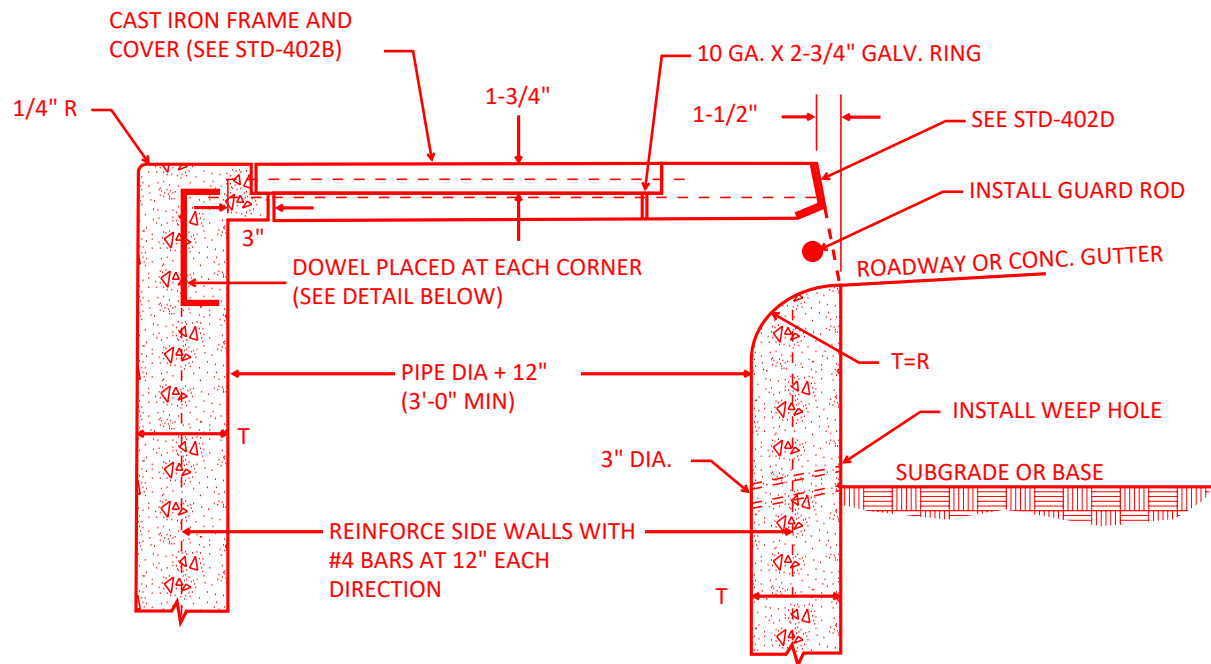

SECTION A-A  
(FROM STD-402B)

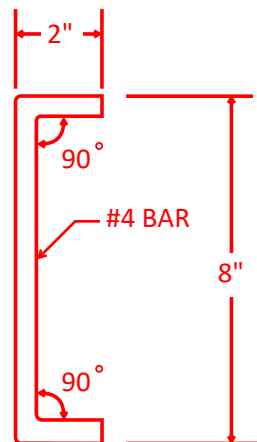

CORNER DOWEL DETAIL

# NOTES:

1. Floor shall be poured and approved prior to pouring of the top.
2. See STD-402E for additional notes.

CITY OF SANTA ROSA

TYPE II CATCH BASIN

Scale: NONE

DRAFT MARCH 2025


DWN: EDS

APPROVED:

FILE NO:

CHK:

STD - 402C

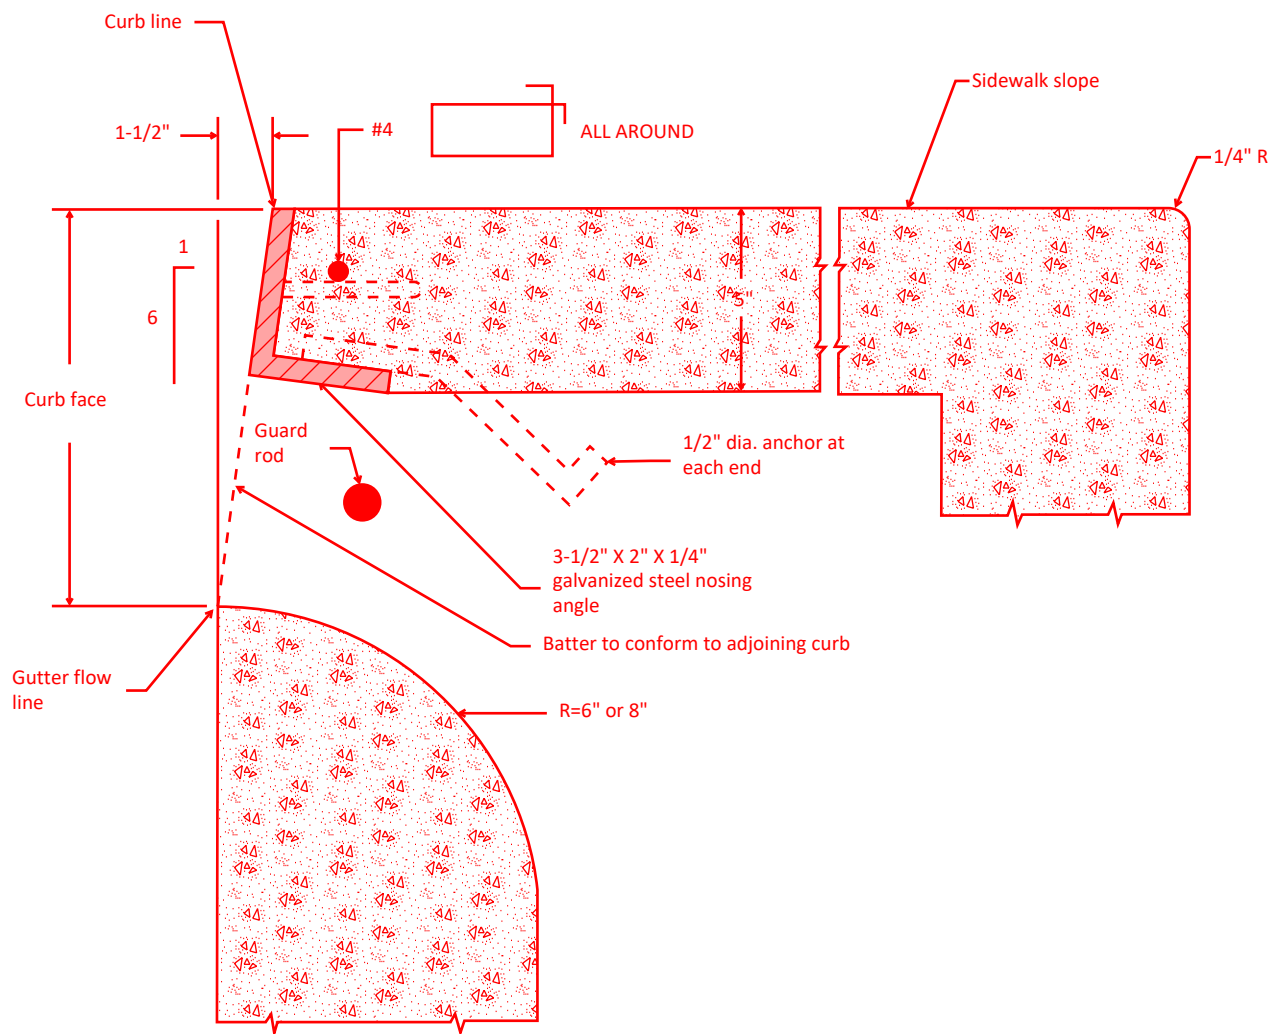

THROAT OPENING DETAIL

**NOTES:**

1. All metal parts shall be hot dipped galvanized after fabrication.
2. All galvanized damaged by welding shall receive two coats of aluminum paint.

**CITY OF SANTA ROSA**

**TYPE II CATCH BASIN**

**Scale: NONE**

**DRAFT MARCH 2025**

**DWN: EDS**

**APPROVED:**

**FILE NO:**

**CHK:**

**STD - 402D**

## NOTES:

1. Connection pipes may be placed in any position around the walls provided the point in the proper direction and the position is otherwise consistent with the improvement plan.
2. Curvature of the lip and sidewalls at gutter opening shall be formed by curved forms and shall not be made by plastering.
3. Wall thickness (T)
  - T = 6 inches if H is 8 feet or less
  - T = 8 inches if H exceeds 8 feet
4. Depth (H) shall be a maximum of 6 feet. For depths between 6 feet to 12 feet, catch basin shall be on a manhole base, see STD-400C. For depths greater than 12 feet deep require a special design by a registered civil engineer.
5. Floor of basin shall be troweled and re-troweled to produce a hard, polished surface of maximum density and smoothness. Slope of floor parallel with curb shall be 1 to 12 unless otherwise specified.
6. Manhole shall be placed as shown on improvement plans.
7. Outlet pipe shall be trimmed to the final shape and length before concrete is poured.
8. Reinforcing steel shall be #4 round deformed bars, or wire mesh as indicated. If wire mesh is used, additional 4"X4" 6 AWG mesh shall be placed around the inlet opening @45 degrees to main mesh reinforcing.
9. Concrete shall meet the requirements of section 90-2 "Minor Concrete" of State Standard Specification.
10. Steps: Steps are required as follows:
  - If H is 3.5 feet or less, no steps are required.
  - If H is more than 3.5 feet, but no more than 4 feet, install 1 step 12 inches above floor of basin
  - If H is more than 4 feet, install steps 12 inches apart, with the top step 6 inches below the surface of the basin and 12 inches above the floor.
  - All steps shall be 6 to 7 inches from the wall.
  - 3/4 inch galvanized steel or polypropylene plastic (Caltrans D72).
11. Surface of all exposed concrete in basin shall conform in slope, grade, color, finish, and scoring to existing or proposed curb and walk adjacent to the basin.
12. General Notes:
  - Catch basin details shown are for cast-in-place and/or when not included on the Engineer's List of approved items.

**CITY OF SANTA ROSA**

**TYPE II CATCH BASIN**

**Scale: NONE**

**DRAFT MARCH 2025**


**DWN: EDS**

**APPROVED:**


**FILE NO:**

**CHK:**


**STD - 402E**

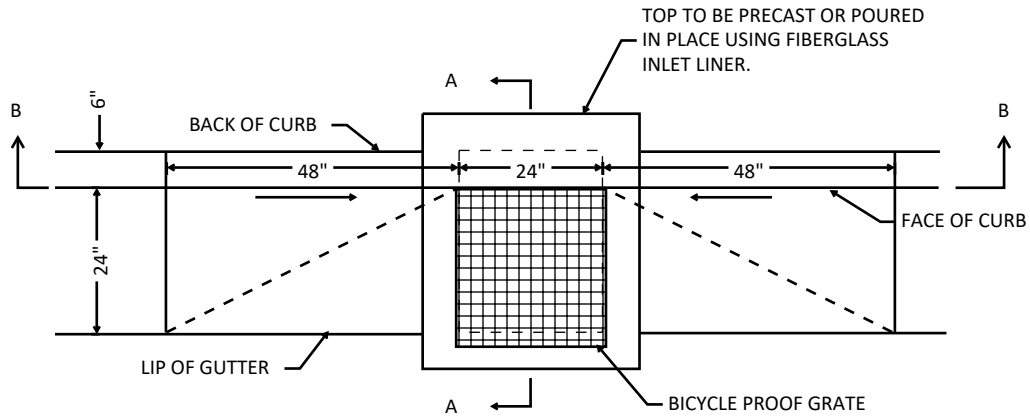

PLAN

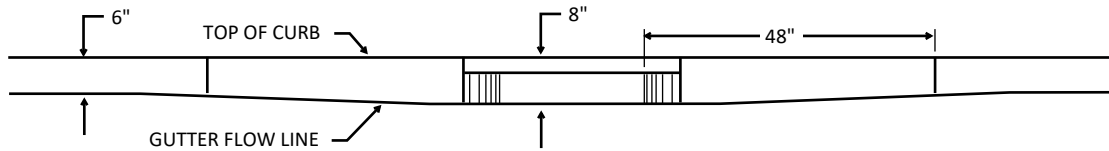

SECTION B-B

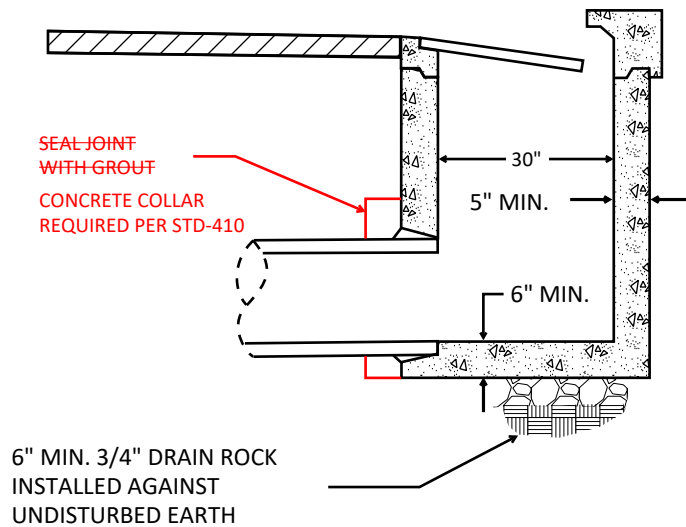

SECTION A-A

### NOTES:

1. Concrete shall have a compressive strength of 4000 psi in 28 days.
2. Grate and nosing angle shall be hot dipped galvanized after fabrication per ASTM A-123
3. Grate frames shall be installed tight against gutter flowline
4. Catch basin box and grate shall be constructed to withstand H20 loading.
5. Install label per City STD-409.

ONLY TO BE USED WHERE SPECIFICALLY APPROVED BY VARIANCE

**APPROVED TYPE I CATCH BASINS**  
See Engineer's approved list

**CITY OF SANTA ROSA**

**TYPE I CATCH BASIN**

Scale: NONE

DRAFT MARCH 2025

DWN: EDS


APPROVED:

FILE NO:


CHK:

STD - 403



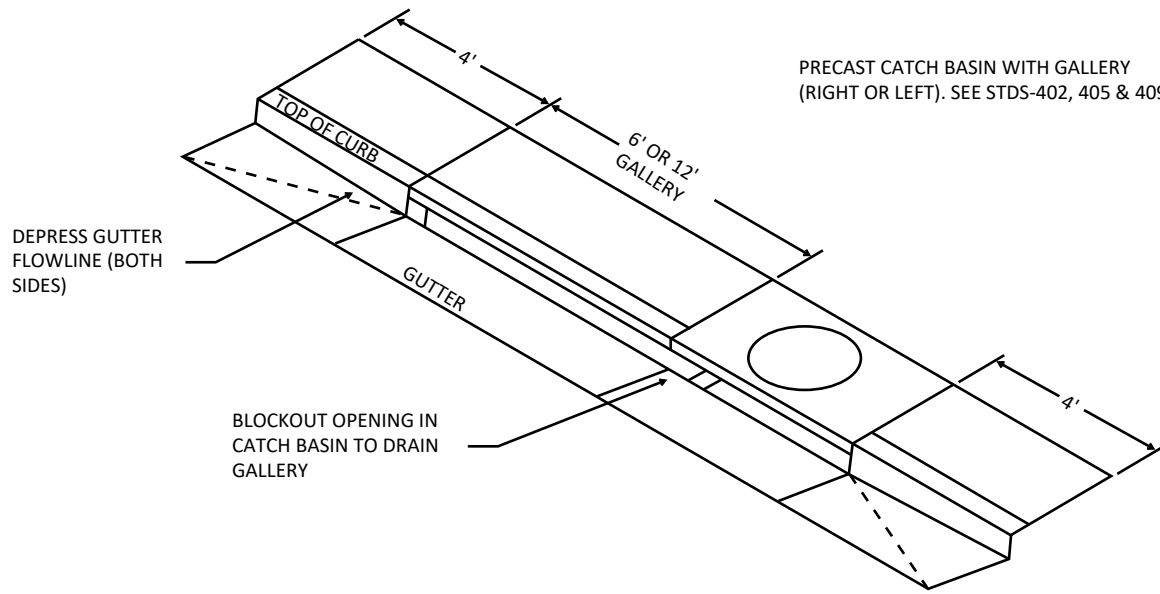

ISOMETRIC VIEW

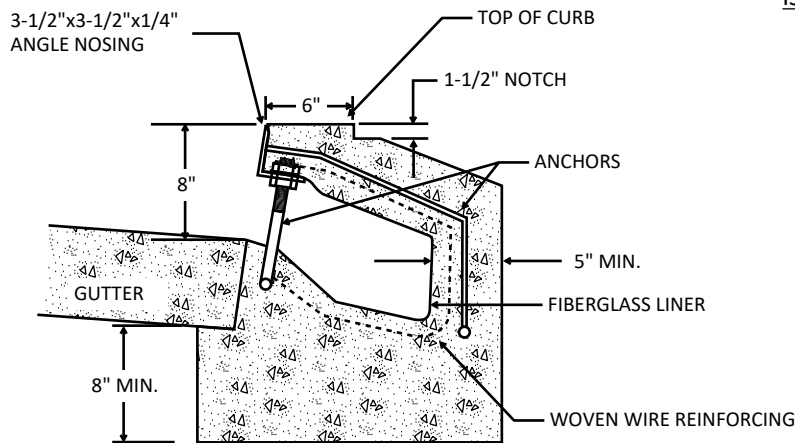

TYPICAL SECTION INSTALLED

**NOTES:**

1. Nosing assembly shall be hot dipped galvanized after fabrication per ASTM A-123.
2. Concrete shall be class A.
3. Install label per City STD-409

APPROVED STORMDRAIN RAIN GALLERY FORM  
See Engineer's approved list

**CITY OF SANTA ROSA**

**STORM DRAIN GALLERY**

Scale: NONE

DRAFT MARCH 2025


DWN: EDS

APPROVED:


FILE NO:

CHK:

STD - 404

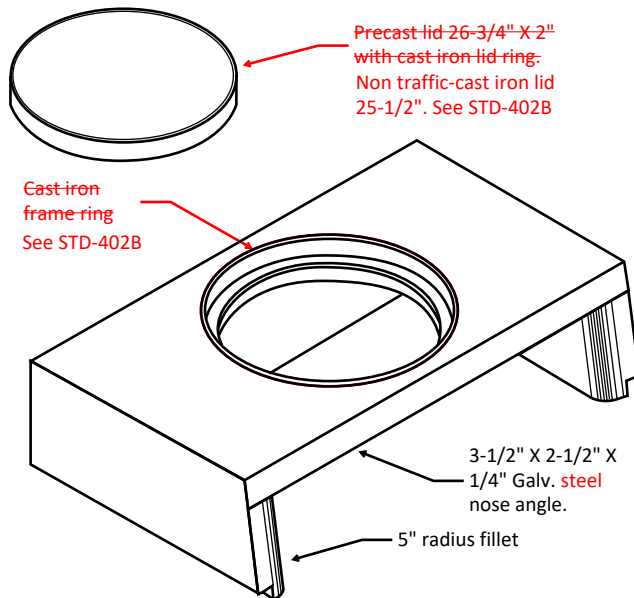


ISOMETRIC

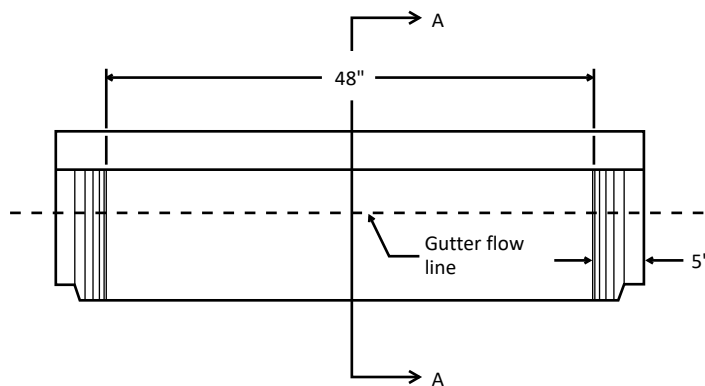

ELEVATION

## NOTES:

1. Concrete shall have a compressive strength of 4000 PSI at 28 days
2. Nosing angle shall be galvanized in accordance with ASTM specification A-123.
3. Exposed concrete surface shall have broom finish.
4. Cast iron shall conform to ASTM 48-30.
5. Apply label per City STD-409.
6. Frame ring inside diameter to be 5/16" to 3/8" greater than lid ring outside diameter.

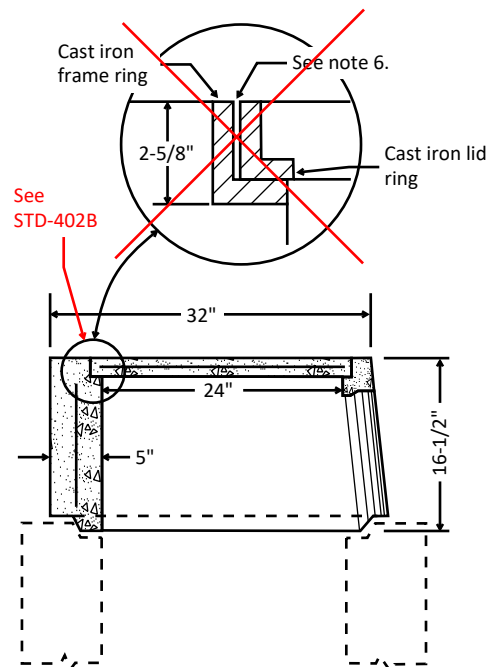

SECTION A-A

APPROVED PRECAST CATCH BASIN COVERS  
See Engineer's approved list

**CITY OF SANTA ROSA**

**PRECAST CATCH BASIN COVER**



Scale: NONE

DRAFT MARCH 2025

DWN: EDS  
CHK:

APPROVED:


FILE NO:  
STD - 405

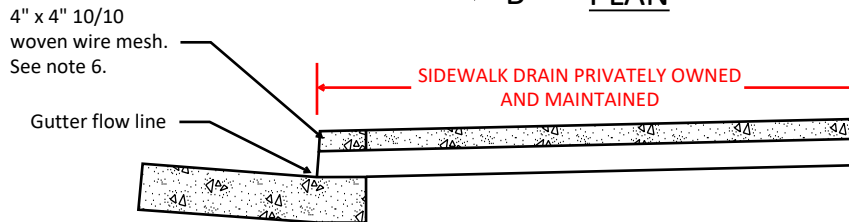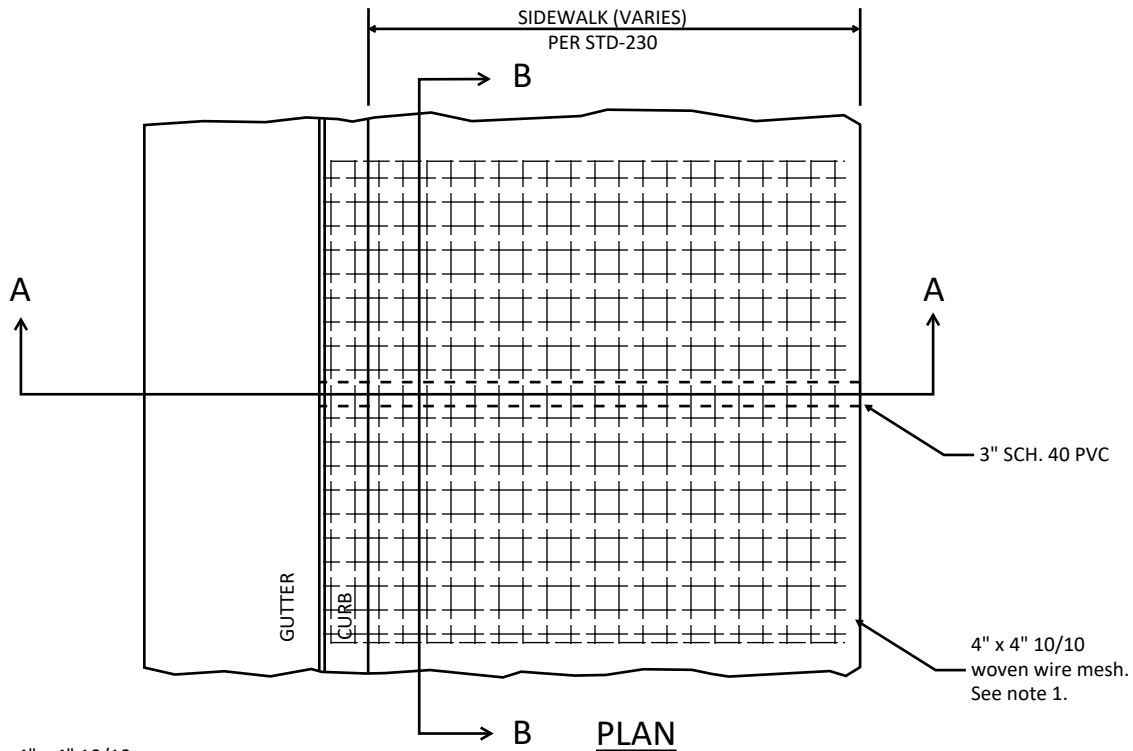

SECTION A-A

**NOTES:**

1. Wire mesh shall be full width of sidewalk minus 2". Length of wire mesh shall, at a minimum, equal the width and be centered over the pipe.
2. On-site drainage and location of curb outlets shall be by owner to the satisfaction of the City Engineer.
3. Drain pipe shall be installed so that the top of pipe is 2-1/2" (min.) below finished grade at back of sidewalk.
4. Sidewalk shall be removed to the nearest scoremark.
5. If sidewalk and gutter are not contiguous, curb may be cored or curb and gutter removed and replaced a minimum of one foot on each side of the drain pipe. Dowel new gutter to existing curb and gutter with (2) 12" #4 rebars, place one dowel in curb and one in gutter pan using epoxy.
6. If sidewalk and gutter are contiguous, pour monolithic with wire fabric extending into curb.

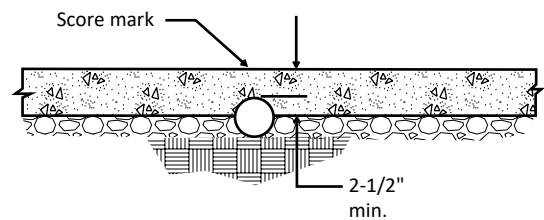

SECTION B-B  
(for one 3" pipe)

**CITY OF SANTA ROSA**

**3" SIDEWALK DRAIN**

Scale: NONE

DRAFT MARCH 2025



DWN: EDS

APPROVED:

FILE NO:

CHK:


STD - 406A

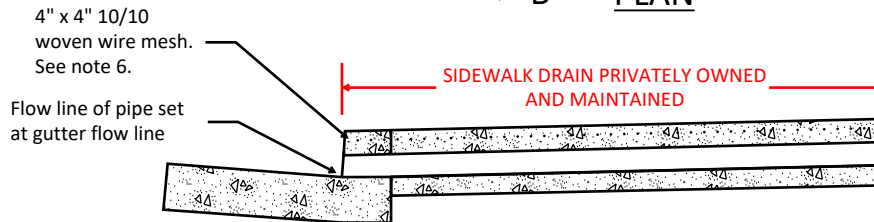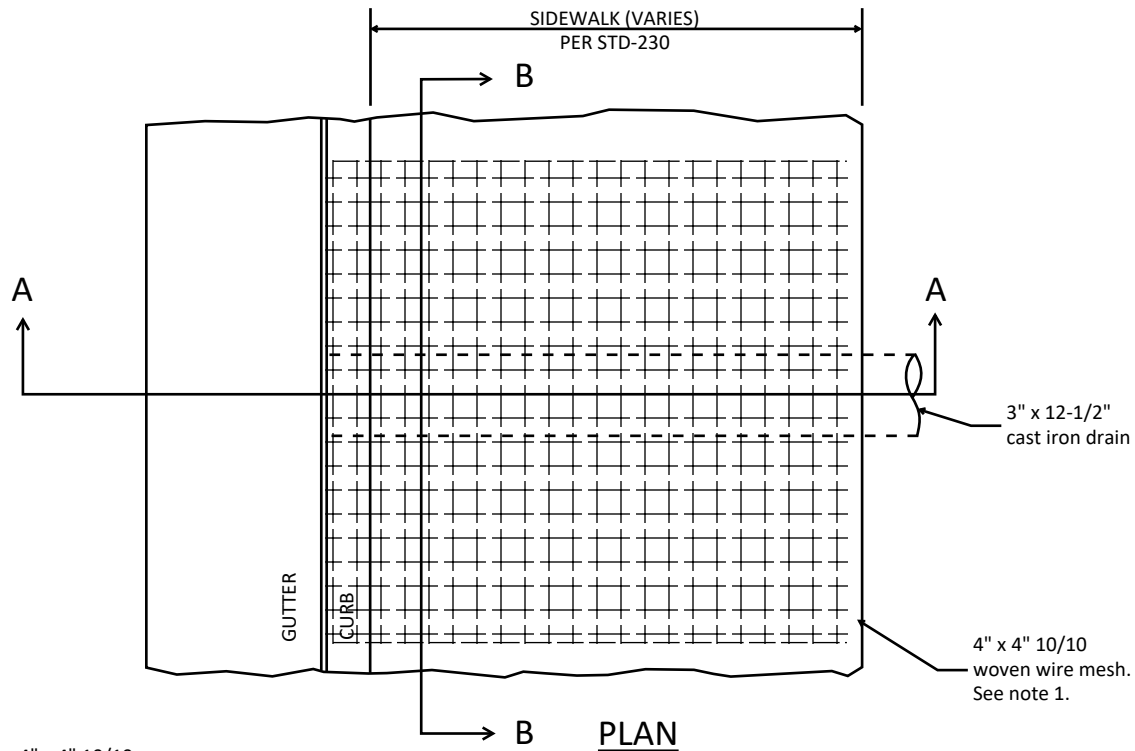

**SECTION A-A**

**NOTES:**

1. Wire mesh shall be full width of sidewalk minus 2". Length of wire mesh shall, at a minimum, equal the width and be centered over the pipe.
2. On-site drainage and location of curb outlets shall be by owner to the satisfaction of the City Engineer.
3. Drain pipe shall be installed so that the top of pipe is 2-1/2" (min.) below finished grade at back of sidewalk.
4. Sidewalk shall be removed to the nearest scoremark.
5. If sidewalk and gutter are not contiguous, curb may be cored or curb and gutter removed and replaced a minimum of one foot on each side of the drain pipe. Dowel new gutter to existing curb and gutter with (2) 12" #4 rebars, place one dowel in curb and one in gutter pan using epoxy.
6. If sidewalk and gutter are contiguous, pour monolithic with wire fabric extending into curb.

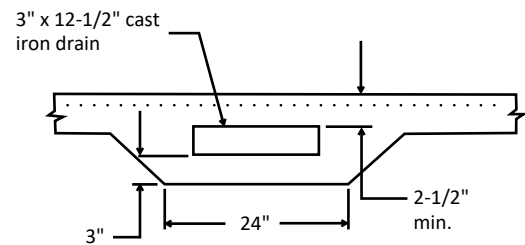

**SECTION B-B**

**CAST IRON SIDEWALK DRAIN**  
See Engineer's Approved List

**CITY OF SANTA ROSA**

**3" X 12-1/2" CAST IRON  
SIDEWALK DRAIN**


Scale: NONE

DRAFT MARCH 2025


DWN: EDS  
CHK:

APPROVED:

FILE NO:  
STD - 406B

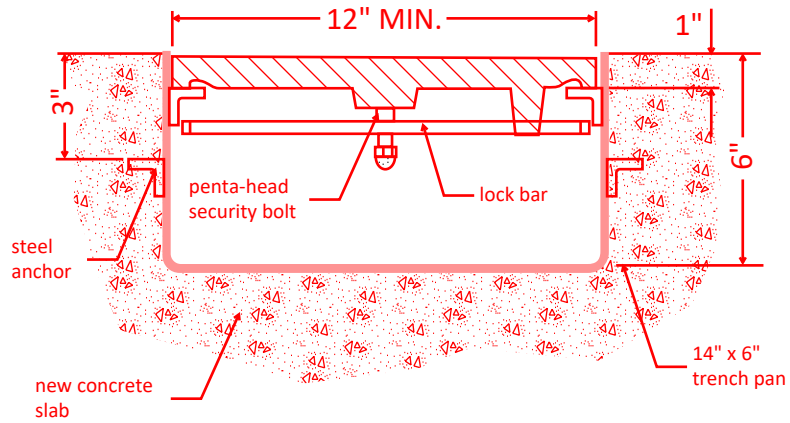

SECTION A-A

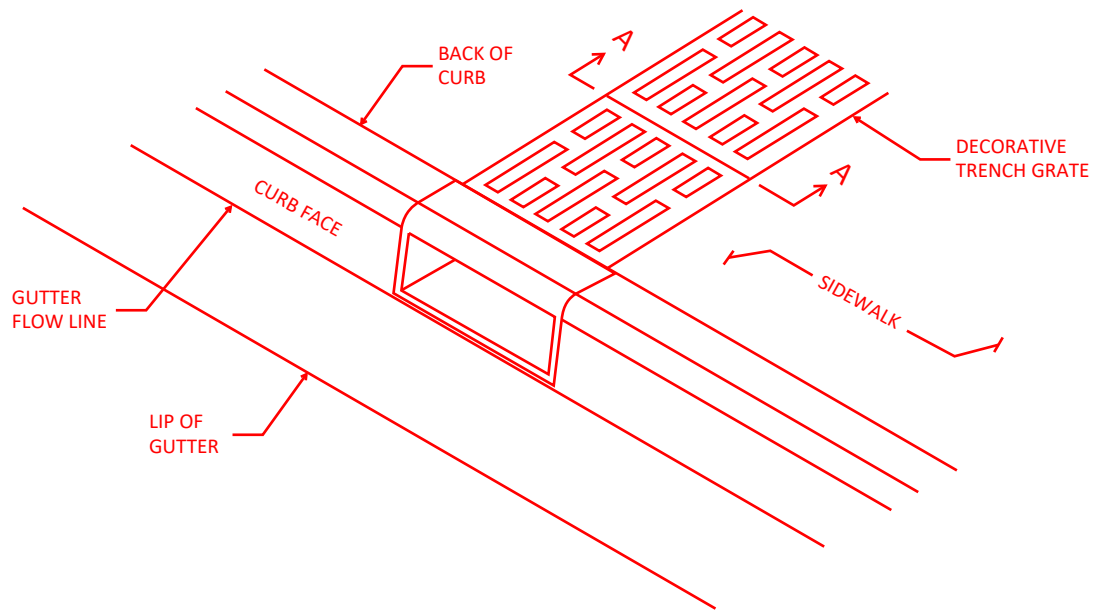

ISOMETRIC VIEW

**CITY OF SANTA ROSA**

**TRENCH DRAIN  
AND GRATE**

Scale: NONE

DRAFT MARCH 2025


DWN: EDS

APPROVED:


FILE NO:

CHK:

STD - 406C

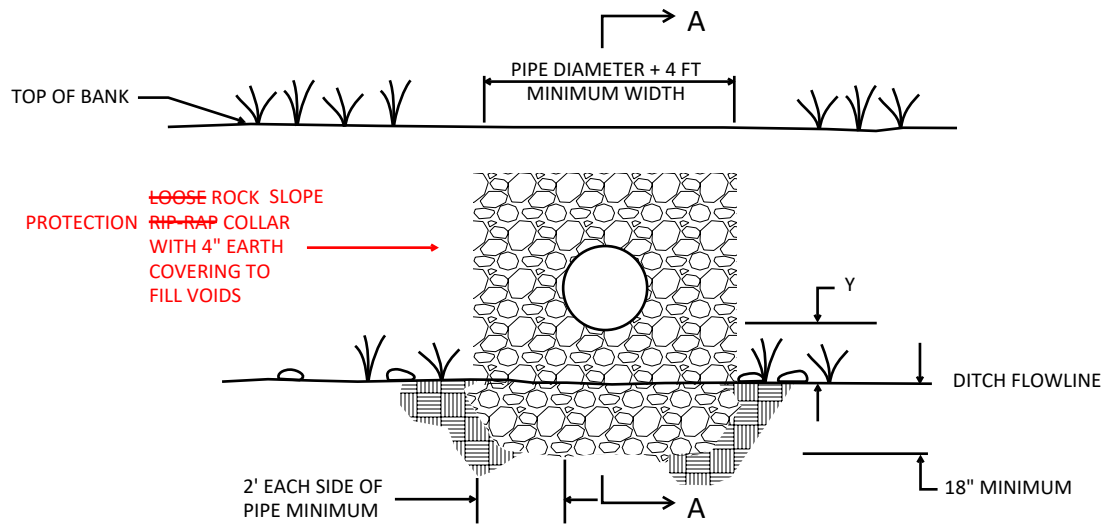

### STORM DRAIN OUTLET ELEVATION

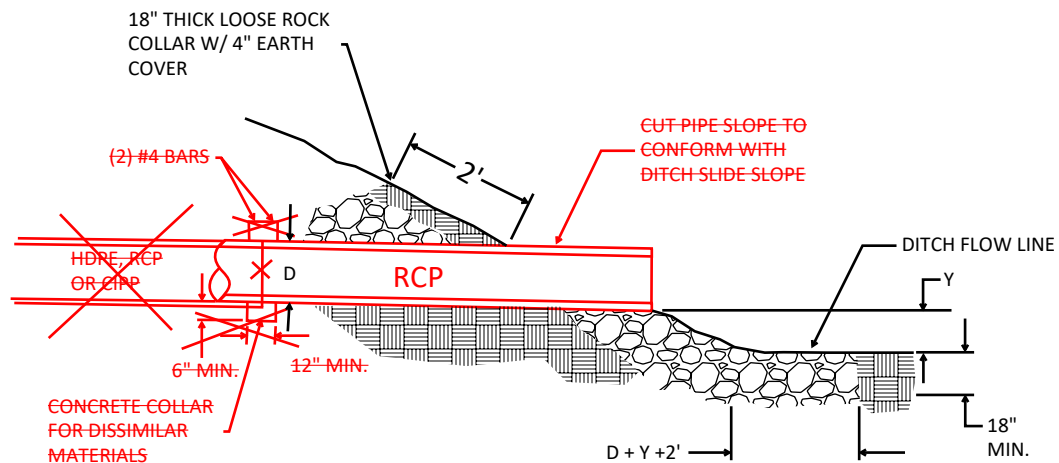

### SECTION A-A

WHEN  $D < 24"$ ,  $Y=2'$   
WHEN  $D \geq 24"$ ,  $Y=1'$

### NOTES:

- 1: CMP shall conform with Section 66-3 of the Standard Specifications:
- 2: HDPE pipe shall conform with Section 64 of the Standard Specification for type S pipe:

CITY OF SANTA ROSA

~~LOOSE ROCK RIP-RAP~~ SLOPE PROTECTION  
STORM DRAIN OUTLET/INLET

Scale: NONE

DRAFT MARCH 2025



DWN: EDS

APPROVED:

FILE NO:

CHK:

STD - 407A

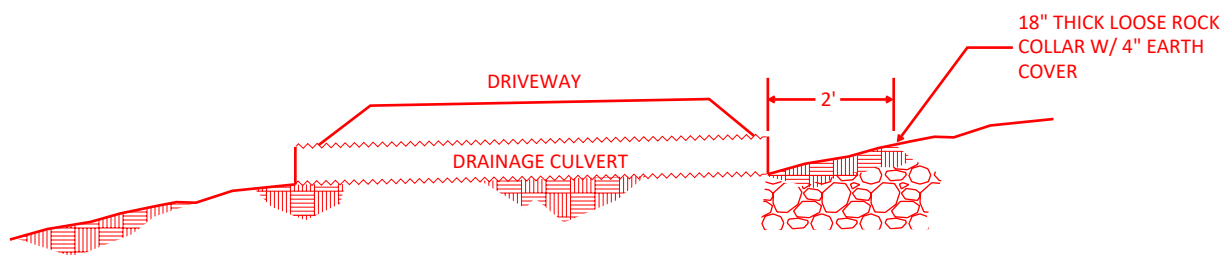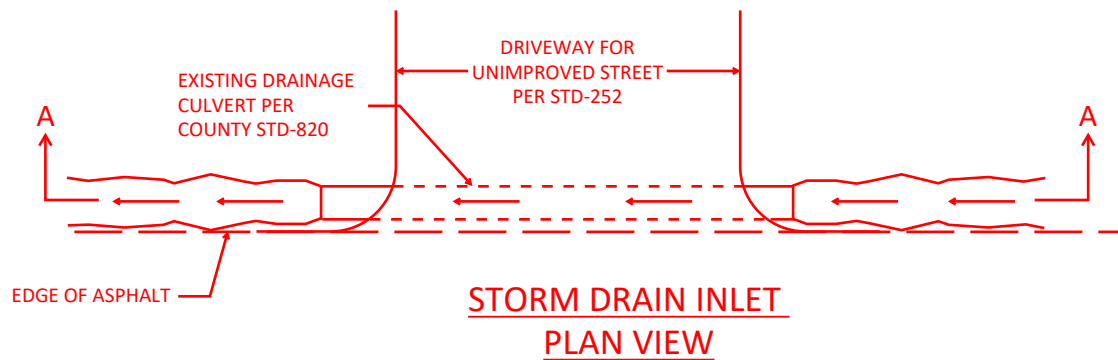

**STORM DRAIN INLET  
SECTION A-A**

## ROCK SLOPE PROTECTION

### MATERIALS

Rocks shall be angular and well graded from an average diameter of four(4) inches to an average diameter of fifteen (15) inches with approximately fifty (50) percent by weight smaller than nine (9) inches in average diameter. Not more than ten (10) percent of the rock rip rap by weight shall be less than four (4) inches average diameter. Not more than ten (10) percent of the rock riprap by weight shall be greater than fifteen (15) inches in average diameter and none shall exceed an average diameter of twenty 20" inches.

**CITY OF SANTA ROSA**

**~~LOOSE ROCK RIP-RAP~~ SLOPE PROTECTION  
STORM DRAIN OUTLET/INLET**

Scale: NONE

DRAFT MARCH 2025


DWN: EDS

APPROVED:

FILE NO:

CHK:

STD - 407B

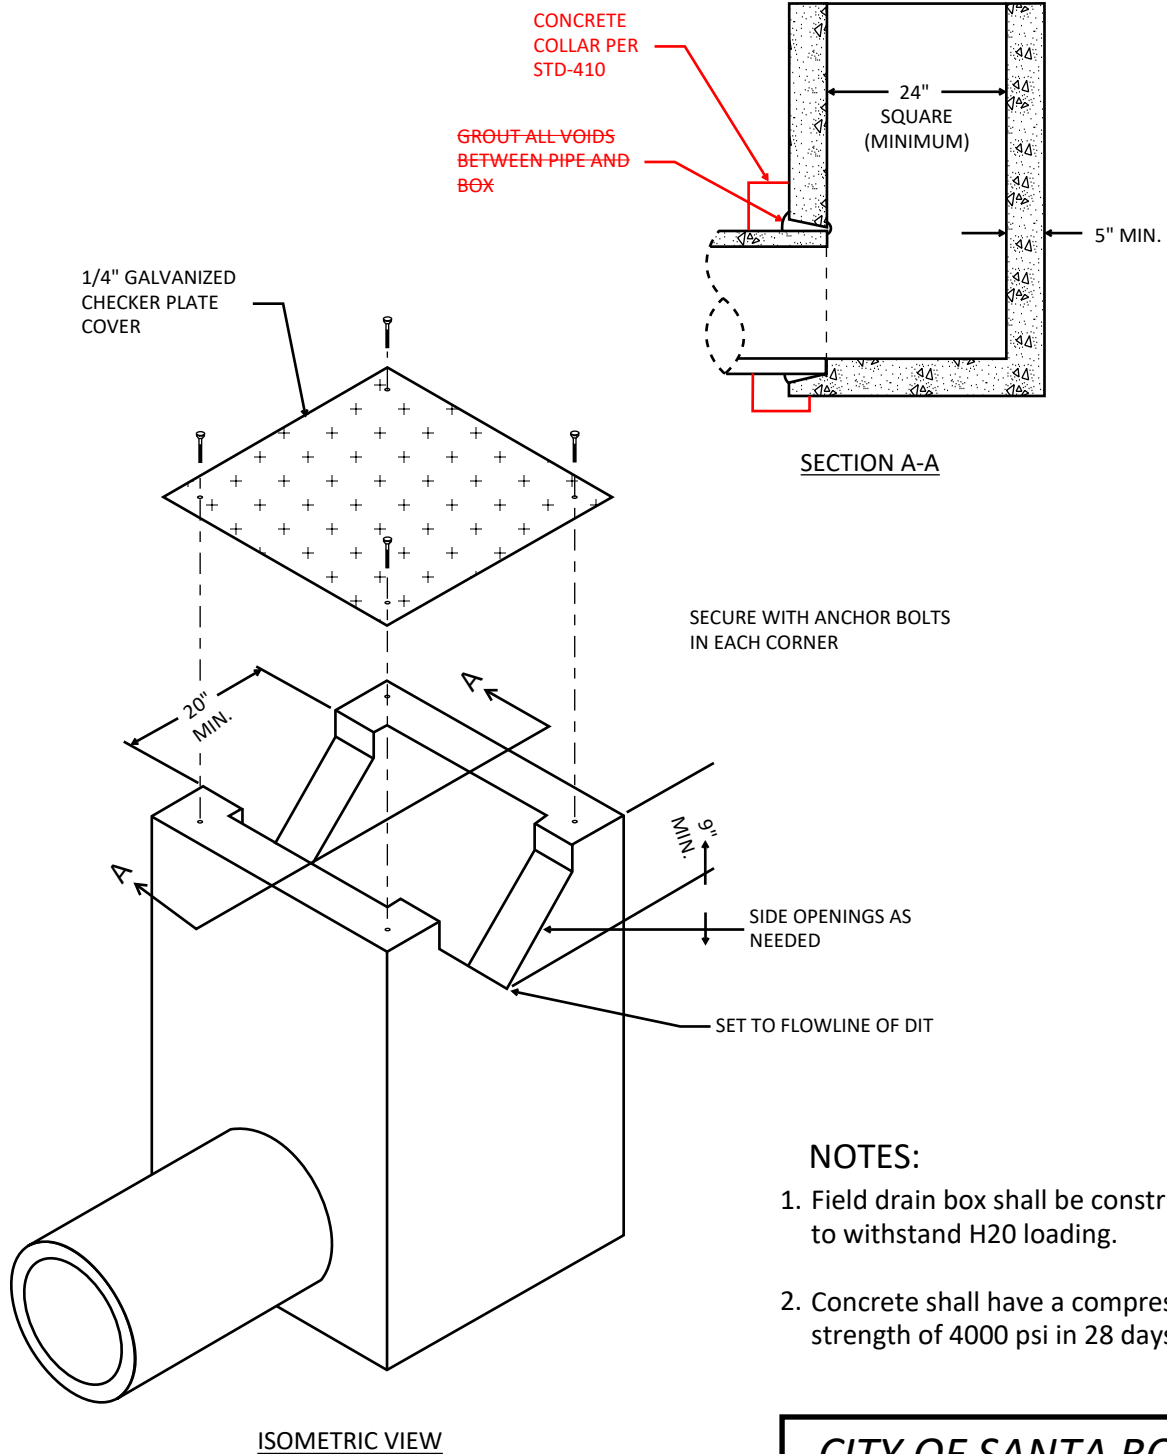

**PRECAST SIDE OPENING FIELD DRAIN**  
See Engineer's approved list

**CITY OF SANTA ROSA**

**PRECAST SIDE OPENING  
FIELD DRAIN**

**Scale: NONE**

**DRAFT MARCH 2025**

DWN: EDS


APPROVED:

FILE NO:

CHK:

STD - 408



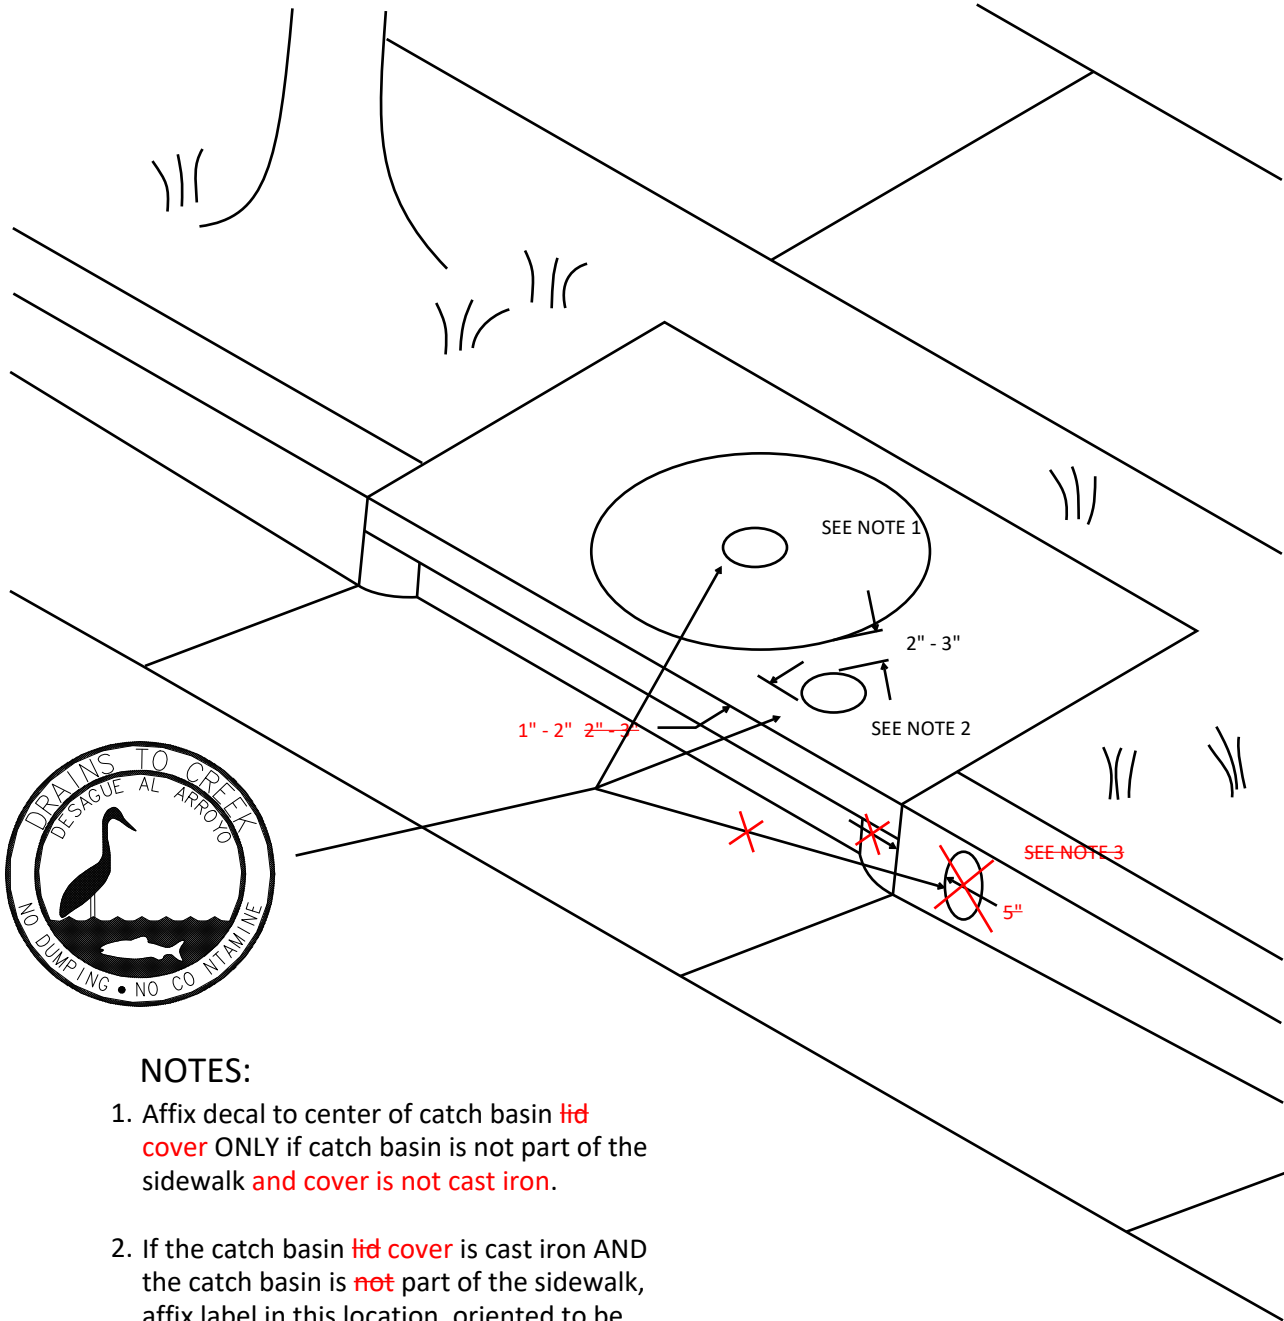

### NOTES:

1. Affix decal to center of catch basin **lid cover** ONLY if catch basin is not part of the sidewalk **and cover is not cast iron**.
2. If the catch basin **lid cover** is cast iron AND the catch basin is **not** part of the sidewalk, affix label in this location, oriented to be read from the street **aligned with the top of curb**.
3. Affix label on the curb face right of the catch basin if catch basin is part of the sidewalk. The left side may be used if the right side curb is damaged or painted.

APPROVED STORM DRAIN LABELS  
See Engineer's approved list

**CITY OF SANTA ROSA**

**STORM DRAIN LABELS**

Scale: NONE

**DRAFT MARCH 2025**



DWN: EDS

APPROVED:

FILE NO:

CHK:

STD - 409

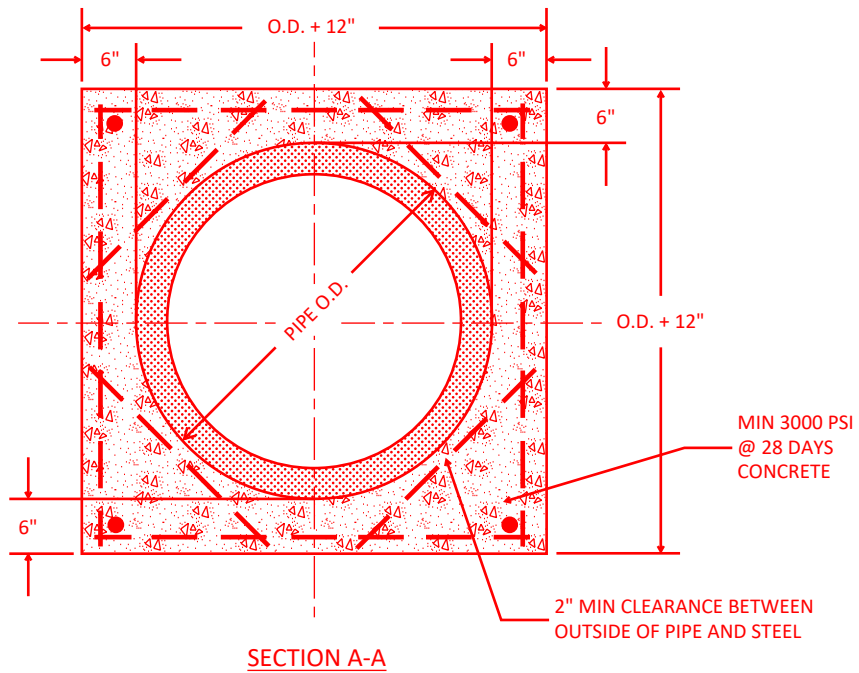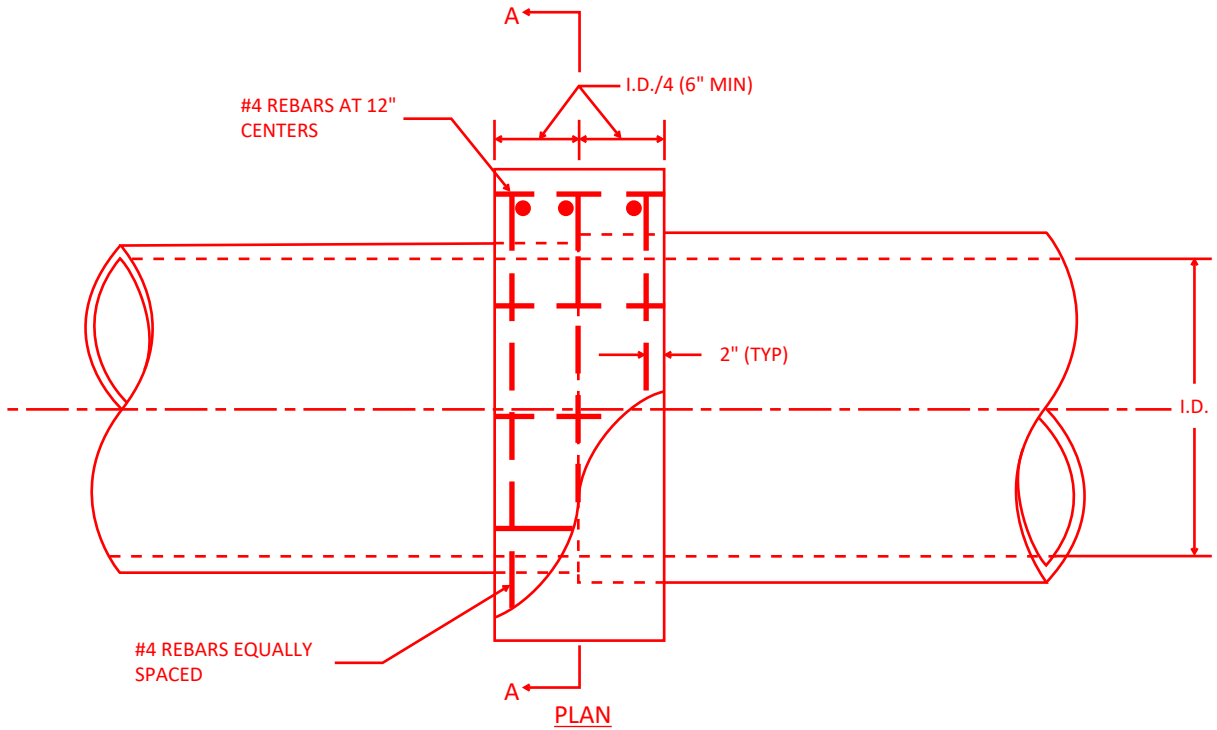

**CITY OF SANTA ROSA**

**REINFORCED CONCRETE  
PIPE COLLAR**

**Scale: NONE**

**DRAFT MARCH 2025**



**DWN: EDS**

**APPROVED:**

**FILE NO:**

**CHK:**

**STD - 410**

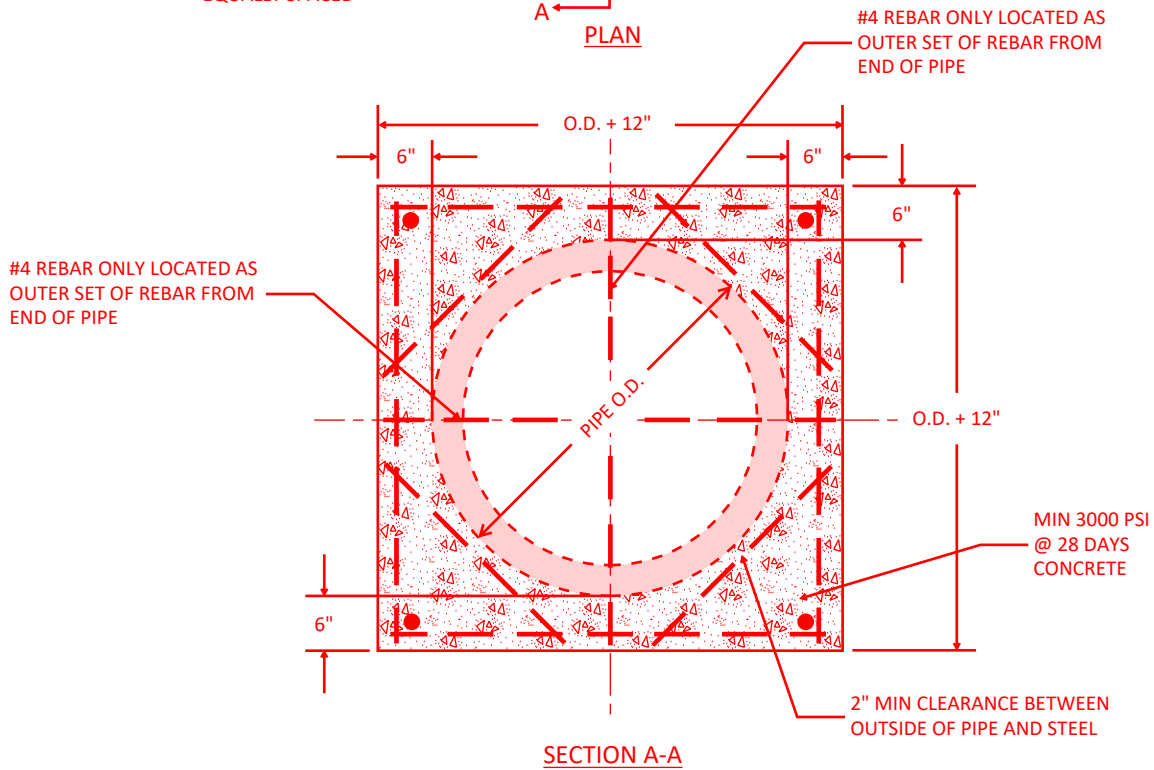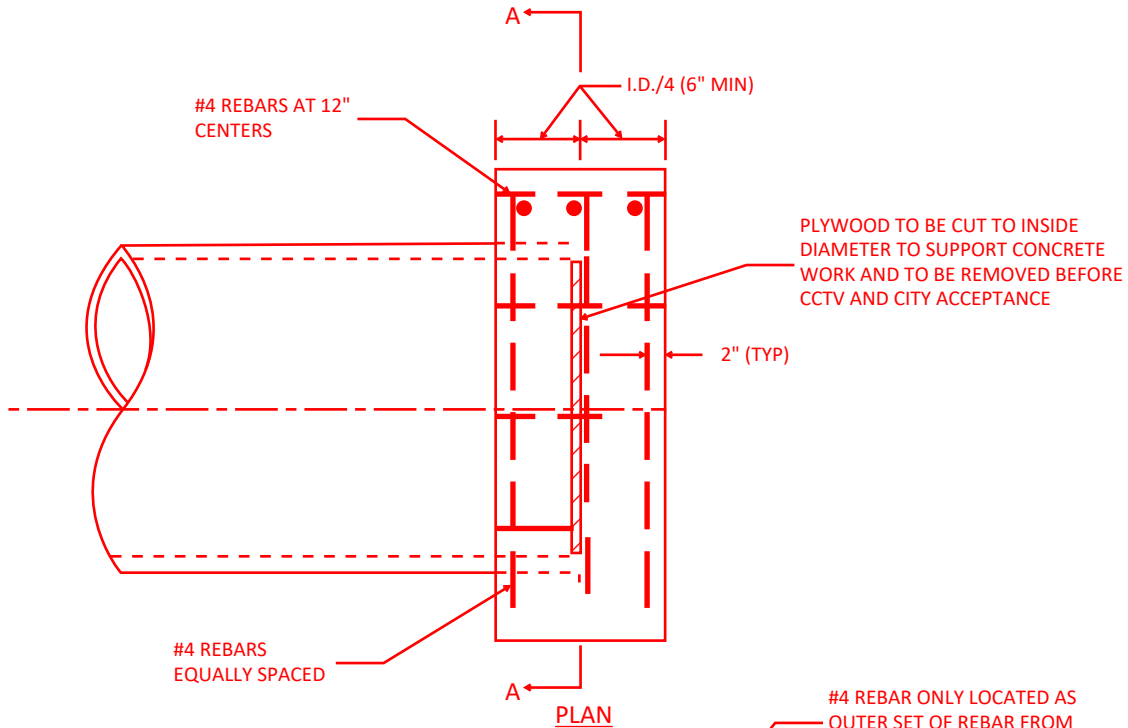

#### NOTES:

1. All reinforced concrete stub caps to be inspected by City during construction and before being covered.

**CITY OF SANTA ROSA**

**REINFORCED CONCRETE  
STUB CAP**

**Scale: NONE**

**DRAFT MARCH 2025**


**DWN: EDS**

**APPROVED:**

**FILE NO:**

**CHK:**

**STD - 411**

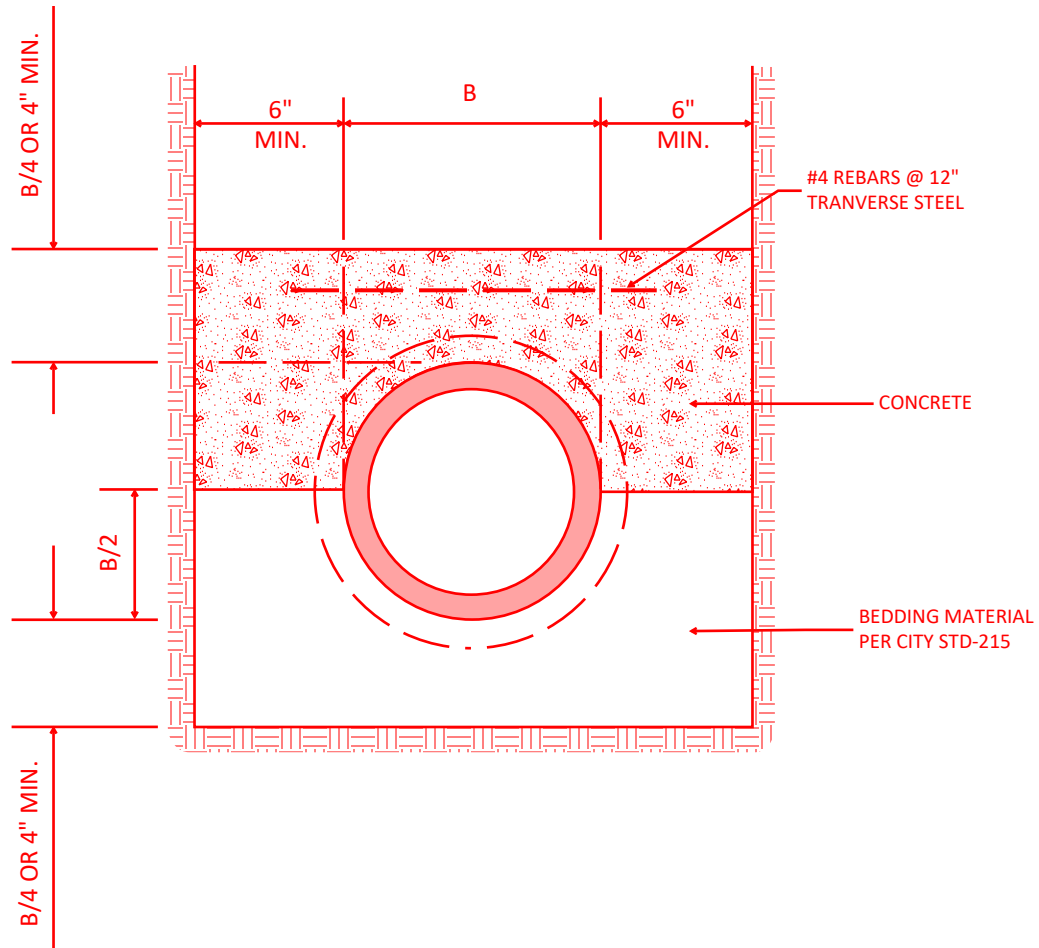

#### NOTES:

1. All concrete for concrete bedding cap shall be Class V concrete.
2. Concrete bedding cap required when a storm drain pipe encroaches in a roadway structural section or is less than three (3) feet below finish grade.
3. Use reinforcing steel when designated on the plans.
4. Unless otherwise specified, concrete bedding cap shall be paid for as part of the construction of pipe sewer or conduits.

**CITY OF SANTA ROSA**

**CONCRETE BEDDING CAP**

**Scale: NONE**

**DRAFT MARCH 2025**


**DWN: EDS**

**APPROVED:**


**FILE NO:**

**CHK:**

**STD - 412**

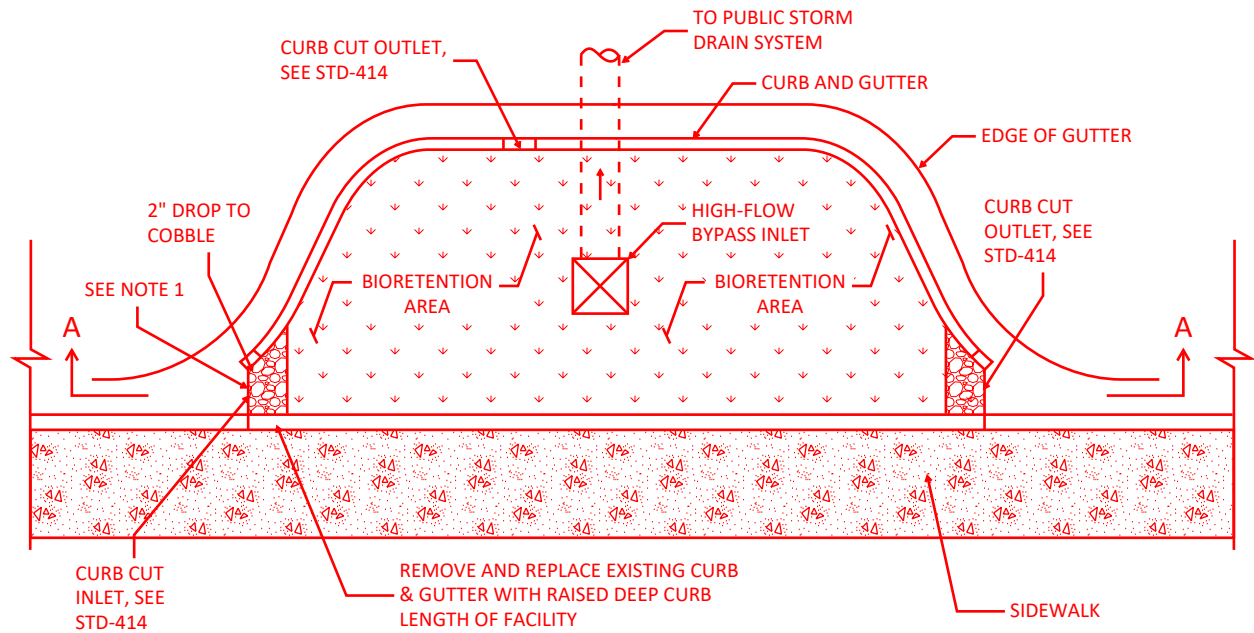

**PLAN VIEW**

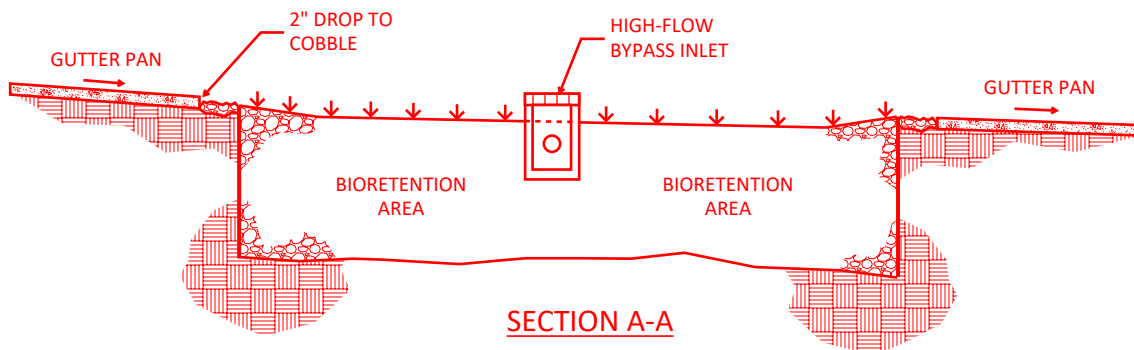

**SECTION A-A**

**NOTES:**

1. This standard detail assumes gradual longitudinal and cross slopes of the roadway. Steeper slopes in either direction will impact conveyance and elevation differences between the facility and adjacent roadway, curb, and sidewalk surfaces. Retrofit projects will face greater constraints than new construction. Site specific design is critical to avoid grade conflicts and maximizing ponding area. Grading plans that provide spot elevations across the entire facility and along adjacent surfaces are necessary.

**CITY OF SANTA ROSA**

**STREET BIORETENTION  
BULB-OUT, MID-BLOCK,  
CORNER CROSSING**

**Scale: NONE**

**DRAFT MARCH 2025**


**DWN: EDS**

**APPROVED:**

**FILE NO:**

**CHK:**

**STD - 413**

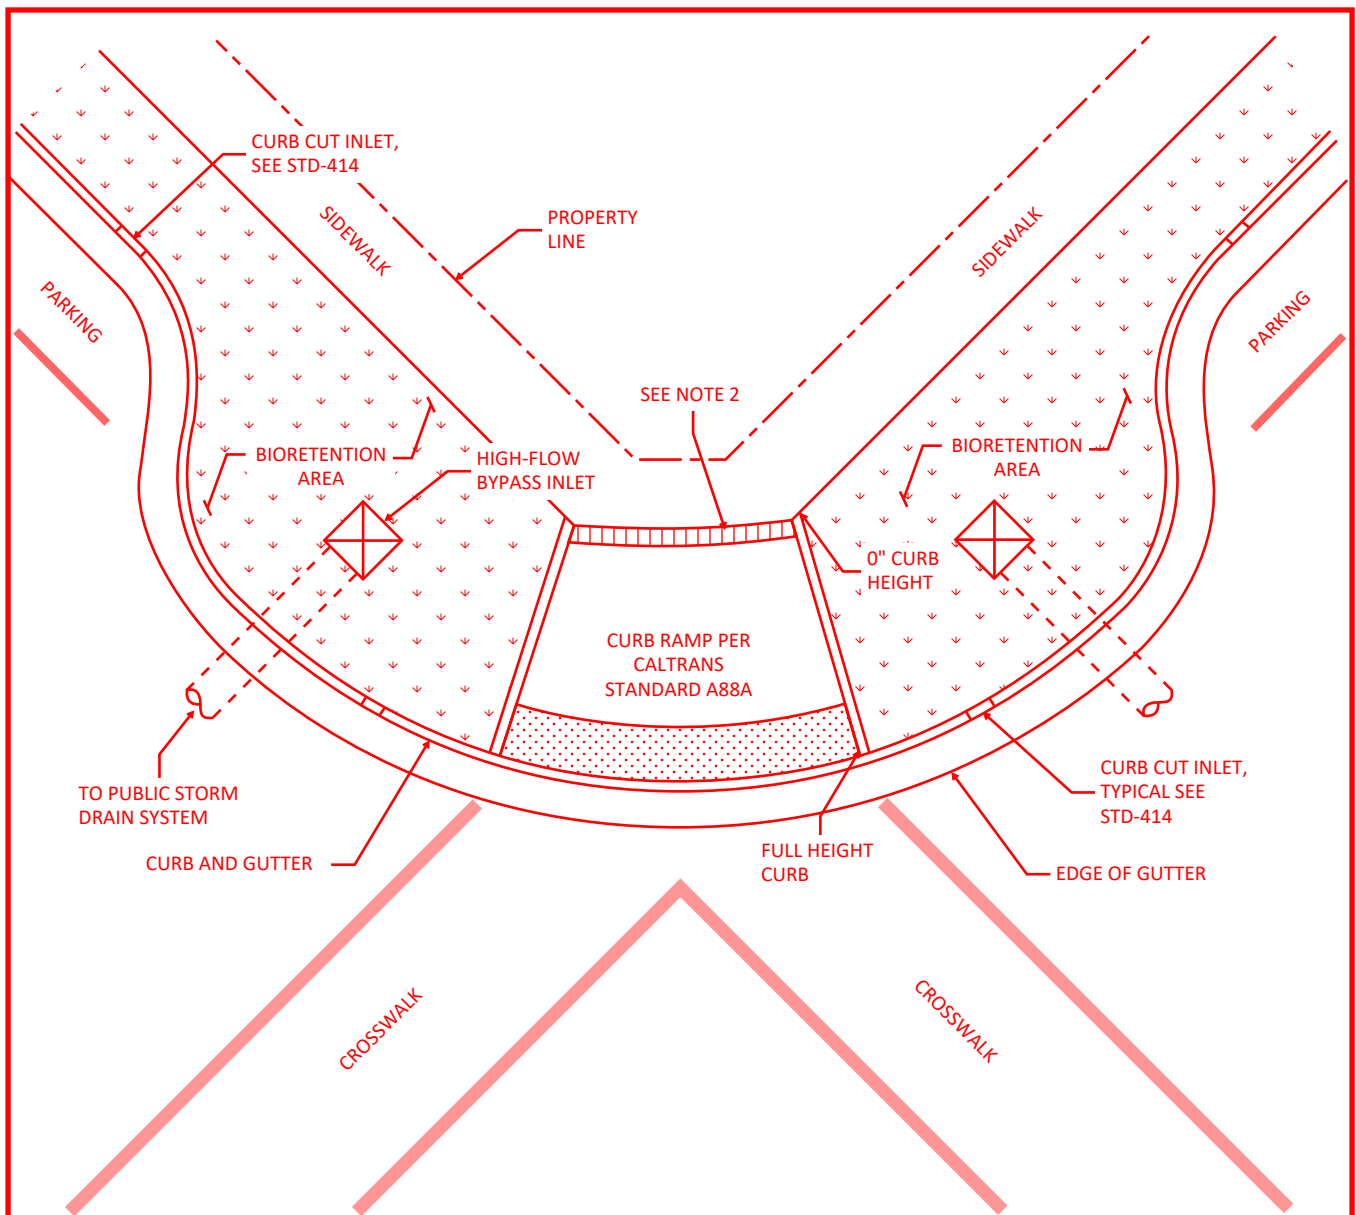

PLAN VIEW

**NOTES CONTINUED:**

2. For the treatment of sidewalk runoff, a trench grate may be installed at the edge of the sidewalk transition to the curb ramp, as needed. The trench grate shall be Americans with Disabilities Act (ADA) compliant and heel proof.
3. Curb cut inlets to be located as governed by the grading design so as to prevent flows being concentrated toward the ramp to gutter transition location.
4. The number of curb cut inlets needed shall be governed by the inlet capacity and flooded width calculations presented in the Drainage Report.

**CITY OF SANTA ROSA**

**STREET BIORETENTION  
BULB-OUT, MID-BLOCK,  
CORNER CROSSING**

**Scale: NONE**

**DRAFT MARCH 2025**


DWN: EDS

APPROVED:


FILE NO:

CHK:


STD - 413

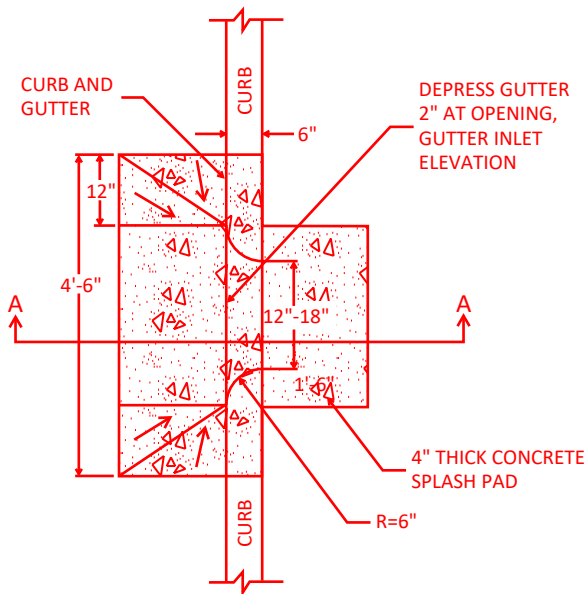

PLAN VIEW

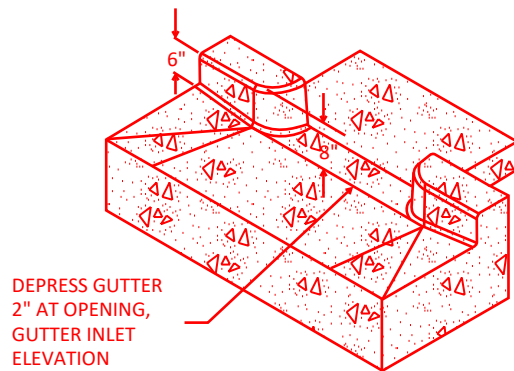

PERSPECTIVE VIEW

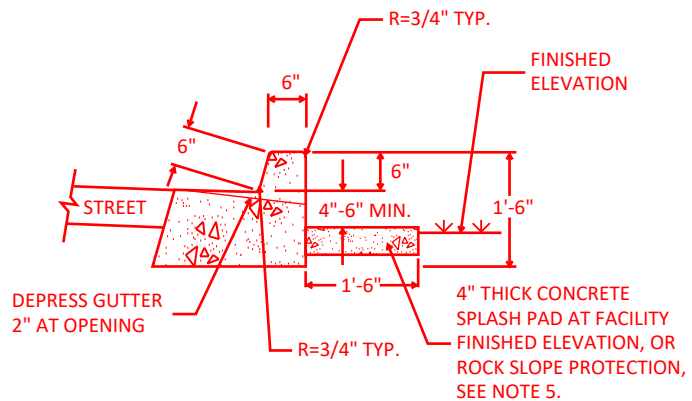

SECTION A-A

### NOTES:

1. For use with stormwater facilities with flat bottoms.
2. Provide spot elevations on plans for finished grade, gutter inlet, top of curb, lip of gutter, etc.
3. Curb and wall details may be modified by Civil and Geotechnical Engineer subject to approval by the City Engineer.
4. Curb height may be reduced to 4" where adjacent to a sidewalk.
5. If rock slope protection is used, calculations for the sizing based on flow velocities is required in the drainage report and Stormwater Low-impact Development Report, as applicable.

## CITY OF SANTA ROSA

### CURB CUT INLET/OUTLET FOR PLANTERS

Scale: NONE

DRAFT MARCH 2025


DWN: EDS

APPROVED:


FILE NO:

CHK:


STD - 414

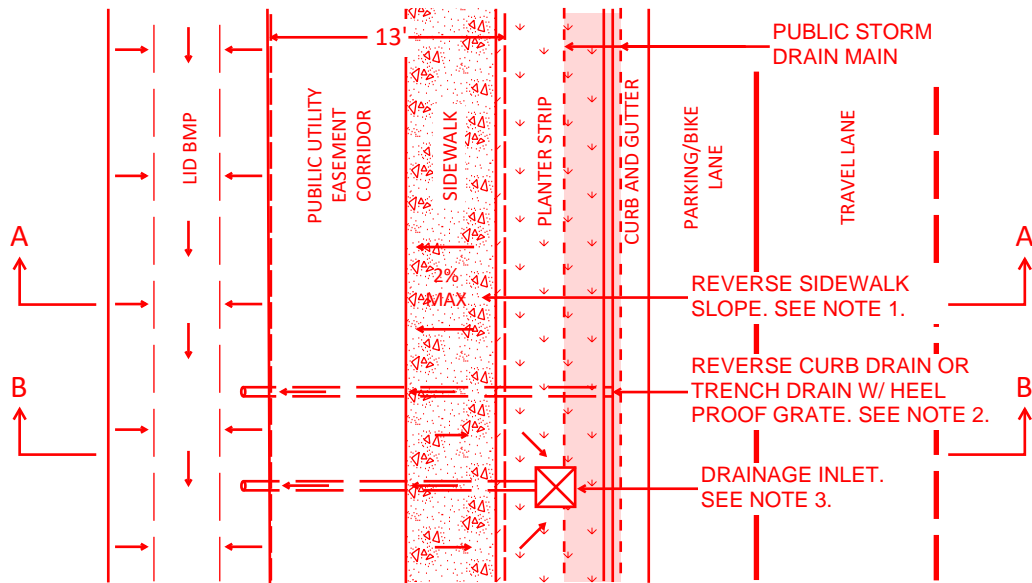

**PLAN VIEW**

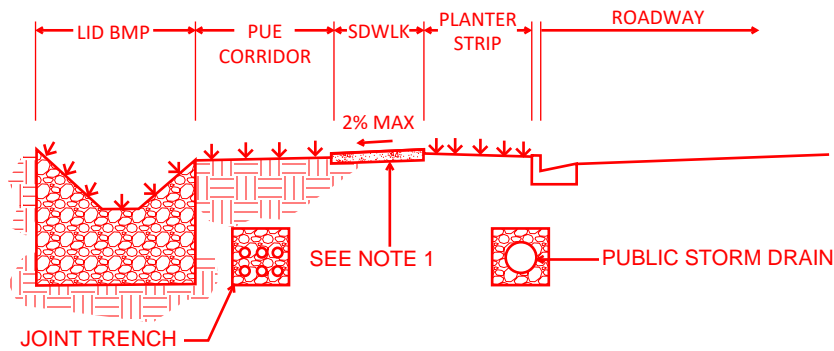

**SECTION A-A**

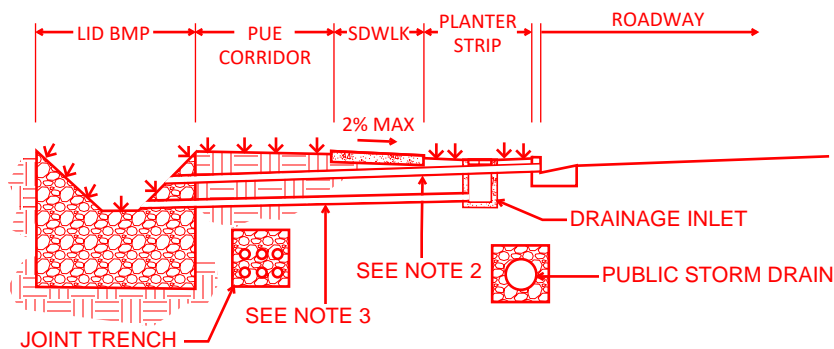

**SECTION B-B**

**CITY OF SANTA ROSA**

**STORM DRAIN UNDER  
CURB OR PLANTER**

**Scale: NONE**

**DRAFT MARCH 2025**

**DWN: EDS**

**APPROVED:**

**FILE NO:**

**CHK:**

**STD - 415**



## NOTES:

1. For the treatment of replaced or proposed sidewalk behind the planter strip or contiguous sidewalk, the sidewalk may be reversed and runoff graded to or conveyed to a LID BMP. This option does not treat the roadway.
2. Reverse curb drain per STD-406A/B or trench drain with a heel proof grate.
3. Sidewalk runoff captured within the planter strip then conveyed to the LID BMP via SCH. 40 PVC. Only sidewalk treatment is provided
4. No rebar or reinforcement shall be placed over public storm drain facilities.
5. No improvements within the sidewalk, planter strip, or right-of-way shall intrude within the pipe or pipe bedding.
6. No portion of any structure or LID BMP shall extend within, over, under, or upon any public utility easement unless otherwise approved by the City Engineer.
7. Utility services and laterals may run through a public utility easement perpendicularly, but private utilities may not run longitudinally within the PUE.
8. A curb cut may be added to treat the roadway.
9. Prior to utility crossings and connections over or under the existing public storm drain, the contractor shall pothole and ensure no conflicts occur with the existing storm drain facilities.
10. The contractor shall be responsible for repairing, damage, or deterioration occurring to the existing public storm drain as a direct result of construction activity related to the installation of the improvements.

**CITY OF SANTA ROSA**

**STORM DRAIN UNDER  
CURB OR PLANTER**

**Scale: NONE**

**DRAFT MARCH 2025**

**DWN: EDS**

**APPROVED:**

**FILE NO:**

**CHK:**

**STD - 415**