
TECHNICAL MEMORANDUM

TO: Colin Close
PREPARED BY: Jennifer Kidson, Martha de Maria y Campos
REVIEWED BY: Xavier Irias, Christy Kennedy, Katie Cole
DATE: July 13, 2023
RE: Santa Rosa Water Supply Alternatives Plan Feasibility Analysis Findings, Task 7

TABLE OF CONTENTS

Executive Summary.....	ES-1
1. Purpose and Background.....	1
2. Study Parameters and Methods.....	1
2.1 Collaborative Development of Study Parameters	1
2.2 Water Supply Goal	2
2.3 Water Supply Options.....	3
2.4 Evaluation Criteria and Metrics	4
2.5 Screening Analysis.....	6
2.5.1 Screening Tool.....	7
2.5.2 Capital Cost Estimate Methodology	9
2.5.3 Feasibility Scoring Methodology.....	10
3. Findings.....	12
3.1 Water Supply Option Descriptions	12
3.1.1 Groundwater Supply Options.....	13
3.1.2 Purified Recycled Water Supply Options	26
3.1.3 Non-Potable Recycled Water Option.....	48
3.1.4 Desalinated Water Supply Options	49
3.1.5 Stormwater Capture Options.....	56
3.1.6 Efficiency Programs	61
3.2 Screening Analysis Results	62
3.3 Feasibility Analysis Results	64
3.3.1 Groundwater Options.....	66

3.3.2	Purified Recycled Water Options	70
3.3.3	Stormwater Capture	72
3.3.4	Efficiency Programs	73
3.3.5	Cost Sensitivity Analysis.....	74
4.	Conclusions	75
5.	References.....	77

LIST OF FIGURES

Figure ES-1-1: Cost-Effectiveness vs Max Yield (with Weighted Score)	ES-6
Figure 2-1: Screening and Feasibility Analysis Process	7
Figure 3-1: Existing City Wells	14
Figure 3-2: Supply Option GW-1.....	18
Figure 3-3: Supply Option GW-3.....	23
Figure 3-4: Regional System Facilities.....	28
Figure 3-5: Average Recycled Water Use (2019-2022).....	29
Figure 3-6: Forms of Potable Reuse in California	30
Figure 3-7: Supply Option PR-1.....	33
Figure 3-8: Supply Option PR-2.....	36
Figure 3-9: Supply Option PR-3a	39
Figure 3-10: Supply Option PR-3c.....	43
Figure 3-11: Supply Option PR-4	46
Figure 3-12: Supply Option DE-1	52
Figure 3-13: Supply Option DE-2.....	54
Figure 3-14: Supply Option SW-1	57
Figure 3-15: Cost-Effectiveness vs Max Yield (with Weighted Score)	66
Figure 3-16: Supply Option Cost Performance with Varying Hydrology (\$/AF).....	74
Figure 3-17: Supply Option Cost Performance with Varying Sonoma Water Cutbacks (\$M/yr)	75

LIST OF TABLES

Table ES-1: Water Supply Options..... ES-2

Table ES-2: Screening Analysis Results Summary ES-3

Table ES-3: Summary of Supply Option Scores..... ES-5

Table 2-1: Stakeholder and Community Outreach Meeting Summary..... 2

Table 2-2: Water Supply Options..... 4

Table 2-3: Evaluation Criteria, Metrics, and Weights..... 5

Table 2-4: Baseline Screening Analysis Parameters and Assumptions 8

Table 2-5: Evaluation Criteria Scoring Rubric..... 11

Table 3-1: Summary of Water Supply Options..... 12

Table 3-2: Preliminary Capital Cost, Supply Option GW-1 16

Table 3-3: Preliminary Annual O&M Cost, Supply Option GW-1..... 17

Table 3-4: Preliminary Capital Cost, Supply Option GW-2 20

Table 3-5: Preliminary Annual O&M Cost, Supply Option GW-2..... 20

Table 3-6: Preliminary Capital Cost, Supply Option GW-3 24

Table 3-7: Preliminary Annual O&M Cost, Supply Option GW-3..... 25

Table 3-8: Preliminary AWPf Flow Summaries 32

Table 3-9: Preliminary Capital Cost, Supply Option PR-1..... 34

Table 3-10: Preliminary Annual O&M Cost, Supply Option PR-1 35

Table 3-11: Preliminary Capital Cost, Supply Option PR-2 37

Table 3-12: Preliminary Annual O&M Cost, Supply Option PR-2 38

Table 3-13: Preliminary Capital Cost, Supply Option PR-3a..... 40

Table 3-14: Preliminary Annual O&M Cost, Supply Option PR-3a..... 41

Table 3-15: Preliminary Capital Cost, Supply Option PR-3c..... 44

Table 3-16: Preliminary Annual O&M Cost, Supply Option PR-3c..... 45

Table 3-17: Preliminary Capital Cost, Supply Option PR-4 47

Table 3-18: Preliminary Annual O&M Cost, Supply Option PR-4 48

Table 3-19: Preliminary Capital Cost, Supply Option DE-1 50

Table 3-20: Preliminary Annual O&M Cost, Supply Option DE-1 51

Table 3-21: Preliminary Capital Cost, Supply Option DE-2..... 55

Table 3-22: Preliminary Annual O&M Cost, Supply Option DE-2 56

Table 3-23: Preliminary Capital Cost, Supply Option SW-1..... 58

Table 3-24: Preliminary Annual O&M Cost, Supply Option SW-1..... 59

Table 3-25: Screening Analysis Results Summary 63

Table 3-26: Summary of Supply Option Scores 65

Table 3-27: Detailed Scoring for Option GW-1 67

Table 3-28: Detailed Scoring for Option GW-2..... 68

Table 3-29: Detailed Scoring for Option GW-3..... 69

Table 3-30: Detailed Scoring for Option PR-2..... 70

Table 3-31: Detailed Scoring for Option PR-4..... 71

Table 3-32: Detailed Scoring for Option SW-1..... 72

Table 3-33: Detailed Scoring for Option E-1 73

Table 3-34: Distribution of Water Year Types in Hydrologic Scenarios..... 74

ACRONYMS AND ABBREVIATIONS

AACEI	Association for the Advancement of Cost Engineering International
AF	acre-foot
AFY	acre-feet per year
AOP	advanced oxidation process
ASR	Aquifer Storage and Recovery
AWPF	Advanced Water Purification Facility
BAF	biological activated filtration
BPU	Board of Public Utilities
City	City of Santa Rosa
CII	Commercial, industrial, institutional
DPR	direct potable reuse
FAT	full advanced treatment
gpf	gallons per flush
gpm	gallons per minute
GSP	Groundwater Sustainability Plan
GWR	groundwater recharge
IPR	Indirect Potable Reuse
LTP	Laguna Treatment Plant
MF	microfiltration
MGD	million gallons per day
O&M	Operations and Maintenance
Regional System	Santa Rosa Regional Water Reuse System
RO	reverse osmosis
RWA	raw water augmentation
SFR	Single family residential
SWA	surface water augmentation
TM	Technical Memorandum
TWA	treated water augmentation
UF	Ultra filtration
UWMP	Urban Water Management Plan
WSAP	Water Supply Alternatives Plan

APPENDICES

Appendix A: Cost Details

Appendix B: Screening Tool Detail (Baseline Scenario)

EXECUTIVE SUMMARY

Purpose and Background

The City of Santa Rosa (City) is in the process of preparing a Water Supply Alternatives Plan (WSAP). Ultimately, the WSAP will provide a menu of water supply options and portfolios for the City to consider when planning future strategic investments and projects. The planning process for the WSAP includes engaging a broad base of stakeholders in establishing water supply goals, identifying potential conceptual-level water supply options, establishing evaluation criteria for these options, and conducting a feasibility analysis of the supply options. Participants include the Water Team (Deputy Directors and key staff), an external Stakeholder Group (leaders from a range of community organizations, resource agencies, environmental groups, and social service providers), the community at large through webinars and public meetings, and the Board of Public Utilities (BPU). This Technical Memorandum (TM) summarizes the results of the feasibility analysis.

Study Methods

The WSAP effort began by establishing water supply goals, supply options, and evaluation criteria, collectively referred to as the “study parameters.” City staff and other stakeholders participated directly in this process during late 2022 based on their input, and the study parameters were finalized in early 2023. In brief, the study parameters include:

- **Water Supply Goal:** Diversify and increase city potable water supplies to reduce dependence on Sonoma Water, particularly during Russian River supply shortages during droughts or due to emergency disruption in delivery. Targets established in conjunction with the stakeholders were:
 - Minimize impact of shortages due to droughts – be able to provide 30 percent of annual water demand with City supplies to mitigate droughts (about 7,500 acre-feet per year (AFY) capacity in 2045)
 - Minimize impacts of disruption in Sonoma Water service – be able to provide 50 percent of normal indoor demand with City supplies for catastrophic events (about 9 million gallons per day (MGD) in 2045)
 - Minimize impacts of peak demand – be able to provide 30 percent of peak month, average day demand from City supplies from late spring through early fall (about 9 MGD in 2045)
- **Water Supply Options:** **Table ES-1**, below, summarizes the 18 water supply options that were considered.
- The following evaluation criteria were selected and assigned relative weights:
 - Cost-effectiveness and scalability (high weight). These two criteria were also used as screening criteria to determine which water supply options merited full feasibility analysis. This screening step was implemented as part of the study parameters in order to focus the feasibility analysis on the most promising water supply options.
 - Resiliency, equity, and environmental performance (high weight).
 - Legal, permitting, and regulatory; City control and interagency coordination; and multi-benefit (medium weight).

Table ES-1: Water Supply Options

Supply Type	Supply Option Name
Groundwater	GW-1: Construct Additional Groundwater Extraction Wells GW-2: Convert Emergency Wells to Production Wells GW-3: Construct Aquifer Storage and Recovery (ASR) Wells GW-4: Construct Regional Groundwater Extraction Wells GW-5: Construct Regional ASR Wells
Purified Recycled Water	PR-1: Direct Potable Reuse (DPR) with Advanced Water Purification Facility (AWPF) at Laguna Treatment Plant (LTP) PR-2: Satellite DPR with AWPF PR-3a: Indirect Potable Reuse (IPR) with AWPF LTP into Groundwater Basin PR-3b: IPR with AWPF LTP into Lake Ralphine PR-3c: IPR with AWPF at LTP into Lake Sonoma PR-4: Regional DPR with AWPF at LTP
Recycled Water	RW-1: Expand City’s Non-Potable Recycled Water System
Desalination	DE-1: Regional Brackish Desalination DE-2: Ocean Desalination
Stormwater	SW-1: Stormwater Treatment and Storage in Aquifer SW-2: Stormwater Storage in Lake Ralphine with Treatment SW-3: Regional Stormwater
Efficiency Programs	E-1: Efficiency Programs

Acronyms:

AWPF – Advanced Water Purification Facility
ASR – Aquifer Storage and Recovery
DPR – Direct Potable Reuse

IPR – Indirect Potable Reuse
LTP – Laguna Treatment Plant

Screening Analysis

Following identification of the study parameters, a pre-screening analysis was conducted to narrow the list of 18 water supply options for screening. Five options were set aside, and 13 options were advanced to the screening step. Each of the water supply options was developed at a conceptual level to estimate potential water supply yield and costs. Cost estimates in this document are considered Class 5 per Association for the Advancement of Cost Engineering International (ACEI) guidelines, i.e., conceptual. Actual project costs would be expected to fall within +50 percent to -15 percent of the cost estimate.

Based on the yield and costs, cost-effectiveness of each water supply option was evaluated under two general scenarios:

- Maximum production: This scenario assumed that each water supply option would be operated to maximize water supply and meet as much of the water supply goal as possible, regardless of whether shortages would be present requiring additional supply.
- “Baseline” scenario: This scenario assumed that each water supply option would be operated in a way that minimized operational costs. This is a more realistic scenario than the “maximum production” scenario.

The results of the screening analysis are summarized in **Table ES-2** below.

Table ES-2: Screening Analysis Results Summary

Option	Maximum Yield		Baseline Usage		Carried forward for full Feasibility Analysis?
	Acre-Foot/Year	\$/Acre-Foot	Avg Acre-Foot/Year	\$/Acre-Foot*	
GW-1: Construct Additional Groundwater Extraction Wells	10,080	\$700	6,734	\$840	Yes
GW-2: Convert Emergency Wells to Production Wells	2,462	\$500	1,744	\$540	Yes
GW-3: Construct Aquifer Storage and Recovery (ASR) Wells	5,130	\$900	3,634	\$1,100	Yes
PR-1: Direct Potable Reuse (DPR) with Advanced Water Purification Facility (AWPF) at Laguna Treatment Plant (LTP)	10,065	\$2,000	4,131	\$3,600	No
PR-2: Satellite DPR with AWPF	10,065	\$2,100	4,131	\$3,900	Yes
PR-3a: IPR with AWPF at LTP into Groundwater Basin	10,065	\$2,500	4,131	\$4,800	No
PR-3c: IPR with AWPF at LTP into Lake Sonoma	10,065	\$3,700	4,131	\$6,400	No
PR-4: Regional DPR with AWPF at LTP	10,065	\$1,800	4,131	\$3,200	Yes
RW-1: Expand City's Non-Potable Recycled Water System	3,000	\$2,900	900	\$9,800	No
DE-1: Regional Brackish Desalination	10,080	\$1,100	4,441	\$2,000	No
DE-2: Ocean Desalination	10,080	\$2,600	4,441	\$4,500	No
SW-1: Stormwater Storage in Aquifer	10,080	\$1,400	2,618	\$3,500	Yes
E-1: Efficiency Programs	2,145	\$2,800	2,145	\$2,800	Yes

Notes:

The following options are not shown in the table as they were eliminated from further consideration prior to completing the detailed cost/yield analysis: GW-4, GW-5, PR-3b, SW-2 and SW-3. All of the water supply options considered in this study are described in more detail in Section 3.1.

* Costs include capital and operating costs consistent with a realistic baseline usage scenario.

Acronyms:

- AWPF - Advanced Water Purification Facility
- ASR – Aquifer Storage and Recovery
- DPR – Direct Potable Reuse
- IPR – Indirect Potable Reuse
- LTP – Laguna Treatment Plant

Feasibility Analysis

The water supply options that passed the screening analysis were then scored based on the evaluation criteria established with input from stakeholders, the BPU, the community, and City staff. A numeric score was assigned for each criterion using a 3-point scale from 0 to 2, with 2 being the most favorable. A score of zero implies that an option is not responsive to a criterion or performs relatively poorly compared to the other options, while a score of 2 implies that the option performs very well.

The raw scores were then weighted consistent with the relative importance of each criterion described earlier, e.g., cost and scalability were assigned very high weight, permitting ease medium weight, etc. The specific weights are as follows:

- Cost-effectiveness and scalability: 5x multiplier
- Resiliency, equity, and environmental performance: 3x multiplier
- Legal, permitting, and regulatory; City control and interagency coordination; and multi-benefit: 1x multiplier

Table ES-3, below, table summarizes the results of the feasibility scoring:


Table ES-3: Summary of Supply Option Scores

Criterion	Groundwater			Purified Recycled Water		Stormwater	E-1: Efficiency Programs
	GW-1: Add Extraction Wells	GW-2: Convert Emergency Wells	GW-3: City ASR Wells	PR-2: Satellite DPR	PR-4: Regional DPR	SW-1: Stormwater Storage in Aquifer	
Cost effectiveness* [\$/AF]	2 [\$840/AF]	2 [\$540/AF]	2 [\$1,100/AF]	0 [\$3,900/AF]	0 [\$3,200/AF]	0 [\$3,500/AF]	1 [\$2,800/AF]
Scalability [Yield in AFY]	2 [5,880 - 10,080 AFY]	0 [1,436 - 2,462 AFY]	1 [2,993 - 5,130 AFY]	2 [3,019 - 10,065 AFY]	2 [3,019 - 10,065 AFY]	1 [1,008 - 10,080 AFY]	1 [2,145 AFY]
Resiliency	1	1	2	2	2	1	1
Equity	2	2	2	1	0	1	0
Environmental performance	1	2	1	0	1	1	2
Legal, permitting, and regulatory	1	2	0	0	0	1	2
City control and interagency coordination	2	2	1	2	0	2	2
Multi-benefit	0	0	1	0	0	2	1
<i>Total Unweighted</i>	<i>11</i>	<i>11</i>	<i>10</i>	<i>7</i>	<i>5</i>	<i>9</i>	<i>10</i>
Total Weighted	35	29	32	21	19	19	24

* Costs include capital and operating costs consistent with a realistic baseline usage scenario.

As shown in **Figure ES-1-1**, most supply options did not score substantially differently from one another.

Figure ES-1-1: Cost-Effectiveness vs Max Yield (with Weighted Score)

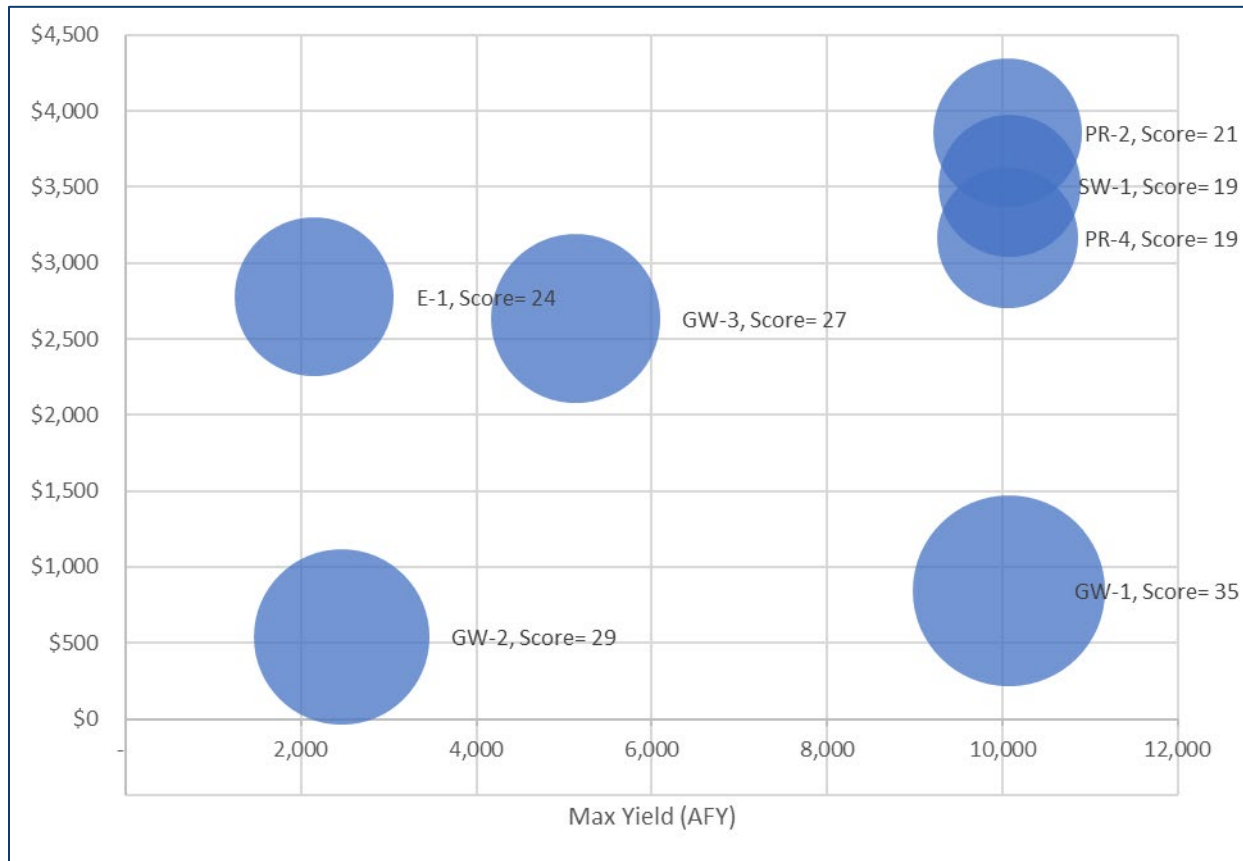

Notes: Water Supply options:

- E-1: Efficiency Programs
- GW-1: Construct Additional Groundwater Extraction Wells
- GW-2: Convert Emergency Wells to Production Wells
- GW-3: Construct Aquifer Storage and Recovery (ASR) Wells
- PR-2: Satellite Direct Potable Reuse (DPR) with Advanced Water Purification Facility (AWPF)
- PR-4: Regional DPR with AWPF at Laguna Treatment Plant
- SW-1: Stormwater Storage in Aquifer

The feasibility analysis also assessed supply option performance under a range of future conditions beyond the baseline scenario. Performance of the options was examined under varying future hydrologic conditions, and varying Sonoma Water dry-year allocations were evaluated. In general, as future conditions become less favorable, a supplemental water supply is used more and becomes more cost-effective.

Conclusions

This Feasibility Analysis reveals several key considerations for the City as it conducts future water supply planning:

- **Future conditions:** Depending on the City’s assumptions about future hydrology, Sonoma Water cutbacks, cost of Sonoma Water supplies, and customer demand/conservation, the City may reach different conclusions about the potential best fit water supplies. For example, if the City assumes a less conservative scenario (e.g., business as usual), the amount of new water needed may be relatively modest, in which case the City would be well served by bridging that gap with a small number of new wells, which could be added one by one as the need arises. On the other hand, if the City assumes a more conservative scenario in which existing water supplies decrease, a broader range of options could be considered, including options such as potable reuse that would be run continuously once implemented. Options that could be implemented in phases (e.g., rehabilitating one well at a time, rather than 3 at once) may help provide resiliency while minimizing capital outlay.
- **Operational assumptions:** Similar to future conditions, the City would need to consider its operational philosophy for a new supply source. If the City elects to operate a new supply on a 24/7 basis, this would reduce the cost per AF of water but could also increase total operational costs.
- **Sensitivity:** This analysis considered the impact of changing hydrology and reduced Sonoma Water dry-year allocations. The supply options generally become more cost-effective under more pessimistic scenarios (drier hydrology and higher Sonoma Water cutbacks) because more water is produced via the new options. However, the analysis indicates that the relative rankings of the supply options do not vary substantially with changes to the baseline condition.

The next step of the WSAP project will be to propose portfolio options (mixes of water supply options to achieve the goals) based on the findings in this TM. This will involve developing portfolio alternatives and analyzing them to further assess the water supply options that passed the screening analysis. The portfolio analysis may consider downscaled versions of some supply options and will consider potential groupings of supply options that would allow the City to optimize different areas such as resiliency, supply volume, cost, and consistency with the multiple goals.

1. PURPOSE AND BACKGROUND

On August 10, 2022, the City of Santa Rosa (City) contracted with Woodard & Curran to prepare the City's Water Supply Alternatives Plan (WSAP). Ultimately, the WSAP will provide a menu of water supply options and portfolios for the City to consider when planning future strategic investments and projects for increasing water supply resiliency and reliability.

The planning process for the WSAP includes establishing water supply goals, identifying potential conceptual-level water supply options, establishing evaluation criteria for these options, and conducting a feasibility analysis of the supply options. This Technical Memorandum (TM) summarizes the results of the feasibility analysis and supporting work.

To increase the City's water supply resiliency and reliability during a drought year or interruption of the Russian River supply, supplemental water is needed. Water conservation and recycled water alone or combined would not generate sufficient water to meet normal water needs through 2045 during a reasonable, worst-case drought event. This TM explores a number of supply options including expansion of existing groundwater supplies, groundwater banking/exchange projects, construction of new purified recycled water projects, construction of a new ocean desalination plant, participation in the development of a regional desalination plant, and stormwater capture along with additional efficiency programs. These options include both local and collaborative regional efforts that would require the City to partner with one or more local water agencies. Each supplemental supply component would provide different amounts of water. When combined with one another in various portfolios (mixes of water supplies) and various levels of water conservation and existing water supplies, new water supplies would help to meet projected normal water needs throughout the planning period.

2. STUDY PARAMETERS AND METHODS

The WSAP effort began by establishing water supply goals, supply options, and evaluation criteria, collectively referred to as the "study parameters." The following subsections describe the development of the study parameters and list the final parameters which acted as the foundation for the feasibility study.

2.1 Collaborative Development of Study Parameters

The study parameters were established through a collaborative process with four groups of participants: the City, stakeholders, the community, and BPU.

Table 2-1 summarizes the series of meetings held with four distinct groups to gather input on the study parameters. The first group, referred to as the Water Team, was composed of City staff from multiple divisions (e.g., water resources planning, wastewater treatment and water recycling, stormwater and environmental compliance, water efficiency, and water and sewer operations). The second group, referred to as the Stakeholder Group, included leaders of local interest organizations (e.g., environmental groups, community associations, social justice organizations, local business groups, agricultural interests, and resource agencies). The third group is referred to as "the community". Community meetings were open to all and held virtually. Community meetings were advertised via social media, email, bill inserts, and postings on the City website. Lastly, the study parameters were reviewed by the City's BPU, which provides oversight of and direction for the management and operation of the City's water and wastewater facilities.

The project team incorporated feedback from the Water Team, Stakeholder Group, the community, and the BPU into the study parameters, resulting in the final water supply goal, water supply options, and evaluation criteria and methodology. These study parameters guided the feasibility analysis.

Table 2-1: Stakeholder and Community Outreach Meeting Summary

Meeting	Date	Topics
Water Team Meeting #1	October 17, 2022	Project overview; introduction of study parameters (water supply goals, water supply options, evaluation criteria, and methodology); input on study parameters.
Community Meeting #1	October 26, 2022	Overview of Santa Rosa water supplies; project background and overview; introduction of water supply goals, supply options, and evaluation criteria; polling questions, input on study parameters, and question and answer time.
Stakeholder Group Meeting #1	November 16, 2022	Overview of Santa Rosa water supplies; project background and overview; high-level group discussion of study parameters, and input on study parameters.
Stakeholder Group Meeting #2	December 14, 2022	Project update; group discussion of proposed study parameters, and input on the refined study parameters.
Water Team Meeting #2	December 15, 2022	Proposed study parameters; input on final refinements of study parameters, and input on the refined study parameters.
Board of Public Utilities Meeting #1	January 19, 2023	BPU direction on proposed study parameters.
Community Meeting #2	January 25, 2023	Project update; review of proposed study parameters; question and answer time.
Water Team Meeting #3	May 17, 2023	Project update on options development and refinement, screening analysis; input on draft study results and portfolio approach.
Stakeholder Group Meeting #3	May 24, 2023	Project update on options development and screening analysis; input on draft study results and portfolio approach.

2.2 Water Supply Goal

The City’s water supply goal for the WSAP effort is as follows:

Diversify and increase city potable water supplies to reduce dependence on Sonoma Water, particularly during Sonoma Water supply shortages or disruption in delivery:

- **Mitigating Droughts:** Meet 30 percent of city’s water demand with city supplies to mitigate impacts of Russian River supply shortages (e.g., due to prolonged and/or severe drought). This goal assumes strict limits on, or banning of, landscape irrigation in severe droughts.
- **Mitigating Natural Disasters and Catastrophic Events:** Provide half of normal domestic/indoor demand for potable water with city supplies during Russian River supply

disruption. Critical facilities would be prioritized for health and safety. Landscape irrigation would be prohibited.

- **Mitigating Peak Day Demand:** Meet 30 percent of peak month average day demand for potable water with city supplies.

Based on current City demand projections, the volume of water required to meet these goals in 2045 would be:

- 7,500 acre-feet per year (AFY) (30 percent of the City's annual water demand)
- 9 million gallons per day (MGD) (which equates to half of normal indoor demand, or 30 percent of peak month average day demand)

This TM assumes that potential water supply options would need to provide 7,500 AFY and 9 MGD of supply for the City, either individually or collectively. The water supply(ies) would generally be used in response to droughts or disruptive events, since in normal years the City's supplies are adequate.

During the goal development process, the following rationale was cited for selecting the goal:

- Provides guidance to support decision making regarding magnitude of resiliency portfolio.
- Increases city potable water supply resiliency and reduces demand on Sonoma Water supplies.
- Mitigates shortages in Sonoma Water supply and interruptions in service.
- Increases ability to meet a portion of peak day demand using local supply.
- Could be achieved over time with a mix of supplies.
- Allows for adjustments to volume target if demands are lower/higher than anticipated (percentage-based goals).
- Integrates input from the Water Team, Stakeholder Group, and the community.

2.3 Water Supply Options

Based on review of existing information and discussions with the City's Water Team, Stakeholder Group, community, and BPU, a list of water supply options was established, as summarized in **Table 2-2**.

Potential water supply options and facilities were identified based on the City's existing facilities and planning efforts already underway. Sources of information included, but were not limited to, the following:

- City of Santa Rosa 2020 Urban Water Management Plan (UWMP)
- City of Santa Rosa 2020 Water Master Plan Update
- City of Santa Rosa 2018 Regional Water Reuse System Master Plan
- City of Santa Rosa Subregional Water Resources Recovery Facilities Master Plan
- Groundwater Sustainability Plan (GSP) Santa Rosa Plain Groundwater Subbasin
- City of Santa Rosa Groundwater Master Plan
- Recycled water agreements
- Desalination white papers
- Peer agency work from Sonoma Water, North Marin, and Marin Municipal on water supplies, as well as UWMPs
- Well test boring results
- City of Santa Rosa Water Use Efficiency water savings workbook
- Recycled water pond storage capacities

- GIS Info: City parcels; stormwater, recycled water, wastewater, and water distribution facilities; well locations

The City’s rationale for the selected suite of water supply options is listed below. The list of options achieves the following:

- Retains a broad diversity of options.
- Includes City and Regional projects.
- Includes aggressive efficiency incentives to reduce demand over time.
- Integrates input from Water Team, Stakeholder Group, and the Community.

Table 2-2: Water Supply Options

Supply Type	Supply Option Name
Groundwater	GW-1: Construct Additional Groundwater Extraction Wells GW-2: Convert Emergency Wells to Production Wells GW-3: Construct Aquifer Storage and Recovery (ASR) Wells GW-4: Construct Regional ASR Wells GW-5: Construct Regional Groundwater Extraction Wells
Purified Recycled Water	PR-1: Direct Potable Reuse (DPR) with Advanced Water Purification Facility (AWPF) at Laguna Treatment Plant (LTP) PR-2: Satellite DPR with AWPF PR-3a: Indirect Potable Reuse (IPR) with AWPF LTP into Groundwater Basin PR-3b: IPR with AWPF LTP into Lake Ralphine PR-3c: IPR with AWPF at LTP into Lake Sonoma PR-4: Regional DPR with AWPF at LTP
Recycled Water	RW-1: Expand City’s Non-Potable Recycled Water System
Desalination	DE-1: Regional Brackish Desalination DE-2: Ocean Desalination
Stormwater	SW-1: Stormwater Treatment and Storage in Aquifer SW-2: Stormwater Storage in Lake Ralphine with Treatment SW-3: Regional Stormwater
Efficiency Programs	E-1: Efficiency Programs

The water supply options then went through a screening analysis to focus the list of options to undergo detailed feasibility analysis. This process is described in Section 2.5. All of the supply options are described in further detail in Section 3.1.

2.4 Evaluation Criteria and Metrics

To assess the feasibility of each water supply option, a list of evaluation criteria and associated metrics and weights were established. After beginning the WSAP process with a list of approximately 16 individual criteria, the list was consolidated and refined with stakeholder input to a focused list of evaluation criteria to be used in the feasibility analysis. The criteria and their descriptions are provided in **Table 2-3**.

Table 2-3: Evaluation Criteria, Metrics, and Weights

Criterion	Description	Proposed Metric	Weight
Cost effectiveness	Quantitative calculation of life-cycle costs, based on future scenarios per the project goals (e.g., five-year drought occurring on average every 10 years).	Life cycle cost effectiveness for key scenarios (\$/acre-foot) (quantitative)	High
Scalability	Qualitative assessment of ability to provide sufficient supply to satisfy goals, i.e., achieve desired level of service for each scenario; secondarily, ability to scale further to address future uncertainty.	Volume of water provided (AFY/MGD) (quantitative) Ability to meet goals, and secondarily to increase production later, without undue effort/cost increase (qualitative)	High
Resiliency	Qualitative assessment of performance in the face of future uncertainty; for example, future regulations, energy costs, hydrology. The best options will suffer only modest degradation of performance if future conditions are worse than anticipated while inferior options will show marked degradation if planning assumptions aren't met.	Performance in the face of uncertainty (qualitative)	High
Equity	Qualitative assessment of any disproportionate impacts on vulnerable communities.	Level of disproportionate impact on vulnerable communities (qualitative)	High
Environmental performance	Qualitative assessment of potential environmental impacts not already included in permitting/regulatory compliance (e.g., level of GHG emissions).	Magnitude of potential impact (qualitative)	High
Legal, permitting, and regulatory	Qualitative assessment of complexity/effort to address legal issues (e.g., water rights), obtain necessary permits, and comply with regulations	Level of complexity and effort to address (qualitative)	Medium
City control and interagency coordination	Qualitative assessment of level of City control and coordination with potential partner agencies, if any (e.g., agreements needed for regional projects).	Level of City control and coordination with potential partner agencies, if any (qualitative)	Medium
Multi-benefit	Qualitative assessment of benefits provided in addition to water supply.	Benefits provided in addition to water supply (qualitative)	Medium

The selected criteria achieve the following:

- Captures key considerations that differentiate projects.
- Consolidates criteria where appropriate. (For example, individual criteria for construction and operations costs were consolidated into the overall cost-effectiveness metric.)
- Removes criteria that would pose a fatal flaw if not met. (For example, water quality was removed from the list of criteria because a supply option that would not provide adequate water quality would not merit further analysis.)
- Removes criteria that did not need to stand alone. (For example, a criterion for “ability to integrate with existing distribution systems” was removed since facilities required to integrate into the existing system would be captured as part of a supply option and its costs.)
- Integrates input from Water Team, Stakeholder Group, the community, and BPU.

Additionally, each criterion was assigned a metric and weight so the feasibility analysis could reflect City priorities about the relative importance of each criterion. Weights and metrics are summarized in **Table 2-3**. The evaluation metrics and weights achieve the following:

- Emphasizes key considerations such as cost, resiliency, and equity via weighting.
- Enables comparisons based on qualitative factors such as permitting/regulatory considerations.
- Provides enough detail for meaningful comparison, given level of available information.
- Integrates input from Water Team, Stakeholder Group, BPU, and the community.


Based on Water Team, BPU, and Stakeholders Group input, all criteria included on the final list were weighted as “high” or “medium” because criteria of lower importance had been removed from the criteria list. The final list of evaluation criteria represents a focused list of key considerations.

As part of the detailed feasibility analysis, a detailed rubric was developed to allow water supply options to be scored against the qualitative criteria (described further in Section 2.5.3).

2.5 Screening Analysis

Prior to detailed analysis of the water supply options, a screening step was implemented to yield a focused and manageable “short list” of water supply options to undergo detailed analysis. Some options were removed from consideration prior to screening based on obvious flaws. The workflow is shown in **Figure 2-1**. Each water supply option listed in **Table 2-2** was evaluated against two key criteria: cost-effectiveness and scalability (yield). The screening analysis involved a high-level assessment of these two criteria in order to determine which supply options are most promising for the City and document the reasoning by which certain supply options should advance for further detailed analysis, or not. The screening process allowed the City to identify any non-starter options early on and focus the remaining analysis. The results of the screening analysis are described further in Section 3.2.

Figure 2-1: Screening and Feasibility Analysis Process

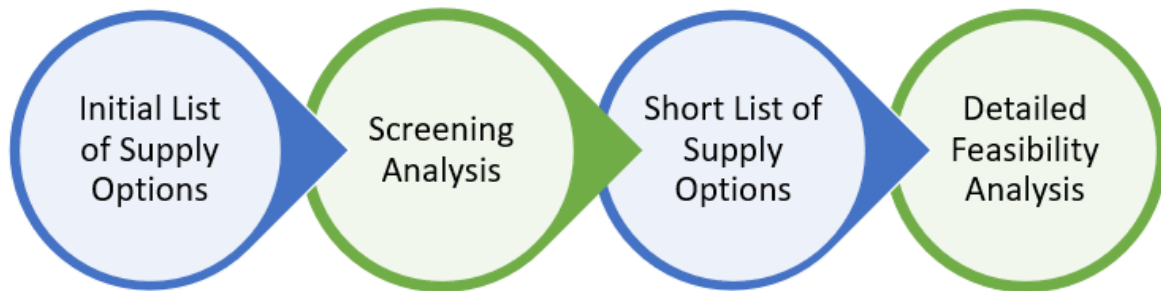

2.5.1 Screening Tool

The screening analysis was accomplished with the aid of a spreadsheet model. The model was used to determine the conceptual performance of each supply option. Specifically, the model evaluated the volume of water that would be supplied under various hydrologic, regulatory, and operational scenarios, and determined the associated unit cost for each supply option based on its projected usage. The screening tool included a number of default assumptions and options, referred to as the baseline scenario, as summarized in **Table 2-4**. Each of these variables can be manipulated in the model to evaluate changing conditions (e.g., higher energy prices).

Table 2-4: Baseline Screening Analysis Parameters and Assumptions

Parameter	Default Value	Source Notes
2045 demand	25,000 AFY	Provided by City
Sonoma Water nominal allotment	29,100 AFY	Provided by City. In dry years, allotment is subject to reduction based on a percent of baseline demand, which is significantly lower than nominal allotment.
Current groundwater firm capacity	1,300 AFY	Provided by City
Discount rate	2.5%	Federal water resources planning discount rate for FY 2023. This rate is used to compute the present-day equivalent cost of future cash flows.
Price of energy	\$200/megawatt hour	Prevailing price in California (note that time of use surcharges were not considered in this high-level analysis)
First year of simulation	2045	Water supply goal. Assumes water supply is available in 2045, at which point the model begins its 50-year simulation.
Planning horizon	50 years	Typical water infrastructure planning horizon
Sonoma Water reduction in dry years	30%	Provided by City. The dry-year Sonoma Water supply is assumed to be 70% of baseline purchases, which in turn are baseline demands less non-Sonoma supplies including existing groundwater plus the water supply option being modeled.
Demand reduction in dry years	10%	Provided by City
Hydrology	Historical replay (beginning in 1920)	United States Geological Survey Russian River Historical Data

A final key model parameter was the assumed hydrologic scenario. The model uses hydrologic scenarios to determine the distribution of normal, dry, and wet years modeled, which in turn determine the volume of supplemental supply required over the planning horizon. The model included the following hydrological scenarios: historical hydrology with selectable starting year (total range from 1911 to 2013); a synthetic hydrology which assumes a greater proportion of dry years; and a synthetic hydrology which assumes a greater proportion of wet years. The synthetic hydrologies employ a blend of inter-year randomness and first-order autoregression to capture the tendency of dry years to appear in runs, and thus cause droughts. The goal of using synthetic hydrologies is not to predict future climate, but rather to evaluate the performance of various water supply options under a variety of potential futures.

Model inputs included the following for each water supply option (except for options that were screened out at the conceptual stage):

- Maximum and minimum supply option yields in normal, wet, and dry years in acre-feet per year (AFY).
- Marginal operation and maintenance cost in normal, wet, and dry years as dollars per acre-foot (\$/AF). These costs include energy costs as appropriate, and purchase cost of water for the ASR option (GW-3).
- Fixed operations and maintenance costs (\$/year).
- Capital costs (\$).
- Storage capacity included in the supply option as acre-feet (AF)
- Leave-behind percentage (if applicable) (%).

The key model output is cost-effectiveness (\$/AF) for a supply option under the chosen scenario. Cost-effectiveness is determined within a given model scenario and is based on actual volume used from the supply source. The cost-effectiveness accounts for the water year type, potential required water allocations (reductions from normal use during water shortages) from Sonoma Water, and demand reduction during dry years (whether imposed by the state, imposed by the City, or done voluntarily), assumed demand, supply from existing wells, and any storage associated with the water supply option. The cost tables in Section 3.1 include the cost-effectiveness of each water supply option under the baseline scenario.

In addition, by varying the model parameters such as hydrology and demand reduction percent, the cost-sensitivity of each supply option could be evaluated under a range of conditions.

2.5.2 Capital Cost Estimate Methodology

A key component of the screening analysis included compiling cost estimates for each supply option on the initial list. The high-level cost estimates presented in this TM were developed from bid tabulations, information obtained from previous studies, and experience on other projects. Life cycle costs presented in this TM include planning level construction costs and operations and maintenance (O&M) costs. The Association for the Advancement of Cost Engineering International (AACEI) developed metrics to classify estimating accuracy through project development. The cost estimates presented in this document are considered Class 5 for a planning-level feasibility study estimate. Based on AACEI guidelines, actual project costs are typically within +50 percent to -15 percent of the planning-level cost estimate. However, there could be additional uncertainty not modeled in the initial estimates. Project feasibility and funding should consider the inherent level of uncertainty associated with planning level cost estimates.

Each planning level cost estimate includes an estimating contingency of 50 percent. Implementation costs were estimated at 40 percent for legal and administration, engineering design, engineering services during construction and construction management. The annual O&M cost estimate includes electricity, labor and maintenance costs.

Project costs were calculated in 2023 dollars using the January 2023 Construction Cost Index for San Francisco, 15498.78. Annual Project costs are amortized using a 2.5 percent interest rate over a 50-year period.

2.5.3 Feasibility Scoring Methodology

Upon completion of the screening analysis, Woodard & Curran completed the feasibility analysis by evaluating and scoring the short-listed water supply options. This step of the analysis built upon the evaluation criteria established during development of the study parameters (**Table 2-3**). The evaluation process included developing criteria for the projects, adding numerical weights to each criterion, and scoring the projects against each criterion. The numerical system provides a score of zero through 2, with 2 being most favorable. A score of zero implies that an option is not responsive to a criterion or performs relatively poorly compared to the other options, while a score of 2 implies that the option performs very well. Applying a weight allows the ranking to better reflect the priorities of the City and its stakeholders, showing the relative importance of each criterion. The evaluation criteria scoring rubric used for the evaluation of the short-listed supplemental supply options is summarized in **Table 2-5**.

Table 2-5: Evaluation Criteria Scoring Rubric

Criterion	Proposed Evaluation Metric	Quantitative Score	Qualitative Score: 0	Qualitative Score: 1	Qualitative Score: 2	Weight	Score Multiplier
Cost effectiveness	Quantitative calculation of life-cycle costs, based on the baseline scenario per the project goals (e.g., five-year drought occurring on average every 10 years).	\$/AF	>\$3,000/AF under baseline scenario	Between \$2,000/AF and \$3,000/AF under baseline scenario	< \$2,000/AF under baseline scenario	High + Screening Criterion	5
Scalability	Qualitative assessment of ability to provide sufficient supply to satisfy goals, i.e., achieve desired level of service for each scenario; secondarily, ability to scale further to address future uncertainty.	Yield (AFY)	Low flexibility: No ability, or minimal ability, to scale down production when supply is not needed.	Moderate flexibility: Some ability to scale production up or down depending on need for supply but would require significant effort or construction of new facility phases.	High flexibility: Production can be easily scaled up or down depending on need without significant investment.	High + Screening Criterion	5
Resiliency	Qualitative assessment of performance in the face of future uncertainty; for example, future regulations, energy costs, hydrology. The best options will suffer only modest degradation of performance if future conditions are worse than anticipated while inferior options will show marked degradation if planning assumptions aren't met.	Change in costs due to energy prices and hydrology scenarios can be accounted for quantitatively. These would feed into the qualitative scores.	Substantial change in cost-effectiveness under changing energy and hydrology conditions.	Moderate change in cost-effectiveness under changing energy and hydrology conditions.	Little or no change in cost-effectiveness under changing energy and hydrology conditions.	High	3
Equity	Qualitative assessment of any disproportionate impacts on vulnerable communities.	N/A	Would have the potential for a disproportionate impact (such as providing different water supply sources to certain parts of City).	Would have no impact on vulnerable communities.	Would have a benefit to vulnerable communities.	High	3
Environmental performance	Qualitative assessment of potential environmental impacts not already included in permitting/regulatory compliance (e.g., level of GHG emissions).	N/A	Unknown or high potential for environmental impacts (e.g., large project footprint, high energy use, or location in undeveloped area).	Moderate potential for environmental impacts (e.g., medium or unknown project footprint, moderate energy use, unknown project location).	Limited potential for environmental impacts (e.g., small project footprint, low energy use, location in existing developed area).	High	3
Legal, permitting, and regulatory	Qualitative assessment of complexity/effort to address legal issues (e.g., water rights), obtain necessary permits, and comply with regulations	N/A	High complexity/effort: Requires major permitting/ regulatory effort, with little or no established precedent to follow.	Moderate complexity/effort: May have major permitting/ regulatory effort permits, etc., but there is an established process to follow.	Low complexity/effort: Permitting/ regulatory steps are known, and projects of this type are routinely implemented.	Med	1
City control and interagency coordination	Qualitative assessment of level of City control and coordination with potential partner agencies, if any (e.g., agreements needed for regional projects).	N/A	Coordination required with partner agencies that City does not already work with.	Coordination required with partner agencies that City already works with.	No need for coordination with other parties.	Med	1
Multi-benefit	Qualitative assessment of benefits provided in addition to water supply.	N/A	No other benefits provided.	One additional benefit would be provided by the project.	Two or more additional benefits would be provided by the project.	Med	1

3. FINDINGS

3.1 Water Supply Option Descriptions

This section describes each of the evaluated supplemental supply options, listed in **Table 3-1**. The options remained substantially the same as those listed in **Table 2-2**, with a numbering system applied and some revisions to the option titles. The preliminary level concepts were developed closely with the Water Team, as well as with input from the Stakeholder Group, BPU, and the community. Preliminary-level cost estimates are also summarized in the following subsections, where applicable. Additionally, the results of the screening tool’s baseline scenario average cost of water are presented in the following subsections. A summary of the results is provided in Section 3-2 Screening Analysis Results (see Table 3-35).

Table 3-1: Summary of Water Supply Options

Supply Type	Supply Option Name
Groundwater	GW-1: Construct Additional Groundwater Extraction Wells GW-2: Convert Emergency Wells to Production Wells GW-3: Construct ASR Wells GW-4: Construct Regional Groundwater Extraction Wells GW-5: Construct Regional ASR Wells
Purified Recycled Water	PR-1: DPR Advanced Water Purification Facility (AWPF) at LTP PR-2: Satellite DPR AWPF PR-3a: IPR AWPF at LTP into Groundwater Basin PR-3b: IPR AWPF at LTP into Lake Ralphine PR-3c: IPR AWPF at LTP into Lake Sonoma PR-4: Regional DPR AWPF at LTP
Recycled Water	RW-1: Expand City’s Non-Potable Recycled Water System
Desalination	DE-1: Regional Brackish Desalination DE-2: Ocean Desalination
Stormwater	SW-1: Stormwater Storage in Aquifer SW-2: Stormwater Storage in Lake Ralphine SW-3: Regional Stormwater
Efficiency Programs	E-1: Efficiency Programs
Baseline	No Project Option, Continue to Import from Sonoma Water

3.1.1 Groundwater Supply Options


The City has a total of six municipal groundwater wells, all within the Santa Rosa Plain Subbasin.¹ These wells are shown in **Figure 3-1**.

Two of the City’s municipal wells (Carley and Peter Springs Wells) are currently operated primarily to serve an adjacent park and school for landscape irrigation but are also available and approved by the California Division of Drinking Water for emergency potable use on standby status. Two of the wells (Farmers Lane Wells No. W4-1 and W4-2) are on active status. One well is operated to provide landscape irrigation water supply only (Farmers Lane Well No. W4-3), and one well is used for emergency potable purposes only (Leete Well). In addition, a new emergency water supply well facility is currently being built at A Place to Play Park, with anticipated completion in calendar year 2023.

For all groundwater supply options developed, it is assumed that groundwater pumping would occur seasonally in the spring and summer months. In dry years, it is assumed that pumping would occur for a greater portion of the year.

¹ Note that the City has two other municipal wells that are either out of service or inactive: Freeway Well (W3) is out of service due to groundwater contamination caused by others; Sharon Park Well (W6) is inactive due to severe sanding.

Figure 3-1: Existing City Wells

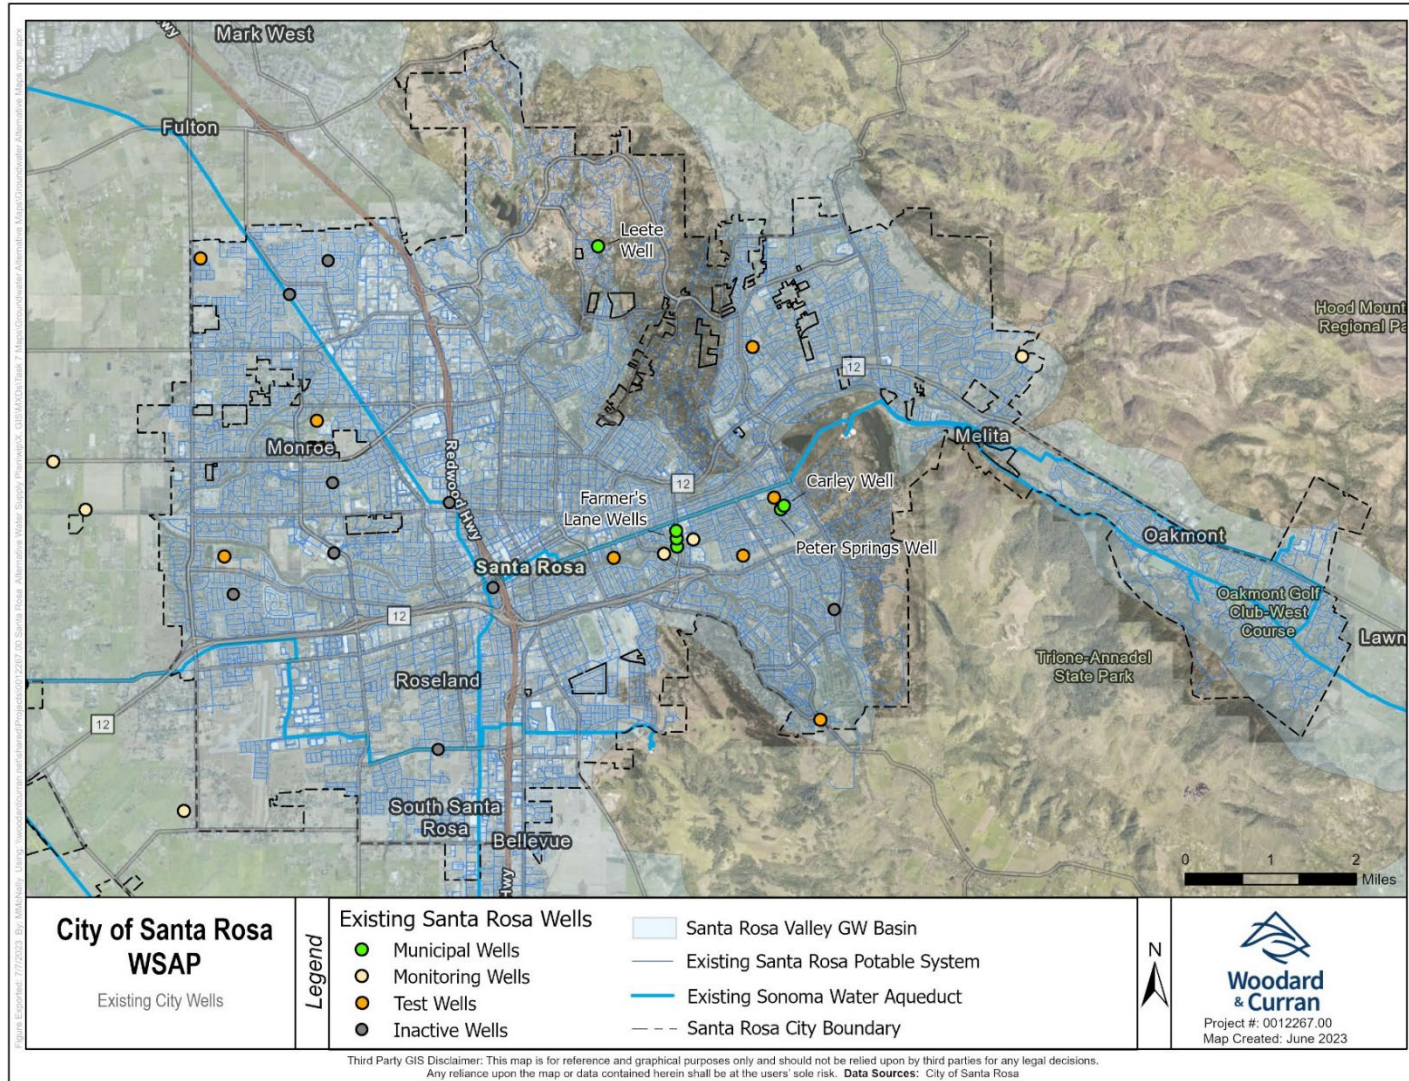

GW-1: Local Groundwater Extraction Wells

Supply option GW-1 proposes to construct additional production wells, wellhead disinfection, and iron and manganese treatment (if necessary) to connect to the City’s existing potable water distribution system. Based on existing well data for the City, an estimated 9 wells would be required to provide 7,500 AFY (i.e., to meet the City’s water supply goal 30 percent of the annual water demand), and 12 wells would be required to meet 30 percent of the peak month average day demand (9 MGD), based on a per-well capacity of ~500 gpm.¹

For this conceptual-level analysis, the following potential limiting factors for the GW-1 supply option were identified:

- Identification of appropriate locations for new wells. For this preliminary analysis, City-owned property was assumed as the location of the new groundwater extraction wells. For this preliminary analysis a 500-foot well depth was assumed. The City has both deep and medium deep wells in the vicinity.
- Well pumping capacity. For this preliminary analysis, well capacity was assumed to be 500 gpm.
- Potential well interference. The proposed wells are assumed to be constructed with even spacing to avoid potential well interference.
- Sustainability. The City’s wells generally have very stable non-pumping groundwater levels, with artesian conditions reported for Farmers 1, 2, and Leete wells. However, additional studies would be needed to verify sustainable yields.

The 12 proposed extraction wells are assumed to be located within the City’s Greenway Area, north of Hoen Avenue. **Figure 3-2** shows the proposed extraction well location zone and conveyance pipelines connecting to the Sonoma Water Aqueduct for distribution throughout the City’s R6R1 pressure zone. The 12 extraction wells would be constructed to be evenly spaced within the Greenway Area. Approximately 3,000 linear feet (LF) of 20-inch pipe and a 240 horsepower (hp) pump station would be required to convey the extracted groundwater to the Sonoma Water aqueduct for distribution. This conceptual option assumes the 12 wells to be connected to each other and one 20-inch water main connecting from the well zone to the City’s distribution system via Sonoma Water’s aqueduct as shown. Based on discussions with City staff, pumping into the aqueduct would not currently be an option; this configuration would require engaging in negotiations with Sonoma Water in the future.

The proposed infrastructure as part of GW-1 supply option may include:

- Well equipment including well head, pump, well house building for 12 wells
- Conveyance pipelines
- Electrical service for each well
- Treatment systems for disinfection, manganese and iron onsite, if needed
- Backup generator for power outage

¹ For simplicity, this analysis assumes construction of 12 new wells. Other possible approaches could include converting emergency wells to production, in combination with new wells, to meet the 9 MGD goal, if GW-2 is not pursued. The City also has Freeway Well and Sharon Park Well, but they don’t appear feasible at this time due to site and water quality constraints.

- Backwashing treatment system (assumes disposal to nearby sanitary sewer)

The total preliminary capital cost for option GW-1, including all infrastructure listed, is approximately \$96 million. A summary of the GW-1 capital cost is shown in **Table 3-2**. Additional cost detail can be found in Appendix A.

Table 3-2: Preliminary Capital Cost, Supply Option GW-1

Component	Description	Cost, in 2023 Dollars
New Well Construction	12 extraction wells, ~500 gpm capacity, 500 feet deep, includes well head, casing, well pump and equipment, electrical service, disinfection, backup generator, well housing (\$3.5 million per well)	\$42,000,000
Groundwater Conveyance Line	20-inch diameter; 3,000 linear feet linear feet	\$2,225,000
Groundwater Pump Station	240 horsepower	\$1,560,000
Potable System Connection		\$100,000
Estimating Contingency	50% of raw construction costs	\$22,950,000
Implementation	40% of total construction costs	\$27,540,000
Total Capital Cost		\$96,380,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$3,398,000

The O&M cost of the project was estimated on a per AF basis for scalability. The GW-1 option has a fixed annual O&M cost of \$500,000 and an annual marginal O&M cost of approximately \$264/ AF. Annual O&M costs will vary depending on the production of the extraction wells. The estimated annual O&M costs for the maximum potential yield of 10,080 AFY is approximately \$3 million. **Table 3-3** summarizes the annual O&M costs for option GW-1. Under the Baseline Scenario, as modeled by the screening tool, actual production would be less, resulting in a somewhat higher cost per AF. Constructing fewer wells would reduce the cost per AF under the Baseline Scenario but would not necessarily meet the 9 MGD goal.


Table 3-3: Preliminary Annual O&M Cost, Supply Option GW-1

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, chemical addition, water/sewer fees	\$264/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing, Santa Rosa Plain Groundwater Sustainability Agency fees	\$501,000
Average cost of water (Baseline Scenario) ¹		\$843/ AF
Annual O&M (10,080 AFY) ²		\$3,165,000
Cost of water (10,080 AFY) ²		\$700/ AF

Notes:

1. See Section 2.5 for description of baseline scenario, in which 6,734 AFY are used. That baseline is based on operating wells at least from April through October in all years, i.e., at a minimum of 7/12 of full capacity, and more as needed in dry years. The cited costs include capital and operating costs for the baseline usage scenario.
2. The maximum supply yield of 10,080 AFY assumes 24/7 operation of all supply option infrastructure. While this scenario does not reflect realistic operations because it would produce more water than the City would use, and because it does not reflect downtime for maintenance. The baseline scenario is more informative as to likely unit costs.

Figure 3-2: Supply Option GW-1

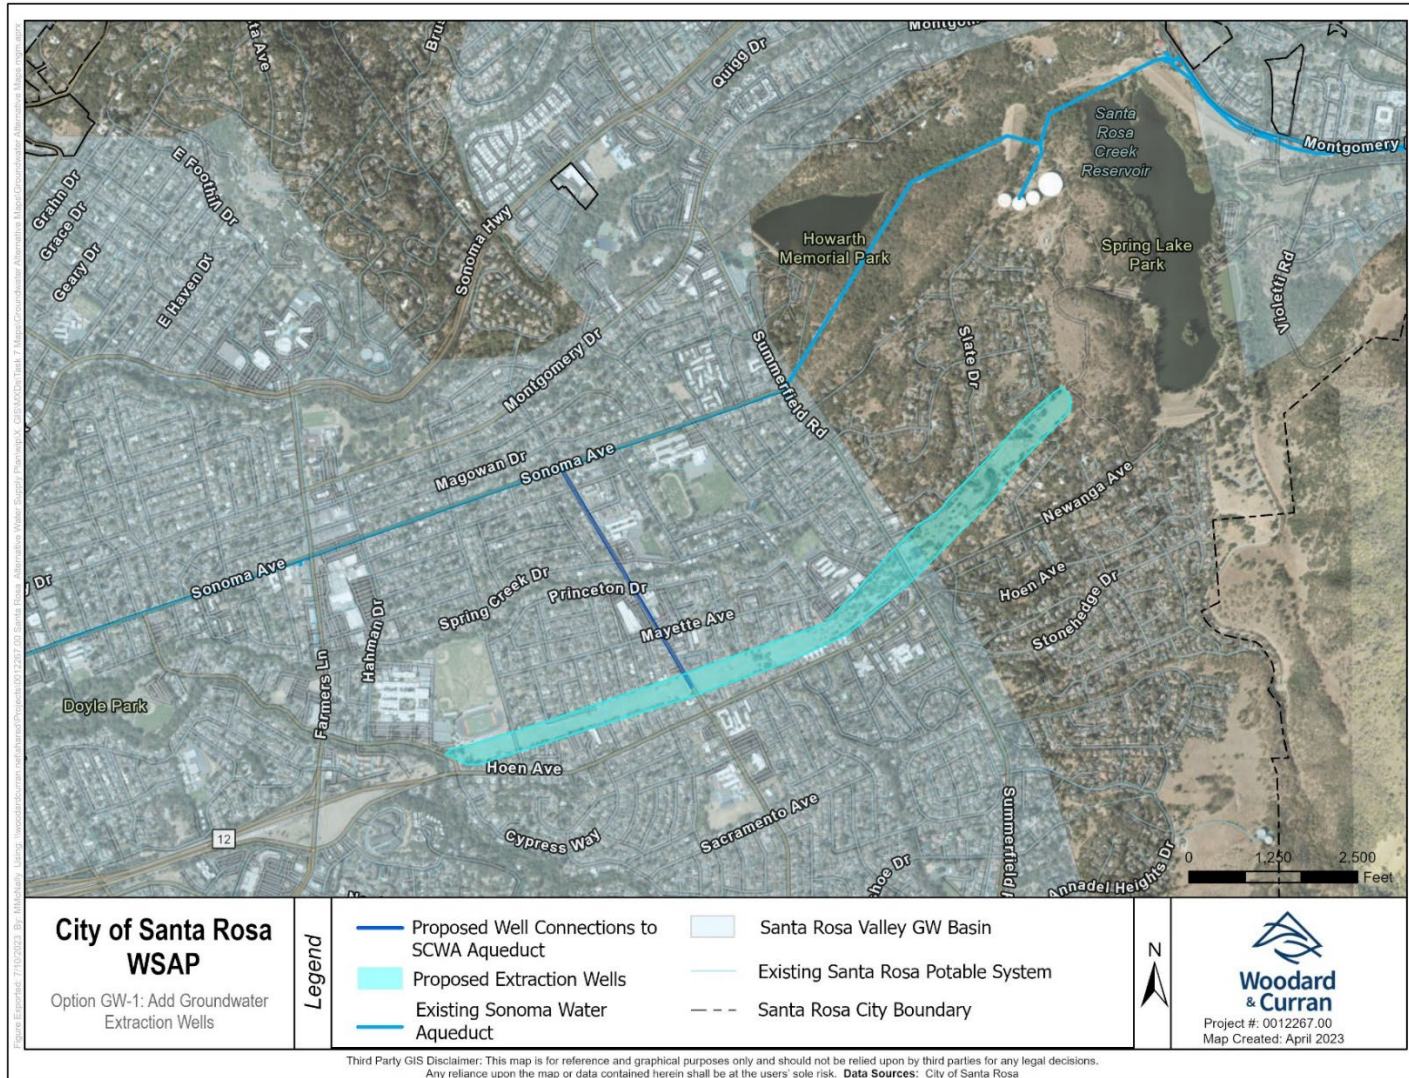

GW-2: Convert Existing Emergency Wells into Production Wells

Supply option GW-2 proposes to rehabilitate the City’s three existing emergency wells into production wells. The three emergency wells for the City include the Leete Well, Carley Well, and Peter Springs Well, as shown in **Figure 3-1**.¹ The Leete Well is currently out of service due to concerns over a possible casing separation, rehabilitation is currently in design. The Carley and Peter Springs wells have the capacity to provide the City with approximately 1 MGD of groundwater capacity on a stand-by-emergency basis.

For this conceptual-level analysis, the following potential limiting factors for the GW-2 supply option were identified:

- Well pumping capacity: Leete, Peter Springs, and Carley standby/emergency supply wells have a pumping capacity of 240, 500 and 700 gpm, respectively. The GW-2 option will provide up to 2,462 AFY of additional supply.
- Technical studies to verify that long-term use of the wells would be sustainable.
- Permitting considerations to allow for water supply from the Leete, Peter Springs, and Carley wells.

The proposed infrastructure rehabilitation and upgrades as part of GW-2 supply option may include:

- Rehabilitation of the three emergency wells, using mechanical and chemical methods
- Redevelopment of the wells
- Well house improvements for the wells, including a pump and motor, a pre-packaged disinfection system with eyewash, and a SCADA connection
- Site improvements including electrical, plumbing, and mechanical
- Instrumentation and control

The total preliminary capital cost for option GW-2, including the improvements listed, is approximately \$11.6 million. A summary of the GW-2 capital cost is shown in **Table 3-4**. Additional cost details can be found in Appendix A.

¹ For simplicity, this analysis assumes rehabilitation of the three existing emergency supply wells. Other possible approaches could include rehabilitating existing inactive wells to production status (such as Freeway Well and Sharon Park Well), in combination with rehabilitation of the existing emergency wells, to provide additional supply. However at this time, Freeway Well and Sharon Park Well do not appear feasible due to water quality concerns.

Table 3-4: Preliminary Capital Cost, Supply Option GW-2

Component	Description	Cost, \$2023
Well Rehabilitation and Upgrades	Rehabilitation and redevelopment of the three-emergency stand-by wells, well house improvements, instrumentation and control	\$5,520,000
Estimating Contingency	50% of raw construction costs	\$2,760,000
Implementation	40% of total construction costs	\$3,310,000
Total Capital Cost		\$11,590,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$409,000

The O&M cost of the project was estimated on a per AF basis for scalability. The GW-2 option has a fixed annual O&M cost of \$123,000 and an annual marginal O&M cost of approximately \$236/ AF. Annual O&M costs will vary depending on the production of the converted wells. The estimated annual O&M costs for the maximum potential yield of 2,462 AFY is approximately \$705,000. **Table 3-5** summarizes the annual O&M costs for option GW-2. Under the Baseline Scenario, as modeled by the screening tool, actual production would be less than 2,462 AFY, resulting in a greater cost per AF.

Table 3-5: Preliminary Annual O&M Cost, Supply Option GW-2

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, chemical addition, water/sewer fees	\$236/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing, Santa Rosa Plain Groundwater Sustainability Agency fees	\$123,000
Average cost of water (Baseline Scenario) ¹		\$540/ AF
Annual O&M (2,462 AFY) ²		\$705,000
Cost of water (2,462 AFY) ²		\$452/ AF

Notes:

1. See Section 2.5 for description of baseline scenario, under which 1,744 AFY are used. That baseline is based on operating wells at least from April through October in all years, i.e., at a minimum of 7/12 of full capacity, and more in dry years as needed. Costs for the baseline scenario include capital and operating costs.
2. The maximum supply yield of 2,462 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations.

GW-3: Local Aquifer Storage and Recovery (ASR) Wells

An additional groundwater supply option is GW-3, which proposes to inject water directly into the groundwater aquifer for later recovery and use. Water is typically injected during wet periods when there is supply available (e.g., potable water) and extracted during dry periods and/or during peak demands

when additional supplies are needed. GW-3 could include injecting excess potable supplies when available into the groundwater basin.

ASR offers advantages as a method to increase water supply for drought mitigation. Due to the underground storage nature of ASR projects, this supply is more resilient than other alternative storage methods such as surface recharge or storage, which experience water losses due to evaporation. A phased approach can be followed to develop a pilot ASR project to understand local conditions and ensure there are no “fatal flaws” before a full-scale ASR implementation. The number of wells to meet the demand would vary depending on well capacities, for this conceptual-level analysis, a 500 gpm capacity and 500 feet well depth was assumed.

For this conceptual-level analysis, the following potential limiting factors for the GW-3 supply option were identified:

- Appropriate site selection for ASR wells; right-of-way issues.
- Hydrogeologic constraints with aquifer potential for injection, storage, and extraction of water.
 - Well capacities range 400-1,000 gpm or greater. Assumed 500 gpm for this level of analysis based on existing City well information.
 - Well depths range from 300-1,000 feet. Assumed 500 feet for this level of analysis based on existing City well information. (Note that actual well depth could be deeper depending on hydrogeologic conditions; for reference, Sonoma Water wells range from about 800 to 1,000 feet deep (Sonoma Water, n.d.)).
- Source of water for injection
- Chemical properties of source water versus native groundwater and potential reactions due to mixing
- Retention time or storage capacity of aquifer prior to injection
- Regulatory constraints and compliance with environmental requirements with injection of water into groundwater
- Pre-treatment of water prior to injection for storage to meet regulatory requirements
- Disinfection and potential treatment prior to distribution (high concentrations of iron and manganese were noted in this area)
- Extensive monitoring of water levels and quality and reporting

Preliminary review of Airborne Electromagnetic survey data available from the Department of Water Resources (DWR) shows potential target areas along the western boundary of the subbasin that appear promising for ASR (California Department of Water Resources, 2022). **Figure 3-3** below shows potential ASR well areas within the City’s boundary. Additional areas would be considered as well, if this option is chosen for further development.

In the Santa Rosa Plain Subbasin, groundwater generally flows westward from recharge areas in the mountains into the west side of the subbasin. The shallow aquifer generally extends from the water table to depths ranging from 150 feet to 200 feet below land surface (Santa Rosa Plain Groundwater Sustainability Agency, 2021). Elevations in the deeper zone aquifers are approximately 10 to 40 feet lower than groundwater elevations in the shallow aquifer system in the Subbasin (Santa Rosa Plain Groundwater Sustainability Agency, 2021). The shallow aquifer is present over the entire extent of the subbasin and generally present under unconfined or semiconfined conditions. Shallow wells in this area (with depths


ranging from 90 to 167 ft below land surface) do not show enough injection capacity with groundwater levels being close to the land surface.

For the concept-level analysis for this feasibility analysis, the proposed six ASR wells were assumed to be constructed within the intermediate/deep aquifer (although the City could elect to include both shallow and deep ASR wells in order to minimize mounding of groundwater levels in areas with lower storage coefficients). The deep aquifer occurs under confined or semiconfined conditions with groundwater levels generally 20 feet lower in this area compared to the shallow aquifer system. The proposed well area is also home to existing dedicated shallow monitoring wells (three wells SRP0713, SRP0355, and SRP0357) and deep monitoring wells (SRP0347, SRP0359, and SRP0725) established as part of the Santa Rosa Plain GSP. These existing wells can be used for future monitoring of local conditions in support of future ASR implementation for sustainable management of the basin. Wells in this area are generally completed in the Wilson Grove Formation (formerly known as the Merced Formation). The Wilson Grove Formation is a sand-dominated formation exposed in the western Santa Rosa Plain Subbasin. Further hydrogeologic investigations would be needed to confirm local conditions.

The potential ASR and conveyance infrastructure required for GW-3 would be:

- Well equipment including well head, pump, and well house building for six ASR wells
- Conveyance pipelines
- Electrical service for each well
- Treatment systems for disinfection and if needed for manganese and iron
- Backup generator for power outage
- Backwashing treatment system (assumes disposal to nearby sanitary sewer)
- Dechlorination prior to injection

Figure 3-3: Supply Option GW-3

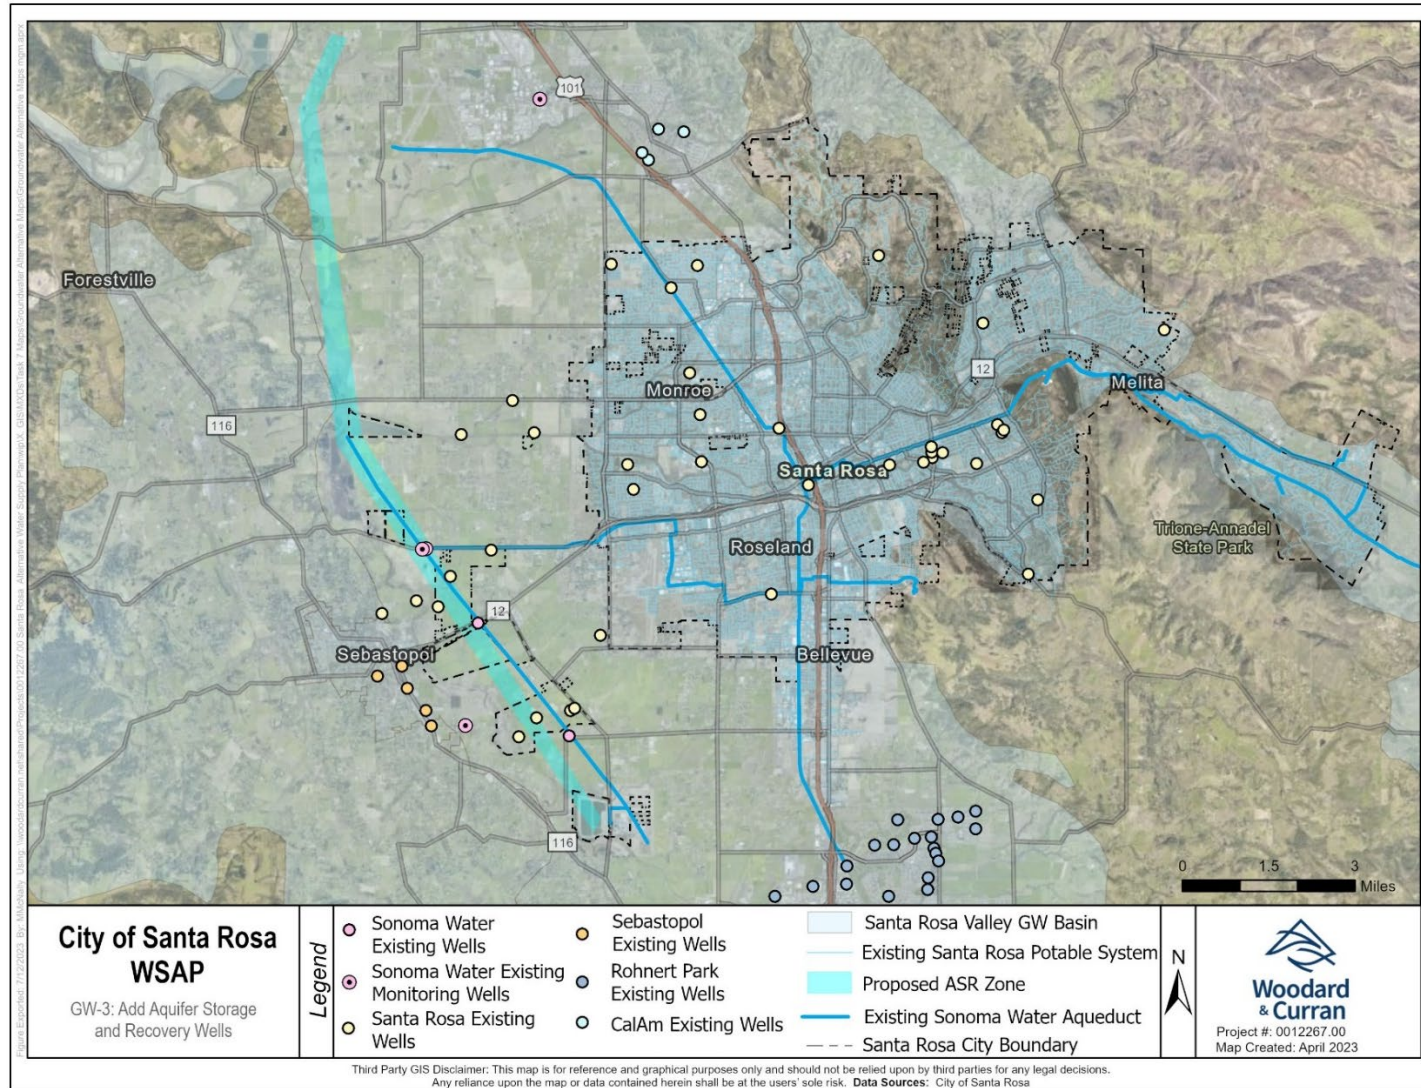

The total preliminary capital cost for option GW-3, including the improvements listed, is approximately \$81 million. A summary of the GW-3 capital cost is shown in **Table 3-6**. Additional cost details can be found in Appendix A.

Table 3-6: Preliminary Capital Cost, Supply Option GW-3

Component	Description	Cost, \$2023
ASR Well Construction	Six ASR (injection/extraction) wells, 500 feet deep, well head, casing, well pump and equipment (\$5 million/ well)	\$30,000,000
Groundwater Conveyance Line	16-inch diameter; 12,000 linear feet	\$7,120,000
Groundwater Pump Station	210 horsepower	\$1,365,000
Potable system connection		\$100,000
Estimating Contingency	50% of raw construction costs	\$19,300,000
Implementation	40% of total construction costs	\$23,160,000
Total Capital Cost		\$81,050,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$2,858,000

The O&M cost of the project was estimated on a per AF basis for scalability. The GW-3 option has a fixed annual O&M cost of \$121,000 and an annual marginal O&M cost of approximately \$1,813, which includes the cost to purchase water from Sonoma Water for injection. Annual O&M costs will vary depending on the production of the ASR wells. The estimated annual O&M costs for the maximum potential yield of 5,130 AFY is approximately \$9.42 million. **Table 3-7** summarizes the annual O&M costs for option GW-3. Under the Baseline Scenario, as modeled by the screening tool, actual production would be less than 5,130 AFY, resulting in a greater cost per AF. Installing fewer ASR wells would reduce the cost per AF under the Baseline Scenario.

Table 3-7: Preliminary Annual O&M Cost, Supply Option GW-3

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, chemical addition, water/sewer fees, purchase of water for injection.	\$1,813/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing, Santa Rosa Plain Groundwater Sustainability Agency fees	\$121,000
Average cost of water (Baseline Scenario) ¹		\$2,600/ AF
Annual O&M (5,130 AFY) ²		\$9,420,000
Cost of water (5,130 AFY) ²		\$2,400/ AF

Notes:

1. See Section 2.5 for description of baseline scenario, under which on average 3,634 AFY would be used. That baseline is based on operating wells at least from April through October in all years, i.e., at a minimum of 7/12 of full capacity, and more in dry years as needed. Cited costs include operating and capital.
2. The maximum supply yield of 5,130 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations. Cited costs include operating and capital.

GW-4: Regional Groundwater Extraction Wells

Option GW-4 consists of constructing new production wells outside the City limits (in neighboring jurisdictions) where the geology may allow for greater well yields than within the City. Provided that the wells are located in or near another Sonoma Water contractor agency’s jurisdiction, a paper exchange could be completed where the City takes a portion of the partner’s Sonoma Water allocation, and the pumped groundwater is used directly by the partner. The paper exchange option would not reduce regional reliance on the Sonoma Water system overall.

Implementation of option GW-4 would require identification of possible well locations, connections to existing distribution systems, regional coordination and agreements, and possible need for regulatory approvals. Components that would need to be constructed could include:

- Well equipping including well head, pump, well house building and equipment
- Conveyance pipelines
- Electrical service for each well
- Treatment systems for manganese and iron onsite, if needed
- Backup generator for power outage
- Backwashing treatment system (assumes disposal to nearby sanitary sewer)

This option assumes that the potential partner would need to be a Sonoma Water contractor who receives sufficient Sonoma Water contract supplies to make them open to a partial trade with Santa Rosa. Based on historical Sonoma Water deliveries, potential candidates could be Petaluma, North Marin Water District, Rohnert Park, and possibly City of Sonoma or Valley of the Moon Water District. This option also assumes that the City would find a partner for whom well yields of 1,000 gpm or more could be achieved, in order to provide a benefit over existing pumping rates of City wells. Based on an initial review of

information from Urban Water Management Plans of potential partners and DWR Bulletin 118, the Sonoma Valley Subbasin may provide enough yield to meet this threshold. The City of Sonoma and Valley of the Moon Water District are located within the Sonoma Valley Subbasin. Each of these agencies typically receives around 2,000 AFY or less from Sonoma Water. Based on these figures, it is assumed that 3,000 AFY at most would be available for trading, which would provide a portion of the City's water supply goal of 7,500 AFY.

Were such a project to be implemented, it is assumed that in wet years with sufficient Sonoma Water allocations, no groundwater pumping would occur. In normal years, pumping would occur in summer months, and in dry years, pumping would occur for a greater portion of the year. According to the Sonoma Valley Basin GSP, groundwater levels in the subbasin are generally stable but have some persistent pumping depressions, and groundwater in storage declined by about 900 AFY during 2012-2018. Therefore, it is assumed that any increase in groundwater extraction in Sonoma Valley would need to be offset by some form of recharge, and without recharge the project may not be compatible with groundwater management practices. Adding a recharge component to this supply option would likely yield a project similar to the Regional Aquifer Storage and Recovery option described in GW-5. Therefore, this supply option was not carried forward for detailed cost analysis or feasibility scoring.

GW-5: Regional Aquifer Storage and Recovery

Supply option GW-5 proposes developing a regional ASR project in collaboration with one or more agencies in the region and using Sonoma Water supplies and ASR water conjunctively. ASR wells can be constructed in the aquifer most feasible and promising in the region. Potential options would include: 1) the City connecting to ASR wells directly, and 2) the City utilizing participating agencies' surface water supplies from Sonoma Water while partnering agencies pump from ASR wells by the same amount in lieu of taking Sonoma Water supply.

Implementation of this supply option would require identification of feasible ASR well locations, connections to existing distribution systems, regional coordination and agreements, and possible need for additional water rights.

Overall, a regional ASR project would include similar components as a local ASR project. In addition, the City would be part of future regional ASR projects implemented by Sonoma Water (and possibly by the GSA) by default. For example, Sonoma Water has been in the process of evaluating feasibility of ASR in the Sonoma Valley Subbasin, including a pilot test in 2018 (Santa Rosa Plain Groundwater Sustainability Agency, 2021). Because many project elements and implementation considerations for regional ASR would be similar to the local ASR option above (GW-3), and because the City would effectively be participating in possible future ASR projects implemented by Sonoma Water, this option did not undergo any further separate technical analysis.

3.1.2 Purified Recycled Water Supply Options

The City operates the LTP for the Santa Rosa Regional Water Reuse System (Regional System). **Figure 3-4** depicts the location of the wastewater treatment facilities and the Regional System key facilities. LTP is a tertiary level treatment facility that has an overall average daily flow of 15.1 MGD and average dry weather flow of 13.6 MGD in 2020. LTP is permitted for 21.34 MGD average daily dry weather flow and takes wastewater from homes, businesses, and industry located within the Cities of Santa Rosa, Rohnert Park, Sebastopol, and Cotati, and the South Park Sanitation District. Over 500 miles of underground pipes bring


wastewater to the LTP where water goes through three stages of treatment prior to disinfection, storage, and reuse. The water is treated to the highest non-potable level recognized in State water recycling regulations (Title 22 Tertiary).

The Regional System provides recycled water to the City of Rohnert Park for its urban reuse program for irrigation at many Rohnert Park schools, parks, and businesses, as well as Sonoma State University. In Santa Rosa, recycled water is used within the City's urban growth boundary for landscape irrigation at City facilities (including the municipal services center, bus transfer station, Finley Park, and A Place to Play sports complex), as well as multi-family residential complexes, institutions, and business parks.

Depending upon the amount of rainfall in any given year, approximately 98 to 100 percent of the Regional System's recycled water is reused for urban landscapes, rural agricultural irrigation, and the Geysers Recharge Project. The volume of Title 22 tertiary water produced by the City in recent years (2019 through 2022) is summarized in **Figure 3-5**; it should be noted that 2020-2022 were historically dry years.


The purified recycled water options (also known as potable reuse) are limited by the reliable volume of tertiary effluent available given its existing use by current customers. For this level of study, it was assumed the City would size the AWPf to meet its 9 MGD peak month supply needs. This requires instantaneous flows as high as 11.4 MGD. That value is less than the average dry-weather flow available in 2020 of 13.6 MGD. However, should this option (or others involving purified water) move forward, an analysis of daily low flows would be needed to verify that the assumed amount of equalization storage was sufficient to allow the plant to run at full rate even during days and hours of low wastewater flows.

Figure 3-4: Regional System Facilities

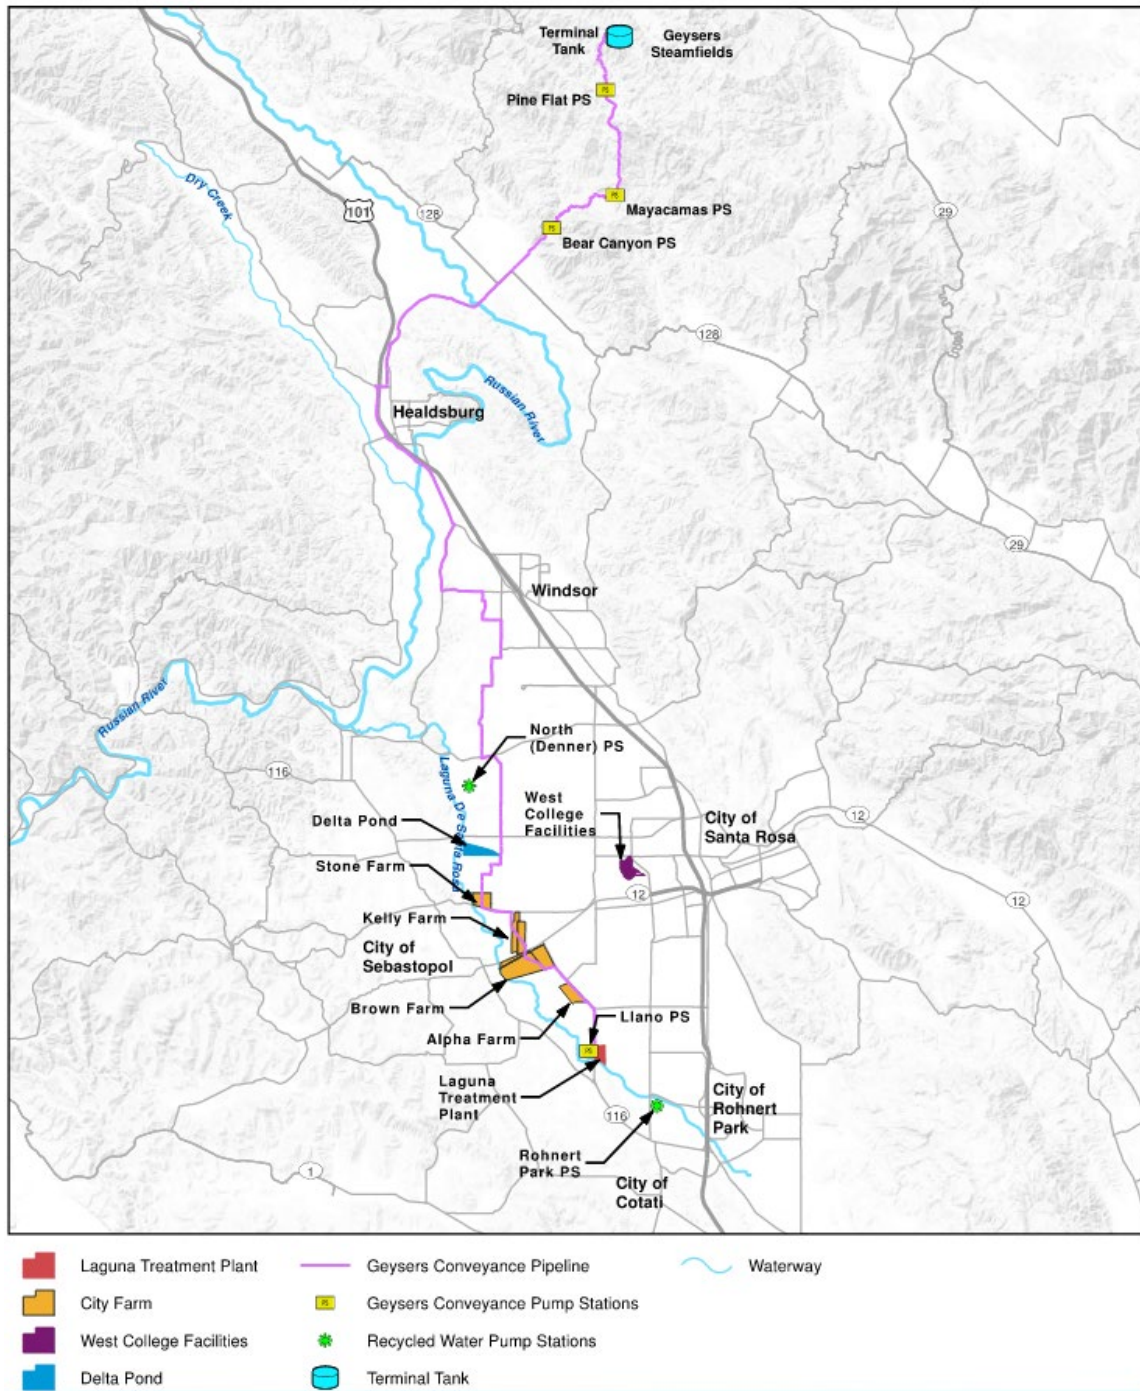

Source: Regional Water Reuse System Master Plan (City of Santa Rosa, 2018)

Figure 3-5: Average Recycled Water Use (2019-2022)

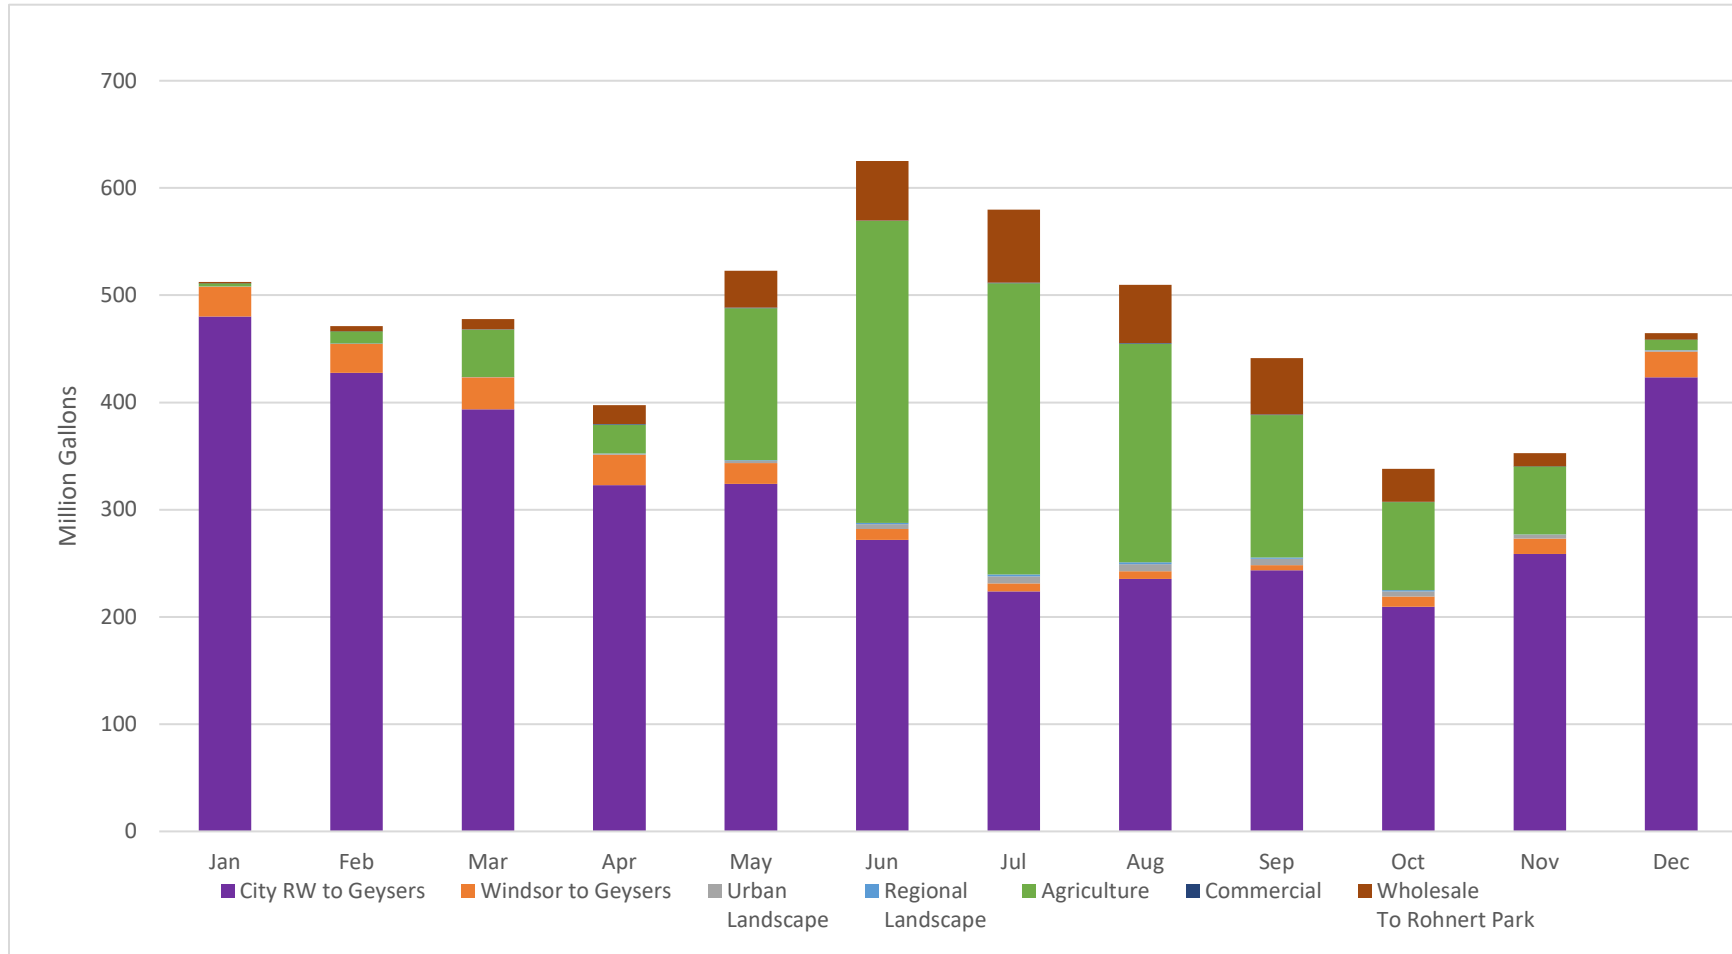


Source: Recycled Water Flows - Volume and User Type by Month 2019-2022 (City of Santa Rosa, 2023)

Potable Reuse Approaches

The spectrum of potable reuse approaches is commonly distinguished by the degree of separation between the treatment and ultimate consumption of purified water. This separation may be physical (e.g., when purified water travels through a groundwater aquifer), temporal (e.g., when water is retained in a tank or a reservoir), or both. IPR projects are characterized by the use of one of two environmental buffers—a groundwater aquifer or a surface water reservoir—that increase the separation between treatment and consumers. DPR projects are defined by the absence of a significant environmental buffer. The State of California recognizes five forms of IPR and DPR that are depicted in **Figure 3-6**, all requiring a multitude of pathogen and chemical control requirements.

Figure 3-6: Forms of Potable Reuse in California

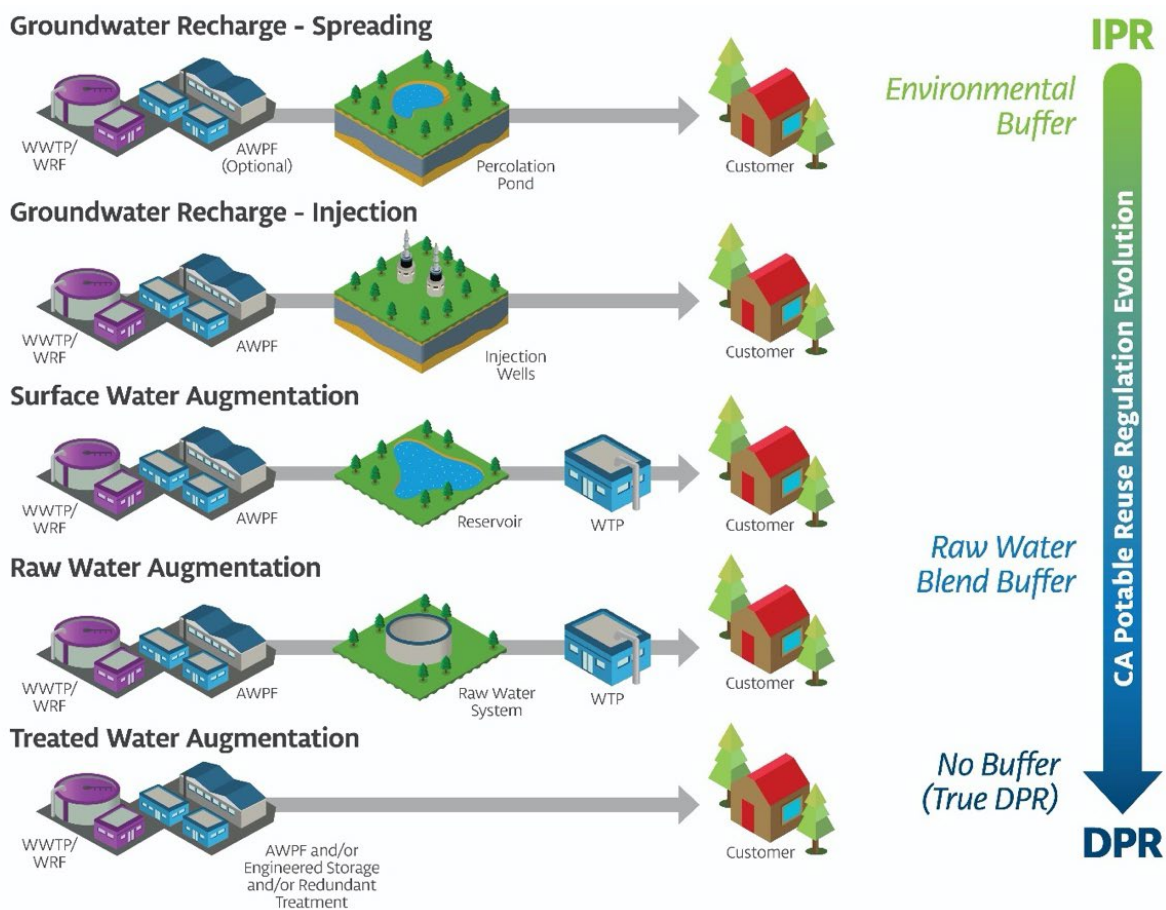

3.1.2.1.1 Indirect Potable Reuse

The first form of IPR distinguished by California regulations is groundwater recharge (GWR), which can be achieved by two different approaches: surface spreading and subsurface injection (Title 22, Chapter 3, Articles 5.1 and 5.2, respectively). The second form of IPR is surface water augmentation (SWA) which introduces purified water directly into a surface water reservoir that is used as a source of domestic drinking water supply.

One of the benefits of pursuing IPR projects in California is the regulatory certainty associated with the existence of final, adopted regulations for both GWR and SWA. This streamlines the permitting process by providing clarity on the requirements for IPR implementation. In the case of GWR, there are also multiple precedents given that permitted California GWR projects have been producing water for nearly 60 years. Based on this experience, the regulatory community has first-hand knowledge of the challenges with GWR allowing them to adapt the requirements to address these needs.

3.1.2.1.2 Direct Potable Reuse

The State Water Resources Control Board released draft criteria for DPR in March 2021 and revised criteria in August 2021 (State Water Resources Control Board, 2021). The draft criteria include stricter requirements than IPR to compensate for the protections that are lost from bypassing the environmental buffer. The criteria can be broken down into four major categories: 1) pathogen control, 2) chemical control, 3) monitoring and control, and 4) technical, managerial, and financial capacity.

Compared to IPR, DPR projects have stricter requirements for nearly all of these categories. One example of this difference is the level of treatment needed for IPR and DPR. Most categories of IPR require full advanced treatment (FAT), which is the treatment of the entire flow of water through both reverse osmosis (RO) and an advanced oxidation process (AOP). The draft DPR criteria specify higher levels of treatment, namely, pre-treatment with ozone and biological activated carbon (BAC) followed by FAT.

State regulations define two types of DPR—raw water augmentation (RWA) and treated water augmentation (TWA)—that are differentiated depending on whether the reuse project is providing a raw source water upstream of a surface water treatment plant, or a finished water directly into a public water system’s distribution system. RWA also encompasses projects that provide raw source water into an environmental buffer that cannot meet the IPR requirements. Despite the differences between RWA and TWA, the draft DPR criteria contain a single set of requirements to cover both forms. The State’s DPR Expert Panel—who is currently reviewing the public health protectiveness of the draft DPR criteria—has asked the State Board to provide separate criteria for these two forms. If the future regulations do not include separate requirements, then it is possible that projects designed for RWA may also have the flexibility to pursue TWA (and vice versa).

One benefit of DPR is that it does not restrict projects to areas with access to groundwater aquifers or reservoirs. Many agencies in California are considering the RWA form of DPR to continue leveraging investments they have made in existing treatment plant infrastructure. The main challenges in pursuing DPR include the lack of regulatory certainty (though draft criteria are on track to be finalized by the end of 2023) and the lack of permitting precedents.

Table 3-8 summarizes the flow requirements for the proposed DPR and IPR AWPfS assumed for this study.


Table 3-8: Preliminary AWPf Flow Summaries

Parameter	Units	DPR Maximum Treatment Flow	IPR Maximum Treatment Flow
Production Capacity	MGD	9.0	9.0
System Feed	MGD	11.6	11.4
Ozone/Biological Activated Filtration (BAF)			
<i>Assumed Recovery</i>	%	98	--
Feed	MGD	11.60	--
Brine	MGD	0.23	--
Effluent	MGD	11.37	--
Microfiltration System (MF)			
<i>Assumed Recovery</i>	%	93	93
Feed	MGD	11.37	11.40
Backwash	MGD	0.80	0.80
Effluent	MGD	10.6	10.6
Reverse Osmosis (RO) System			
<i>Assumed Recovery</i>	%	85	85
Feed	MGD	10.6	10.6
Brine	MGD	1.59	1.59
Effluent	MGD	9.0	9.0
Ultraviolet-Peroxide Disinfection (Ultraviolet/Advanced Oxidation Process - UV/AOP)			
<i>Assumed Recovery</i>	%	100	100
Feed	MGD	9.0	9.0
Effluent	MGD	9.0	9.0
Free Chlorine Disinfection			
<i>Assumed Recovery</i>	%	100	--
Feed	MGD	9.0	--
Effluent	MGD	9.0	--

PR-1: DPR AWPf at LTP

Option PR-1 would convey the City’s tertiary effluent to an AWPf co-located at the City’s existing LTP and return AWPf waste streams to the LTP headworks. The concept 9 MGD AWPf would include treatment processes in compliance with future anticipated regulations for TWA. The purified water would be conveyed to Sonoma Water’s 36-inch Kawana Pipeline for distribution to the City’s potable water system. PR-1 is limited by the reliable volume of tertiary effluent available. For this level of study, it was assumed the City would size the AWPf to meet its 9 MGD peak month supply needs. **Figure 3-7** shows the PR-1 concept, including the AWPf and conveyance infrastructure to the proposed potable connection point along Occidental Road.

Figure 3-7: Supply Option PR-1

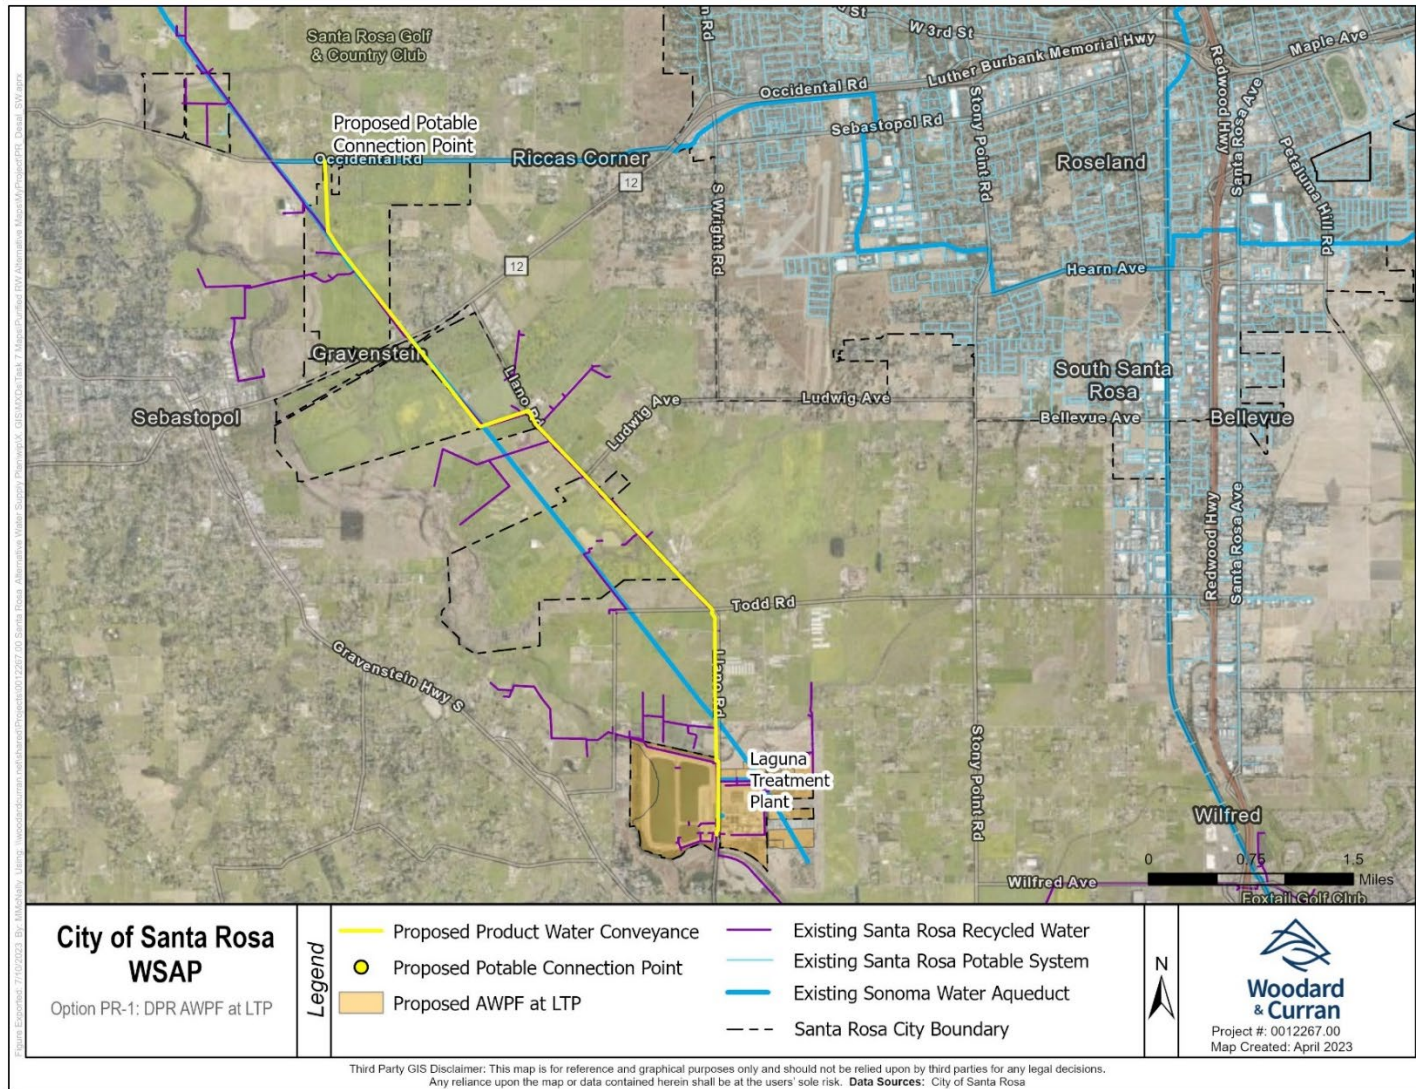

Components that would need to be constructed as part of PR-1 include:

- 24-inch tertiary water pipeline from LTP to AWPF
- 1.8 million gallon equalization basin
- AWPF to meet anticipated DPR regulations, conventional FAT plus ozone/ BAF
 - Ozone/BAF
 - Microfiltration system (MF)
 - Reverse Osmosis (RO) system
 - UV/AOP
 - RO brine disposal system (Evaporator and Crystallizer)
 - Ancillary facilities
- 20-inch product water pipeline and pump station to potable connection point
- Potable connection infrastructure

The total preliminary capital cost for option PR-1, including all infrastructure listed, is approximately \$289 million. A summary of the PR-1 capital cost is shown in **Table 3-9**. Additional cost detail can be found in Appendix A.

Table 3-9: Preliminary Capital Cost, Supply Option PR-1

Component	Description	Cost, \$2023
Equalization	1,820,000 gallon equalization basin prior to feeding AWPF	\$2,275,000
Tertiary Water Pipeline	24-inch diameter; assumed 500 linear feet	\$445,000
9 MGD DPR AWPF	Ozone, BAF, Ultra Filtration (UF)/Micro Filtration (MF), RO, chemical storage and feed systems, sitework, piping, structures, waste disposal to headworks	\$100,659,000
Brine Disposal	Brine evaporator and crystallizer for zero liquid discharge	\$10,730,000
Purified Water Line	20-inch diameter; 26,330 linear feet	\$19,528,000
Purified Water Pump Station	625 horsepower	\$4,063,000
Potable system connection		\$100,000
Estimating Contingency	50% of raw construction costs	\$68,900,000
Implementation	40% of total construction costs	\$82,680,000
Total Capital Cost		\$289,380,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$10,203,000

The O&M cost of the project was estimated on a per AF basis for scalability. The PR-1 option has a fixed annual O&M cost of \$873,000 and an annual marginal O&M cost of approximately \$927/ AF. Annual O&M costs will vary depending on the production of the AWPF. It is assumed the AWPF could be turned down to a production capacity of 30 percent during low demand periods. The estimated annual O&M

costs for the maximum potential yield of 10,065 AFY is approximately \$10.2 million. **Table 3-10** summarizes the annual O&M costs for option PR-1.

Table 3-10: Preliminary Annual O&M Cost, Supply Option PR-1

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, and chemical addition	\$927/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing	\$873,000
Average cost of water (Baseline Scenario) ¹		\$3,600/AF
Annual O&M (10,065 AFY) ²		\$10,200,000
Cost of water (10,065 AFY) ²		\$2,050/ AF
Annual O&M (3,019 AFY) ³		\$3,671,000
Cost of water (3,019 AFY) ³		\$4,600/ AF

Notes:


1. See Section 2.5 for description of baseline scenario, under which on average 4,131 AFY are produced by PR-1. Costs including operating and capital.
2. The maximum supply yield of 10,065 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations because it would produce more water than the City would use, which causes the unit cost of water to appear artificially low.
3. The minimal yield of 3,019 AFY assumes 30 percent turndown of the AWPf’s maximum yield to provide a range of supply available for the PR options.

PR-2: Satellite DPR AWPf

Option PR-2 would convey the City’s tertiary effluent to a satellite AWPf and return AWPf waste streams to the nearest sewer. The AWPf would include treatment processes in compliance with future anticipated regulations for TWA. The purified water would be conveyed to Sonoma Water’s 36-inch diameter pipeline for distribution to the City’s potable water system. The satellite AWPf is assumed to be located on City-owned agricultural leased land, Stone Farm. Although siting the AWPf as a satellite facility allows the City to reduce the purified water conveyance facilities, the satellite AWPf requires more ancillary facilities to support operations staff than if the AWPf were sited within the existing LTP.

For this level of study, it was assumed the City would size the AWPf to meet its 9 MGD peak month supply needs. The tertiary effluent to feed the AWPf would be conveyed to the satellite AWPf through new conveyance infrastructure assuming the existing Geysers pipeline corridor/ easement. The purified water would be conveyed to Sonoma Water’s aqueduct for distribution to the City as shown in **Figure 3-8**.

Figure 3-8: Supply Option PR-2

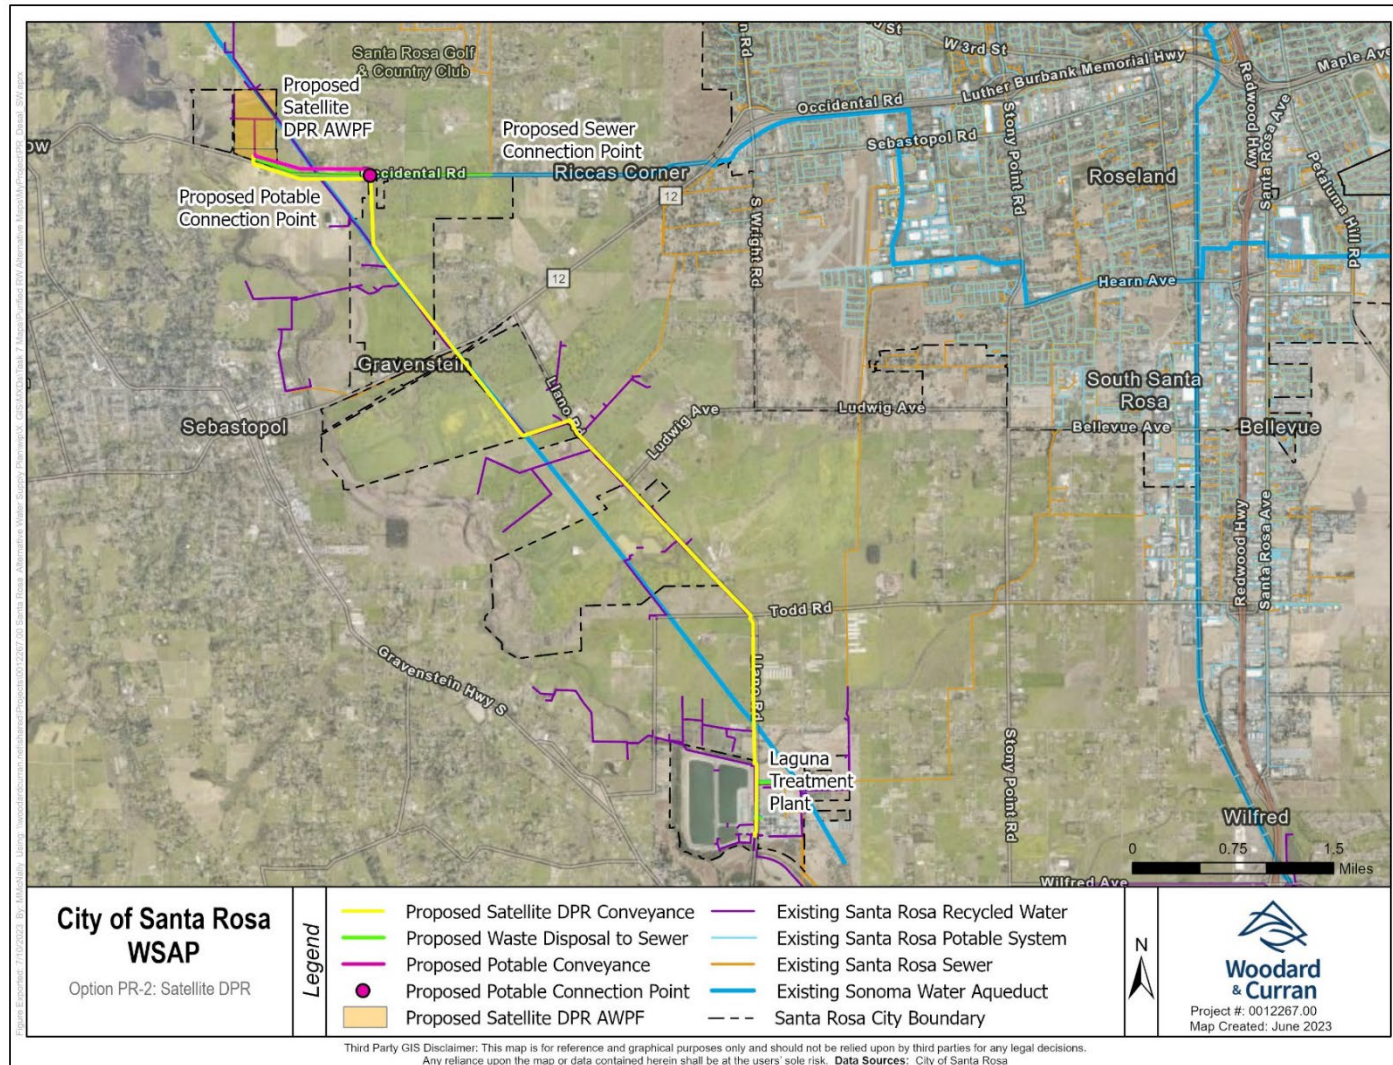

Components that would need to be constructed as part of PR-2 include:

- 24-inch tertiary water pipeline from LTP to AWPf
- 400 horsepower tertiary water pump station
- 1.8 million gallon equalization basin
- AWPf to meet anticipated DPR regulations, conventional FAT plus ozone/BAC
 - Ozone/BAC
 - MF/Spell out (UF) System
 - RO System
 - UV/AOP
 - RO brine disposal system (Evaporator and Crystallizer)
 - Ancillary facilities
 - 10-inch AWPf waste disposal to nearest sewer with capacity
- 20-inch purified water pipeline
- 250 horsepower pump station to potable connection point
- Potable connection infrastructure

The total preliminary capital cost for option PR-2, including all infrastructure listed, is approximately \$314 million. A summary of the PR-2 capital cost is shown in **Table 3-11**. Additional cost detail can be found in Appendix A.

Table 3-11: Preliminary Capital Cost, Supply Option PR-2

Component	Description	Cost, \$2023
Equalization	1,820,000 gallon equalization basin	\$2,275,000
Tertiary Water Pipeline	24-inch diameter; 30,100 linear feet	\$26,789,000
9 MGD DPR AWPf	Ozone, BAC, MF, RO, chemical storage and feed systems, sitework, piping, structures, waste disposal to nearest sewer	\$103,191,000
Brine Disposal	Brine evaporator and crystallizer for zero liquid discharge	\$10,730,000
Purified Water Line	20-inch diameter; 26,330 linear feet	\$1,520,000
Purified Water Pump Station	250 horsepower	\$1,625,000
Potable system connection		\$100,000
Estimating Contingency	50% of raw construction costs	\$74,780,000
Implementation	40% of total construction costs	\$89,730,000
Total Capital Cost		\$314,060,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$11,073,000

The O&M cost of the project was estimated on a per AF basis for scalability. The PR-2 option has a fixed annual O&M cost of \$954,000 and an annual marginal O&M cost of approximately \$943/ AF. Annual O&M costs will vary depending on the production of the AWPf. It is assumed the AWPf could be turned

down to a production capacity of 30 percent during low demand periods. The estimated annual O&M costs for the maximum potential yield of 10,065 AFY is approximately \$10.4 million. **Table 3-12** summarizes the annual O&M costs for option PR-2.

Table 3-12: Preliminary Annual O&M Cost, Supply Option PR-2

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, and chemical addition	\$943/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing	\$954,000
Average cost of water (Baseline Scenario) ¹		\$3,900/ AF
Annual O&M (10,065 AFY) ²		\$10,443,000
Cost of water (10,065 AFY) ²		\$2,150/ AF
Annual O&M (3,019 AFY) ³		\$3,800,000
Cost of water (3,019 AFY) ³		\$5,000/ AF

Notes:


1. See Section 2.5 for description of baseline scenario, under which on average 4,131 AFY are produced. Costs include operating and capital.
2. The maximum supply yield of 10,065 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations because it would produce more water than the City would use, which causes the unit cost of water to appear artificially low.
3. The minimal yield of 3,019 AFY assumes 30 percent turndown of the AWPf’s maximum yield to provide a range of supply available for the PR options.

PR-3a: IPR AWPf at LTP, Ground Water Augmentation (GWA) via Delta Pond

Option PR-3a would convey the City’s tertiary effluent to an AWPf at LTP and return AWPf waste stream to the headworks at LTP. The AWPf would include treatment processes in compliance with regulations for GWR. The purified water would be conveyed to the City-owned Delta Pond, after the minimum retention time of 2-months in the groundwater aquifer, the recharged groundwater could then be extracted. The purified water would be injected into and later extracted from the groundwater aquifer via new ASR wells. The same capital cost assumptions for the GW-3 option were applied for the 12 new ASR wells. For this level of study, it was assumed the City would size the AWPf to meet its 9 MGD peak month supply needs .

As shown in **Figure 3-9**, the 9 MGD AWPf would be co-located at LTP and the purified water would be conveyed to the Delta Pond area through new conveyance infrastructure assuming use of the existing Geysers pipeline corridor/ easement.

Figure 3-9: Supply Option PR-3a

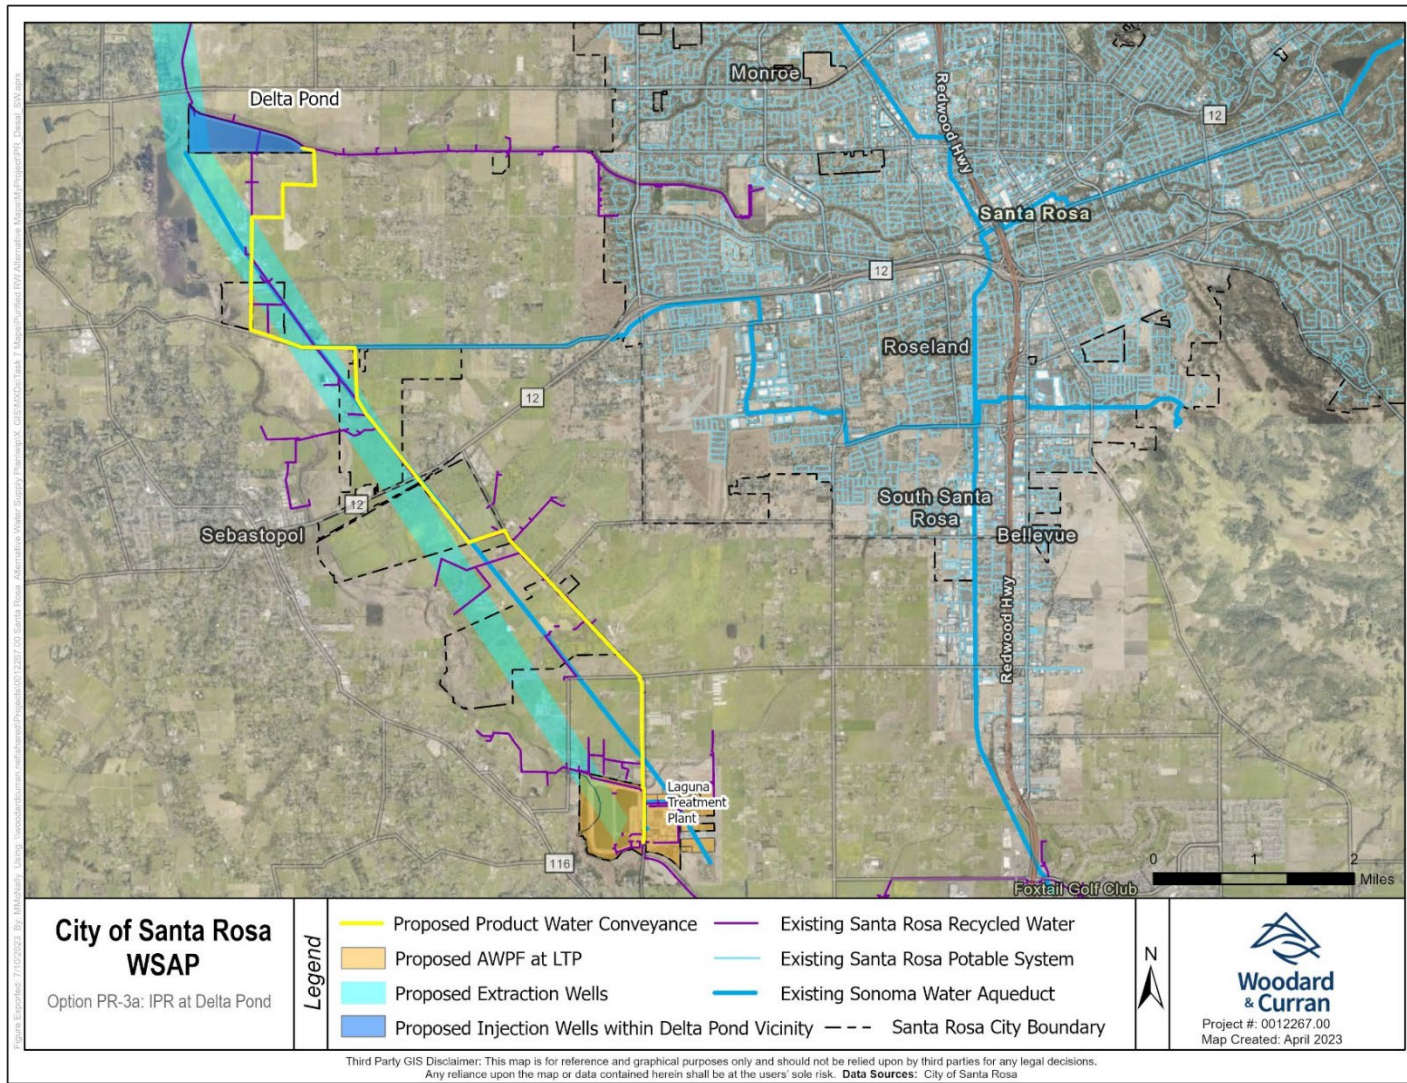

Components that would need to be constructed as part of PR-3a include:

- 24-inch tertiary water pipeline from LTP to AWPf
- 1.8 million gallon equalization basin
- AWPf to meet IPR GWA regulations, conventional FAT
 - MF System
 - RO System
 - UV/AOP
 - RO brine disposal system (Evaporator and Crystallizer)
 - Ancillary facilities
 - 8-inch AWPf waste disposal to LTP headworks
- 22-inch purified water pipeline
- 490 horsepower pump station to Delta Pond
- ASR wells

The total preliminary capital cost for option PR-3a, is approximately \$419 million. A summary of the PR-3a capital cost is shown in **Table 3-13**. Additional cost detail can be found in Appendix A.

Table 3-13: Preliminary Capital Cost, Supply Option PR-3a

Component	Description	Cost, \$2023
Equalization	1,820,000 gallon equalization basin	\$2,275,000
Tertiary Water Pipeline	24-inch diameter; assumed 500 linear feet	\$445,000
9 MGD IPR AWPf	UF, RO, chemical storage and feed systems, sitework, piping, structures, waste disposal to headworks	\$89,390,000
Brine Disposal	Brine evaporator and crystallizer for zero liquid discharge	\$10,760,000
Purified Water Line to Delta Pond	22-inch diameter; 41,220 linear feet	\$33,628,700
Purified Water Pump Station	490 horsepower	\$3,185,000
New Well Construction	12 ASR wells (injection/ extraction) wells, 500 gpm capacity, 500 feet deep, well head, casing, well pump and equipment (\$5 million/ well)	\$60,000,000
Estimating Contingency	50% of raw construction costs	\$99,840,000
Implementation	40% of total construction costs	\$119,810,000
Total Capital Cost		\$419,330,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$14,785,000

The O&M cost of the project was estimated on a per AF basis for scalability. The PR-3a option has a fixed annual O&M cost of \$1,069,000 and an annual marginal O&M cost of approximately \$936/ AF. Annual O&M costs will vary depending on the production of the AWPf. It is assumed the AWPf could be turned down to a production capacity of 30 percent during low demand periods. The estimated annual O&M costs for the maximum potential yield of 10,065 AFY is approximately \$12.7 million. **Table 3-14** summarizes the annual O&M costs for option PR-3a.

Table 3-14: Preliminary Annual O&M Cost, Supply Option PR-3a

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, and chemical addition	\$936/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing	\$1,069,000
Average cost of water (Baseline Scenario) ¹		\$4,800/AF
Annual O&M (10,065 AFY) ²		\$12,700,000
Cost of water (10,065 AFY) ²		\$2,730/AF
Annual O&M (3,019 AFY) ³		\$4,558,000
Cost of water (3,019 AFY) ³		\$6,400/AF

Notes:

1. See Section 2.5 for description of baseline scenario, under which on average 4,131 AFY of water would be produced. Costs include capital and operating.
2. The maximum supply yield of 10,065 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations.
3. The minimal yield of 3,019 AFY assumes 30 percent turndown of the AWPf’s maximum yield to provide a range of supply available for the PR options.

PR-3b: IPR AWPf at LTP, SWA via Lake Ralphine

Option PR-3b would convey the City’s tertiary effluent to an AWPf at LTP and return AWPf waste stream to the headworks at LTP. The AWPf would include treatment processes in compliance with regulations for SWA. After preliminary retention calculations it was determined that Lake Ralphine would not provide the minimum required 2-month retention time to quality as IPR per California regulations. Therefore, option PR-3b would qualify as a DPR and would likely yield a project similar to the PR-1 option described above. Therefore, this supply option was not carried forward for detailed cost analysis or feasibility scoring.

PR-3c: IPR AWPf at LTP, SWA via Lake Sonoma

Option PR-3c would convey the City’s tertiary effluent to an AWPf at LTP and return AWPf waste stream to the headworks at LTP. The AWPf would include treatment processes in compliance with regulations for SWA. The purified water would be conveyed to Lake Sonoma through a new purified water line assuming the existing Geysers pipeline corridor/ easement and extending to Lake Sonoma as shown in **Figure 3-10**.

For this level of study, it was assumed the City would size the AWPf to meet its 9 MGD peak month supply needs


The AWPf would be located at LTP, and the purified water would be conveyed to Lake Sonoma through new conveyance infrastructure. Water would be withdrawn from Lake Sonoma using Sonoma Water's existing infrastructure.

Components that would need to be constructed as part of option PR-3c include:

- 24-inch tertiary water pipeline from LTP to AWPf
- 1.8 million gallon equalization basin
- AWPf to meet IPR GWA regulations, conventional FAT
 - MF system
 - RO system
 - UV/AOP
 - RO brine disposal system (Evaporator and Crystallizer)
 - Ancillary facilities
 - 8-inch AWPf waste disposal to LTP headworks
- 22-inch purified water pipeline
- 2,600 horsepower pump station to Lake Sonoma

This option incorporates some assumptions that would need to be vetted and refined if the option were implemented. Among them is an assumption that sufficient space exists in Lake Sonoma, and that withdrawing the water from Lake Sonoma could be done with existing infrastructure. Both of these issues would likely add cost and-or reduce yield to the option. However, given the very high cost of the option even without those burdens, the issues were not fully explored in the current study.

Figure 3-10: Supply Option PR-3c

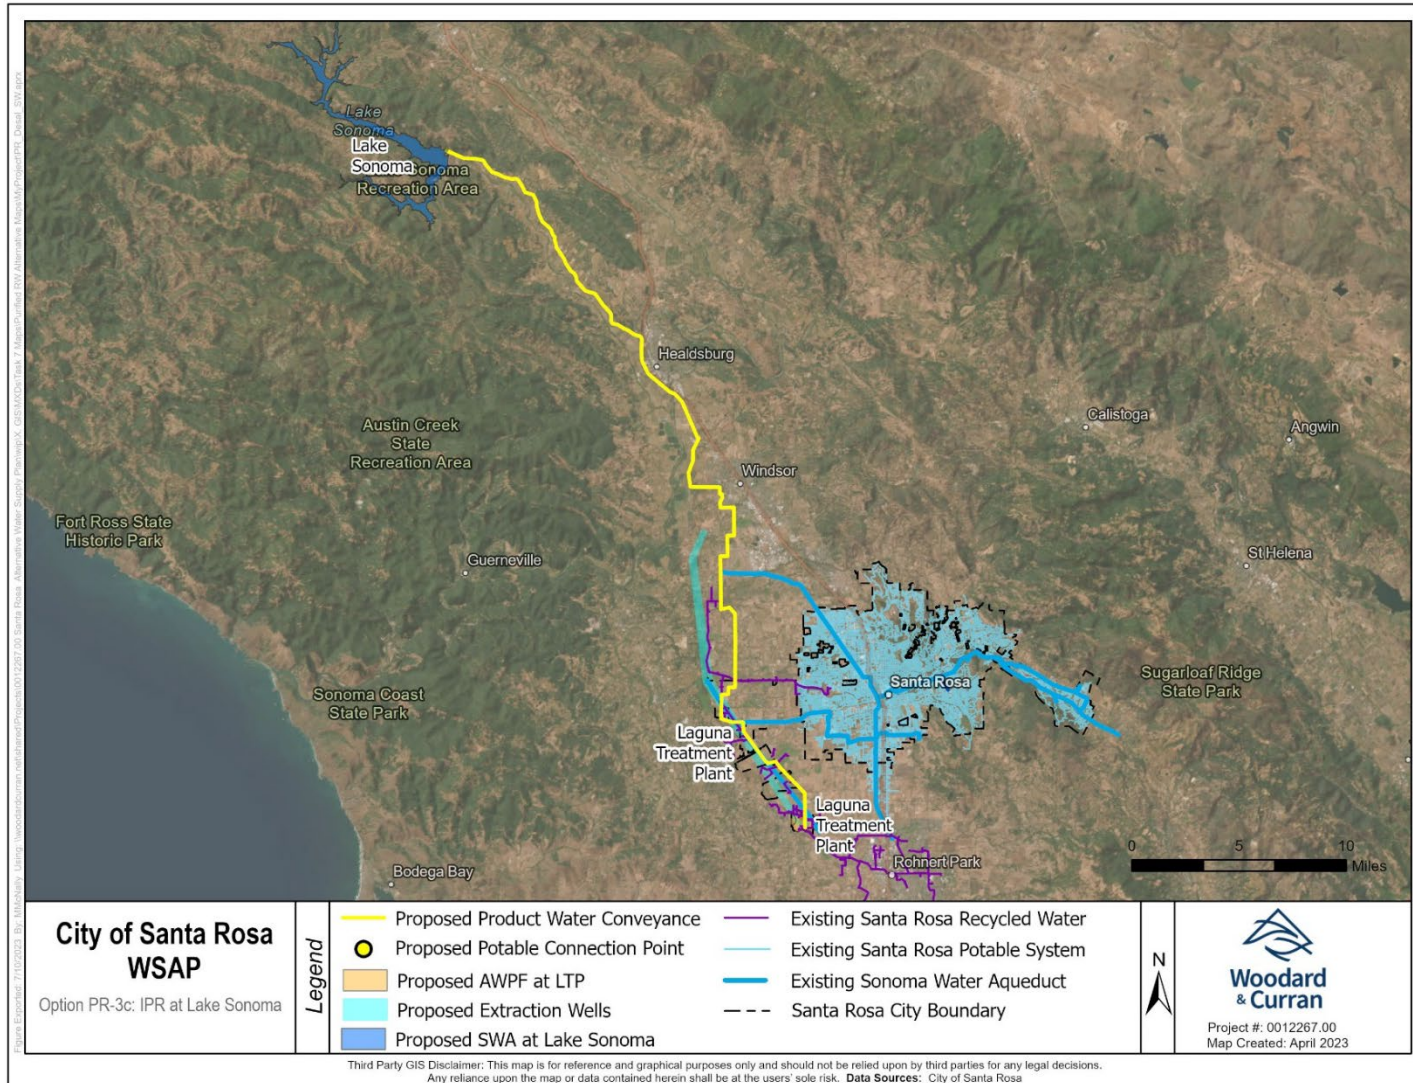

The total preliminary capital cost for option PR-3c is approximately \$650 million. A summary of the PR-3c capital cost is shown in **Table 3-15**. Additional cost detail can be found in Appendix A.

Table 3-15: Preliminary Capital Cost, Supply Option PR-3c

Component	Description	Cost, \$2023
Equalization	1,820,000 gallon equalization basin	\$2,275,000
Tertiary Water Pipeline	24-inch diameter; assumed 500 linear feet	\$445,000
9 MGD IPR AWPF	UF, RO, chemical storage and feed systems, sitework, piping, structures, waste disposal to headworks	\$89,390,000
Brine Disposal	Brine evaporator and crystallizer for zero liquid discharge	\$10,760,000
Purified Water Line to Lake Sonoma	22-inch diameter; 181,300 linear feet	\$147,910,600
Purified Water Pump Station	2,600 horsepower	\$16,900,000
Estimating Contingency	50% of raw construction costs	\$133,840,000
Implementation	40% of total construction costs	\$160,610,000
Total Capital Cost		\$562,130,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$19,800,000

The O&M cost of the project was estimated on a per AF basis for scalability. The PR-3c option has a fixed annual O&M cost of \$1,790,000 and an annual marginal O&M cost of approximately \$1,200/ AF. Annual O&M costs will vary depending on the production of the AWPF. It is assumed the AWPF could be turned down to a production capacity of 30 percent during low demand periods. The estimated annual O&M costs for the maximum potential yield of 10,065 AFY is approximately \$15.9 million. **Table 3-16** summarizes the annual O&M costs for option PR-3c.

Table 3-16: Preliminary Annual O&M Cost, Supply Option PR-3c

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, and chemical addition	\$1,200/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing	\$1,786,000
Average cost of water (Baseline Scenario) ¹		\$6,430/AF
Annual O&M (10,065 AFY) ²		\$13,870,000
Cost of water (10,065 AFY) ²		\$3,350/ AF
Annual O&M (4,131 AFY) ³		\$6,319,000
Cost of water (4,131 AFY) ³		\$6,430/AF

Notes:


1. See Section 2.5 for description of baseline scenario, under which on average 4,131 AFY would be produced. Operating and capital costs are included.
2. The maximum supply yield of 10,065 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations.
3. The minimal yield of 3,019 AFY assumes 30 percent turndown of the AWPf’s maximum yield to provide a range of supply available for the PR options.

PR-4: Regional DPR AWPf at LTP

Similar to Option PR-1, PR-4 would convey the City’s tertiary effluent to an AWPf located at the LTP and return AWPf waste stream to the LTP headworks. The AWPf would include treatment processes in compliance with future anticipated regulations for TWA. The purified water would be conveyed to Sonoma Water’s 48-inch diameter aqueduct for regional distribution, as shown in **Figure 3-11**.

Under the PR-4 project concept, the purified water could be delivered to another party rather than used directly by the City, and a paper exchange could be completed whereby the City receives water in return. The paper exchange option would not reduce reliance on the Sonoma Water system overall.

Figure 3-11: Supply Option PR-4

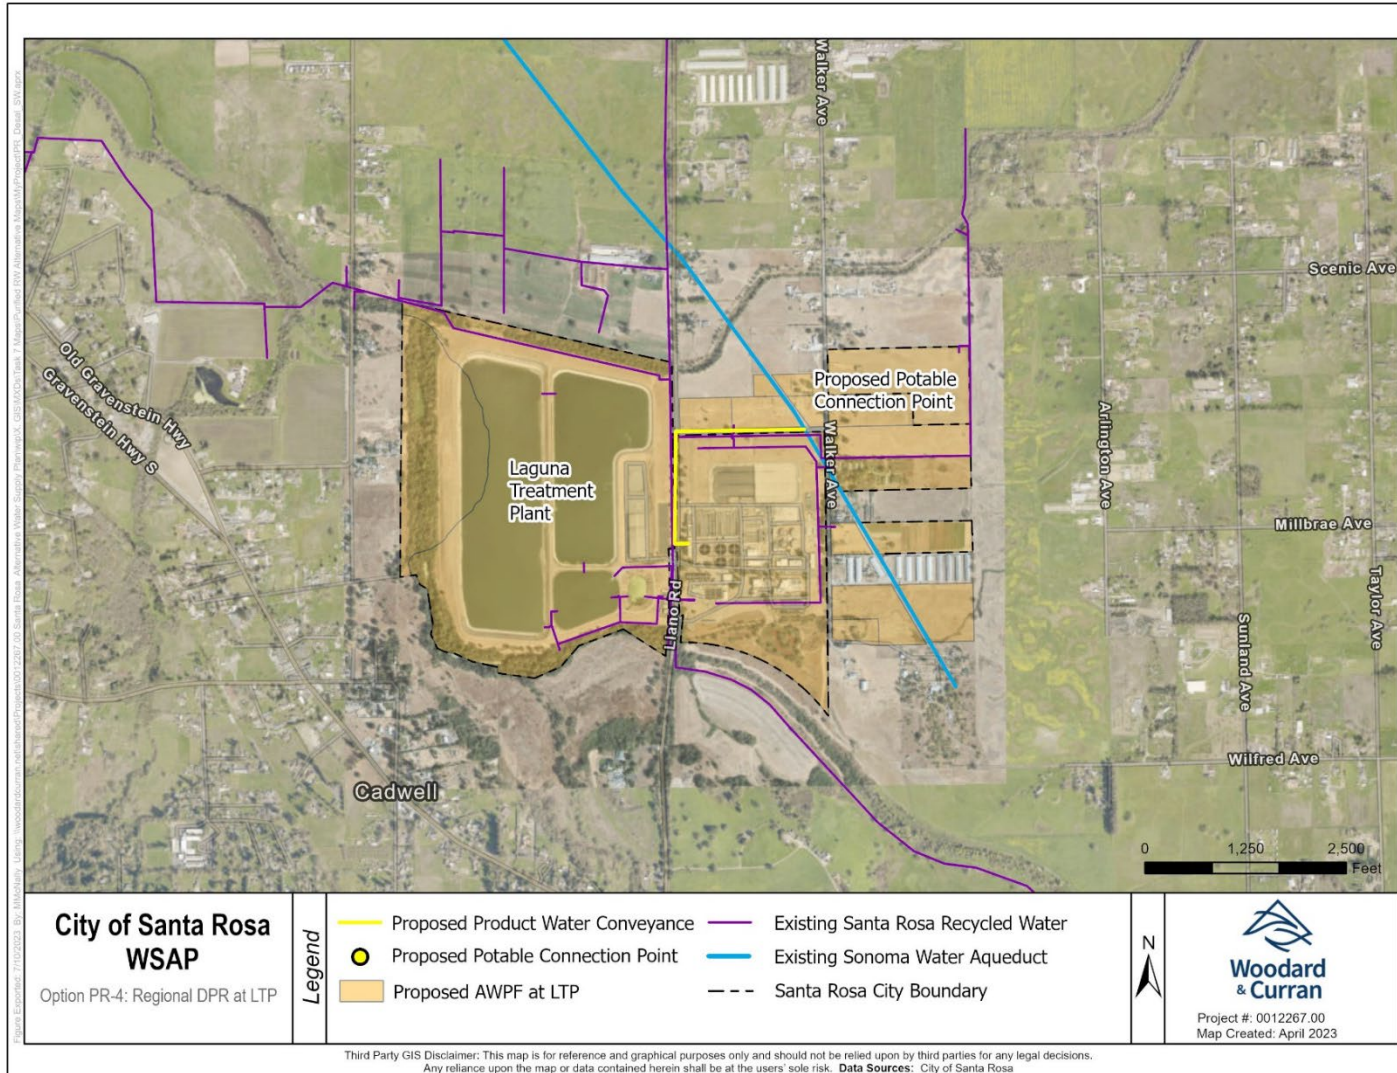

Components that would need to be constructed as part of PR-4 include:

- 24-inch tertiary water pipeline from LTP to AWWPF
- 1.8 million gallon equalization basin
- AWWPF to meet anticipated DPR regulations, conventional FAT plus ozone/ BAC
 - Ozone/BAC
 - MF System
 - RO System
 - UV/AOP
 - RO brine disposal system (Evaporator and Crystallizer)
 - Ancillary facilities
- 20-inch product water pipeline and pump station to potable connection point
- Potable connection infrastructure

The total preliminary capital cost for option PR-4, including all infrastructure listed, is approximately \$247 million. A summary of the PR-4 capital cost is shown in **Table 3-17**. Additional cost detail can be found in Appendix A.

Table 3-17: Preliminary Capital Cost, Supply Option PR-4

Component	Description	Cost, \$2023
Equalization	1,820,000 gallon equalization basin prior to feeding AWWPF	\$2,275,000
Tertiary Water Pipeline	24-inch diameter; assumed 500 linear feet	\$445,000
9 MGD DPR AWWPF	Ozone, BAF, UF, RO, chemical storage and feed systems, sitework, piping, structures, waste disposal to headworks	\$100,659,000
Brine Disposal	Brine evaporator and crystallizer for zero liquid discharge	\$10,730,000
Purified Water Line	20-inch diameter; 2,200 linear feet	\$1,631,700
Purified Water Pump Station	270 horsepower	\$1,755,000
Potable system connection		\$100,000
Estimating Contingency	50% of raw construction costs	\$58,800,000
Implementation	40% of total construction costs	\$70,560,000
Total Capital Cost		\$246,960,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$8,707,000

The O&M cost of the project was estimated on a per AF basis for scalability. The PR-4 option has a fixed annual O&M cost of \$714,000 and an annual marginal O&M cost of approximately \$885/ AF. Annual O&M costs will vary depending on the production of the AWWPF. It is assumed the AWWPF could be turned down to a production capacity of 30 percent during low demand periods. The estimated annual O&M

costs for the maximum potential yield of 10,065 AFY is approximately \$9.6 million. **Table 3-18** summarizes the annual O&M costs for option PR-4.

Table 3-18: Preliminary Annual O&M Cost, Supply Option PR-4

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, and chemical addition	\$885/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing	\$714,000
Average cost of water (Baseline Scenario) ¹		\$3,200/AF
Annual O&M (10,065 AFY)		\$9,625,000
Cost of water (10,065 AFY)		\$1,850/ AF
Annual O&M (3,019 AFY)		\$3,387,000
Cost of water (3,019 AFY)		\$4,000/ AF

Notes:

1. See Section 2.5 for description of baseline scenario, under which an average of 4,131 AFY would be produced. Operating and capital costs are included.
2. The maximum supply yield of 10,065 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations because it would produce more water than the City would use, which causes the unit cost of water to appear artificially low.
3. The minimal yield of 3,019 AFY assumes 30 percent turndown of the AWPf’s maximum yield to provide a range of supply available for the PR options.

The costs presented for PR-4 would represent the total cost of the supply option. Were a regional partner to be identified, the costs would be distributed between the City and its partner(s), and the City presumably would not bear the entire project cost.

3.1.3 Non-Potable Recycled Water Option

As discussed in Section 3.1.2, the City is responsible for the operation and management of the Regional System. The Regional System operates the LTP, oversees the Industrial Pretreatment Program, and operates and maintains the recycled water system for more than 225,000 residents and 6,500 businesses for the Cities of Cotati, Rohnert Park, Santa Rosa, and Sebastopol, and the South Park Sanitation District and portions of unincorporated Sonoma County. As managing partner of the Regional System, the City is responsible for operating the system economically and safely and for planning for future regulatory changes and growth.

RW-1: Recycled Water System Expansion

Option RW-1 would increase the amount of urban reuse within Santa Rosa, Cotati, and Rohnert Park supplied by recycled water. The Santa Rosa Urban Reuse Project Feasibility Study identified the following phases, each with a capacity of 250 MGY (City of Santa Rosa, 2007). The total expansion would yield an additional 3,000 AFY for distribution. The four phases of the expansion are:

- Phase 1 West: pipelines generally located in northwest Santa Rosa extending from either the west transmission main or the West College Facility. Diurnal storage may be included in Phase 1 West and would be located between elevation 300 and 400 feet in the Fountaingrove area.
- Phase 1 South: pipelines generally located in southeast Santa Rosa extending from the south transmission main. Diurnal storage may be included in Phase 1 South and would be located between elevation 300 and 400 feet within the Santa Rosa Urban Growth Boundary or in the southeast of Santa Rosa area.
- Phase 2 South: pipelines extending from the Phase 1 South system into southwest Santa Rosa. Connections between the south and west system may be made during this phase. Diurnal storage may be included in Phase 2 South and would be located between elevation 300 and 400 feet or at lower elevations in northwest Rohnert Park or west of Cotati.
- Phase 2 West: pipelines extending from the Phase 1 West system to interconnect with the south system. Diurnal storage may be included in Phase 2 West and would be located between elevation 300 and 400 feet or at lower elevations near the Geysers pipeline or east of Rohnert Park.

The total preliminary capital cost for option RW-1, escalated from the Santa Rosa Urban Reuse Project Feasibility Study in 2006 to 2023 dollars is approximately \$214 million. The O&M cost of the project was estimated at \$1.3M/year by prorating based on the City's FY2020- 2021 Wastewater Resource Distribution Expenditure. The average cost of water for the Baseline Scenario (see **Section 2.5**) is approximately \$8,800/ AF. Expanding use of recycled water would not provide a new source of potable drinking water for severe water shortages or emergencies (irrigation would be significantly restricted or banned).

3.1.4 Desalinated Water Supply Options

Marin Municipal Water District (Marin Water) is also considering alternatives for supplemental water supplies with the City of Petaluma, garnering potential for regional partnerships between Marin Water, Petaluma, and the City. The City's service area is too far from saline water sources and the local groundwater supply does not require desalination. Alternative water supplies Marin Water is currently evaluating include a potential temporary or long-term seawater desalination facility (using brackish bay water) or a brackish groundwater desalination facility. This section evaluated a partnership between Marin Water and the City for a regional brackish bay water desalination facility and the concept of the City's own ocean desalination facility.

DE-1: Regional Brackish Water Desalination

Option DE-1 would allow the City and Marin Water to partner in constructing a desalination facility to augment Marin Water's local water supply and the City's Sonoma Water supply via water transfers. A full-scale facility could have an initial capacity of 5 MGD or 10 MGD and be expandable up to 15 MGD. The full-scale facility could be located at the Marin Water Pelican Way Site in San Rafael as shown in **Figure 3-12**. The screened intake would be offshore with an on-shore pump station near the Marin Water Pelican Way Site. The bay water intake would include passive screens. The intake screens would be connected to an onshore wet well and pump station via an HDPE pipeline on and under the bay floor. The intake pump station would deliver raw water to the treatment facilities located at either or both the maintenance yard and parking lot sites. The 15 MGD long-term full-scale desalination facilities require approximately 6.5 acres of space. Treated water from the desalination facilities would be delivered to the Marin Water distribution system in San Rafael.

Provided that the desalination facility would be within the jurisdiction of Marin Water, a paper exchange could be completed where the City receives 9 MGD of Marin Water’s Sonoma Water allocation, and the desalinated water is used directly by Marin Water. Since the Sonoma Water aqueduct would be an integral component of operations, the paper exchange option would not reduce reliance on the Sonoma Water system overall, but it would reduce overall reliance on the Russian River.

The City’s total preliminary capital cost for option DE-1 is approximately \$181 million. A summary of the DE-1 capital cost is shown in **Table 3-19**. Additional cost detail can be found in Appendix A.

Table 3-19: Preliminary Capital Cost, Supply Option DE-1

Component	Description	City Cost, \$2023
Brackish Water Intake	Intake Screens, Pipeline and Pumps, Raw Water Pipe to facility	\$8,178,000
Desalination Plant	Rapid Mix Strainers, UF and Building, Filtrate and Backwash Supply Tanks, RO Feed Pump Station, 1st pass RO and Building, Permeate Tank, Chlorine Contact Tank, Chemical Facilities, Backwash Equalization Basin, Gravity Thickener, Centrifuges, O&M Building, Sitework/Piping, Electrical, Instrumentation and Controls	\$71,559,000
Brine Disposal	Brine Pump Station, Brine Transmission Line	\$3,444,000
Distribution	Distribution Booster Pumps, Treated Water Line	\$2,899,200
Estimating Contingency	50% of raw construction costs	\$43,040,000
Implementation	40% of total construction costs	\$51,650,000
Total Capital Cost		\$180,770,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$6,374,000

The O&M cost of the project was estimated on a per AF basis for scalability. The DE-1 option has a fixed annual O&M cost of \$909,000 and an annual marginal O&M cost of approximately \$401/ AF. Annual O&M costs will vary depending on the production of the desalination facility. It is assumed the desal facility could be turned down to a production capacity of 30 percent during low demand periods. The estimated annual O&M costs for the maximum potential yield of 10,080 AFY is approximately \$5 million. **Table 3-20** summarizes the City’s portion of the estimated annual O&M costs for option DE-1.


Table 3-20: Preliminary Annual O&M Cost, Supply Option DE-1

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, and chemical addition	\$401/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing	\$909,000
Average cost of water (Baseline Scenario) ¹		\$2,041/AF
Annual O&M (10,080 AFY) ²		\$4,954,000
Cost of water (10,080 AFY) ²		\$1,200/ AF
Annual O&M (3,360 AFY) ³		\$2,005,000
Cost of water (3,360 AFY) ³		\$2,500/ AF

Notes:

1. See Section 2.5 for description of baseline scenario, under which an average of 4,441 AFY would be produced. Capital and operating costs are included.
2. The maximum supply yield of 10,080 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations.
3. The minimal yield of 3,360 AFY assumes 30 percent turndown of the desalination plant’s maximum yield to provide a range of supply available for the DE options.

Figure 3-12: Supply Option DE-1

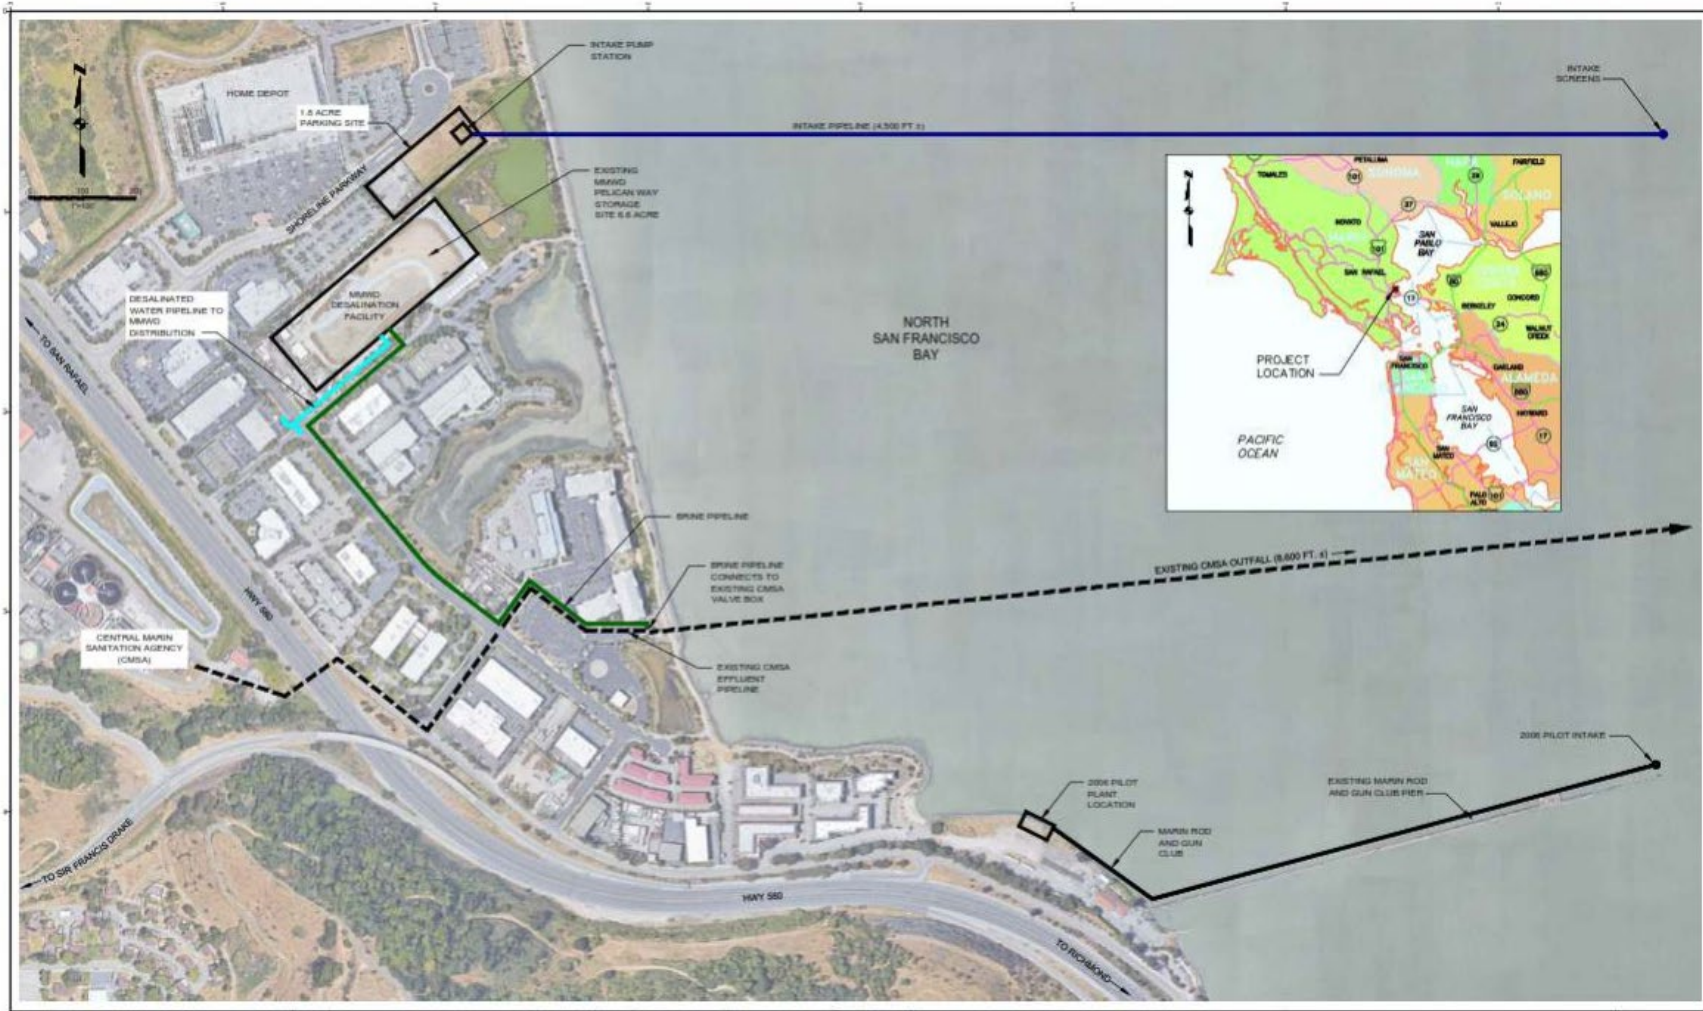

Source: Marin Water Desalination Supply Study Draft Technical Memorandum (Marin Municipal Water District, 2021)


DE-2: Ocean Desalination

Option DE-2 would construct a seawater desalination facility to increase the City's local water supply. The desalination facility would be sized to produce 9 MGD to meet the City's peak month demands. The screened intake would be offshore with an onshore pump station near the desalination site. For costing purposes only, a general location for ocean desalination option was estimated. For purposes of this study, the conceptual full-scale facility was assumed to be located offshore along Bodega Bay as shown in **Figure 3-13**. A full siting study would be required to determine the most feasible and optimal location for the seawater desalination facility if brought forward through the screening process.

Components that would need to be constructed for DE-2 include:

- The 9 MGD desalination facilities:
 - Intake Screens, Pipeline and Pumps
 - Raw Water Pipe to facility
 - Rapid Mix Strainers
 - UF System including Filtrate and Backwash Supply Tanks
 - RO Feed Pump Station
 - RO System and permeate tank
 - Chlorine Contact Tank
 - Chemical Facilities
 - Backwash Equalization Basin
 - Gravity Thickener
 - Centrifuges
 - Ancillary facilities
- Brine disposal
 - 290 horsepower pump station
 - 24-inch Brine Transmission Line
- Potable Water Distribution
 - 1,880 horsepower pump station
 - 24-inch potable water pipeline

Figure 3-13: Supply Option DE-2

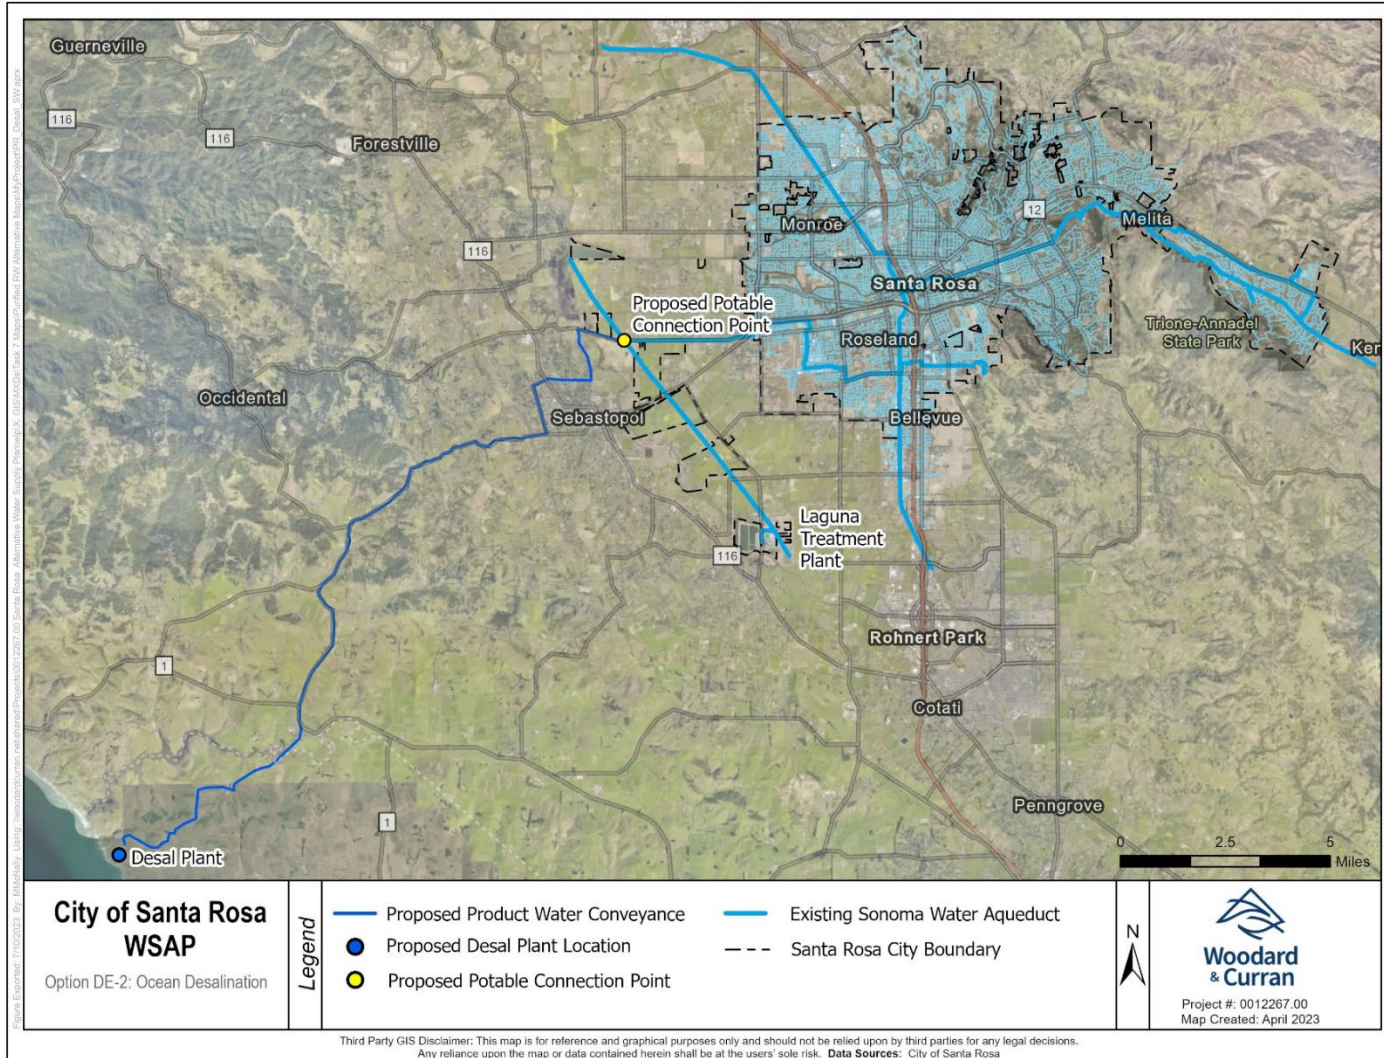

The capital cost estimate for option DE-2 is also based on a recent draft cost estimate from the 2021 Marin Water Desalination Supply Study (Marin Municipal Water District, 2021). The total preliminary capital cost for option DE-2 is approximately \$378 million. A summary of the DE-2 capital cost is shown in **Table 3-21**. Additional cost details can be found in Appendix A.

Table 3-21: Preliminary Capital Cost, Supply Option DE-2

Component	Description	City Cost, \$2023
Seawater Intake	Intake Screens, Pipeline and Pumps 30-inch; 2,000 linear feet Raw Water Pipe to facility	\$10,167,000
Desalination Plant	Rapid Mix Strainers, UF and Building, Filtrate and Backwash Supply Tanks, RO Feed Pump Station, 1st pass RO and Building, Permeate Tank, Chlorine Contact Tank, Chemical Facilities, Backwash Equalization Basin, Gravity Thickener, Centrifuges, O&M Building, Sitework/Piping, Electrical, Instrumentation and Controls	\$71,560,000
Brine Disposal	290 horsepower Brine Pump Station 24-inch; 2,000 linear feet Brine Transmission Line	\$3,665,000
Distribution	1,880 horsepower Distribution Pump Station 24-inch; 92,600 linear feet Treated Water Line	\$94,634,000
Estimating Contingency	50% of raw construction costs	\$90,020,000
Implementation	40% of total construction costs	\$108,020,000
Total Capital Cost		\$378,070,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	\$13,330,000

The O&M cost of the project was estimated on a per AF basis for scalability. The DE-2 option has a fixed annual O&M cost of \$1,604,000 and an annual marginal O&M cost of approximately \$1,165/ AF. Annual O&M costs will vary depending on the production of the desalination facility. It is assumed the desal facility could be turned down to a production capacity of 30 percent during low demand periods. The estimated annual O&M costs for the maximum potential yield of 10,080 AFY is approximately \$13.3 million. **Table 3-22** summarizes the City’s portion of the estimated annual O&M costs for option DE-2.

Table 3-22: Preliminary Annual O&M Cost, Supply Option DE-2

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, and chemical addition	\$1,165/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing	\$1,604,000
Average cost of water (Baseline Scenario) ¹		\$4,500/ AF
Annual O&M (10,080 AFY) ²		\$13,330,000
Cost of water (10,080 AFY) ²		\$2,700/ AF
Annual O&M (3,360 AFY) ³		\$5,520,000
Cost of water (3,360 AFY) ³		\$5,600/ AF

Notes:

1. See Section 2.5 for description of baseline scenario, under which an average of 4,441 AFY would be produced. Capital and operating costs are included.
2. The maximum supply yield of 10,080 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations.
3. The minimal yield of 3,360 AFY assumes 30 percent turndown of the desalination plant’s maximum yield to provide a range of supply available for the desalination options.


3.1.5 Stormwater Capture Options

SW-1: Capture Excess Winter Flows in Aquifer Storage

Option SW-1 proposes to construct a diversion structure within Santa Rosa Creek to divert excess winter flows to new spreading basins (it may be determined after future investigations that injection wells will be required for groundwater recharge) for storage within the Santa Rosa aquifer to increase the City’s local water supply. The diversion location for this study was assumed to be within Santa Rosa Creek near the existing USGS stream gage 11466320 due to its proximity to Delta Pond for potential storage prior to aquifer recharge via proposed spreading basins in the vicinity (see **Figure 3-14**). For the 9 MGD supply, 12 new extraction wells would be required. The same assumptions for the GW-1 option were applied for the proposed extraction wells.

A preliminary stream gage analysis was performed to determine the allowable diversion volume from Santa Rosa Creek. The allowable stream diversion period lies within the months of December through March. This level of analysis assumed that all flows above the 90th percentile of stormwater volume within the creek can be diverted unless the diversion amount is greater than 20 percent of the day’s flow (in which case, this analysis capped the diversion volume at 20 percent of that day’s flow). Based on dry year data from 1999 to 2023, the allowable diversion volume between the months of December through March can range from 1,200 to 212,640 AF. For purposes of the current study, it was assumed that adequate volumes are available on average to support the maximum annual usage of 7,500 AFY, accounting for the need to withdraw less than the amount recharged, and that sufficient aquifer storage exists to buffer intra-year and inter-year supply variations.

Figure 3-14: Supply Option SW-1

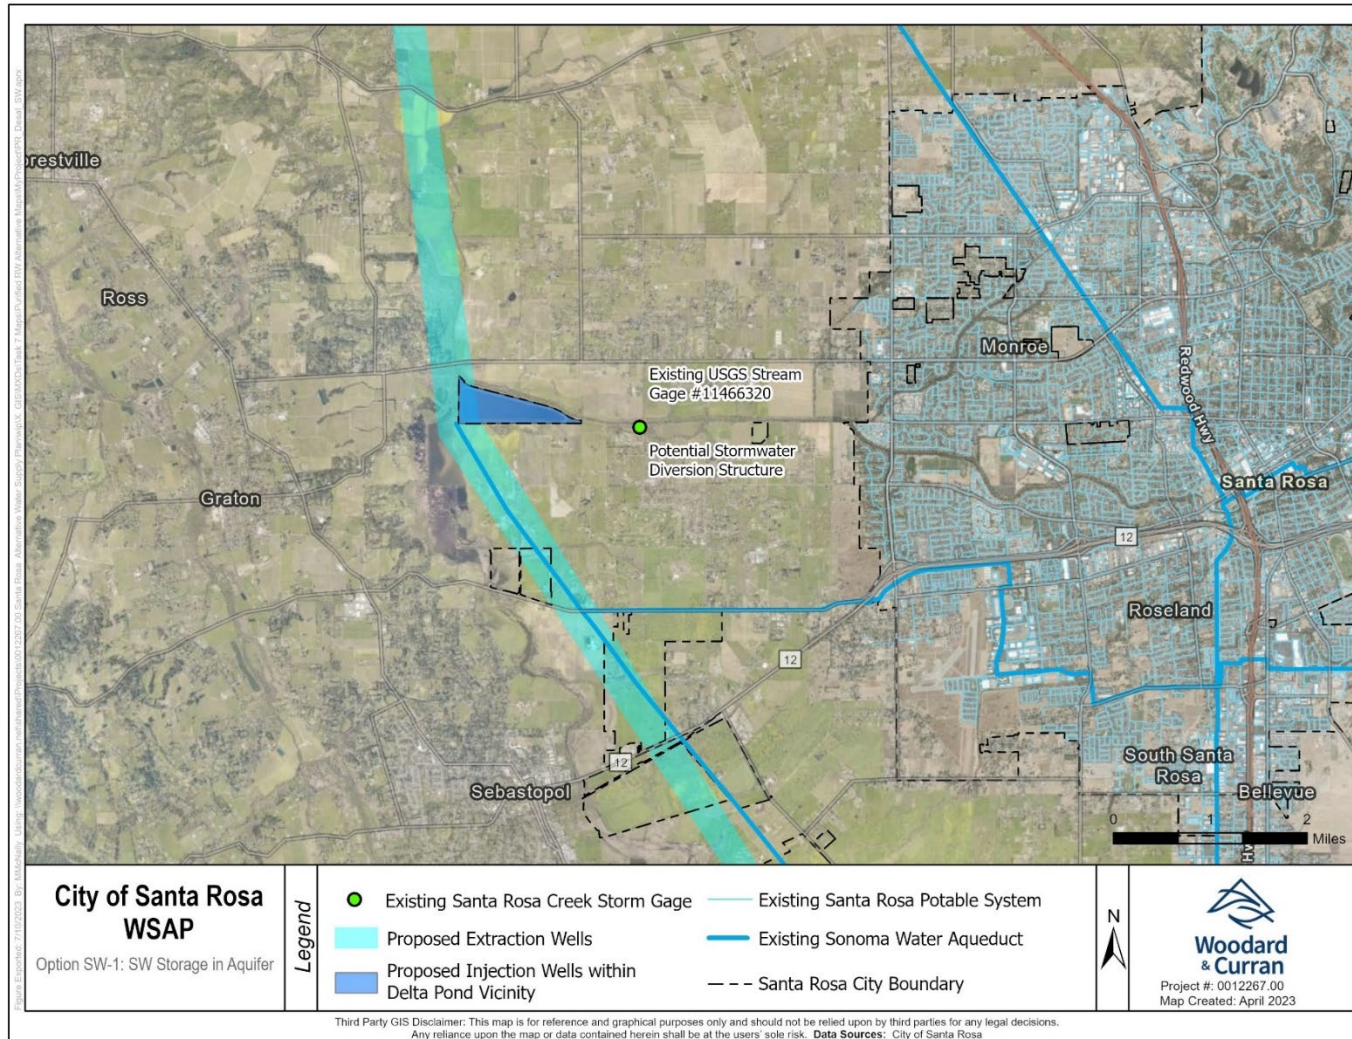

Components that would need to be constructed as part of option SW-1 include:

- Stormwater diversion structure including pumps, pipes
- Spreading basins in the Delta Pond vicinity
- 12 new extraction wells and conveyance
- Treatment plant providing conventional treatment (coagulation, flocculation, sedimentation, filtration); this is a conservative assumption and would need further exploration if the alternative were carried forward.

The total preliminary capital cost for option SW-1 is approximately \$223million. A summary of the SW-1 capital cost is shown in **Table 3-23**. Additional cost details can be found in Appendix A.

Table 3-23: Preliminary Capital Cost, Supply Option SW-1

Component	Description	Cost, \$2023
Santa Rosa Creek Diversion	Diversion Structure, including pumps, spreading basins	\$18,144,000
New Well Construction	12 extraction wells, 500 gpm capacity, 500 feet deep, well head, casing, well pump and equipment	\$42,000,000
Treatment to Stormwater Prior to Recharge	9 MGD conventional treatment plant	\$42,000,000
Groundwater Conveyance	20-inch; 3,000 linear feet	\$2,225,000
Groundwater Pump Station	240 horsepower	\$1,560,000
Potable Connection		\$100,000
Estimating Contingency	50% of raw construction costs	\$52,980,000
Implementation	40% of total construction costs	\$38,420,000
Total Capital Cost		\$222,500,000
Annualized Capital Cost	Annualized over 50 years, 2.5% interest	4,741,000

The O&M cost of the project was estimated on a per AF basis for scalability. The SW-1 option has a fixed annual O&M cost of \$542,000 and an annual marginal O&M cost of approximately \$303/ AF. Annual O&M costs will vary depending on the amount of water diverted from Santa Rosa Creek during winter. The estimated annual O&M costs for the maximum potential yield of 10,080 AFY is approximately \$3.6 million. Table 3-24 summarizes the estimated annual O&M costs for option SW-1.

Table 3-24: Preliminary Annual O&M Cost, Supply Option SW-1

Component	Description	Cost, \$2023
Marginal Cost	Marginal costs include power consumption, labor, and chemical addition	\$303/ AF
Fixed Cost	Fixed costs include routine maintenance practices, water quality testing	\$542,000
Average cost of water (Baseline Scenario) ¹		\$3,500/ AF
Annual O&M (10,080 AFY) ²		\$3,600,000
Cost of water (10,080 AFY) ²		\$1,135/ AF

Notes:

1. See Section 2.5 for description of baseline scenario, under which on average 2,600 AFY are produced. Costs include capital and operating.

This baseline estimate of usage is uncertain as it would depend on adequate stormwater being captured and banked to support that level of usage. If this alternative were to be further developed, more detailed modeling would need to be performed.

2. The maximum supply yield of 10,080 AFY assumes 24/7 operation of all supply option infrastructure. This scenario may not reflect realistic operations. This is particularly true for this option, since its operation would be subject to a host of unknowns including hydrologic variations on the intra-seasonal and inter-seasonal timescales that would affect supply availability. Some of those variations, e.g., low stormwater availability, could be temporally correlated with Russian River droughts, thus limiting supplemental supply when it is most needed.

SW-2: Capture Excess Winter Flows in Surface Storage (Lake Ralphine or Alternate)

This option explored the possibility of capturing excess winter stormwater flows for surface storage. The City does not currently have unused surface storage. Lake Ralphine holds slightly under 500 AF and served as a historical water supply source for the City (through the late 1950's) and is currently used for recreation. A review of prior City planning work and City water systems and topography did not yield any alternative surface water sites for further exploration.

In order to store surface water in Lake Ralphine, the existing dam would need to be raised, which would displace the existing recreational areas (picnic areas, ball fields, etc.), which are highly valued by the community and City. The size of a potential reservoir would be limited due to surrounding topography and presence of residential neighborhoods surrounding the reservoir. Even an enlarged Lake Ralphine would likely fill naturally during wet periods, limiting its utility for providing additional stormwater storage in wet months. Furthermore, Lake Ralphine is not used for drinking water supply, meaning that a new water treatment plant would need to be constructed in order to use Lake Ralphine for drinking water supply. Given that enlarging Lake Ralphine would not provide a large water storage benefit and would have substantial financial and social costs (requiring a new treatment plant, impacting City recreational facilities), this supply option did not advance to undergo cost estimation.

SW-3: Regional Stormwater

Supply option SW-3 proposes developing a regional stormwater project in collaboration with one or more agencies in the region. There are several regional stormwater programs underway that could be bolstered with City partnership and/or used to generate new ideas for a regional project. One such example is a project being explored by North Marin Water District which involves diverting stormwater into Stafford Lake. More information about regional efforts is included in the following plans:

Marin Municipal Water District

- Water Resiliency projects: <https://www.marinwater.org/WaterSupplyResiliency>

North Marin Water District

- Local Water Supply Enhancement Study <https://nmwd.com/save-water/new-water-supplies/>

Petaluma

- Integrated Water Master Plan <https://cityofpetaluma.org/iwmp/>

Sonoma Water

- Drought Resiliency Project <https://www.sonomawater.org/DroughtResiliency>
- Regional Water Supply Resiliency Study
 - Presentation slides, May 1, 2023
https://www.sonomawater.org/media/PDF/About/WAC/2023_05/Item%207%20-%202023%20Resiliency%20Update.pdf
 - Presentation slides, May 2, 2023
https://www.sonomawater.org/media/PDF/About/WAC/2022_05/7.1.%20SonomaWater_ResiliencyStudy%20WAC%20Update_2022_0502.pdf
 - Report: Accelerated 2021-2022 Drought Resiliency Analysis, April 27, 2022
https://www.sonomawater.org/media/PDF/About/WAC/2022_05/7.2.%20Sonoma%20Water%20Resiliency%20Study%20-%20Drought%20Analysis%20TM%20FINAL%20DRAFT.pdf
 - Presentation slides, Drought Options Update, Feb 7, 2023
https://www.sonomawater.org/media/PDF/About/WAC/2022_02/12.%20SonomaWater_ResiliencyStudy_WAC_Update_2022_0207_REDUCED.pdf
 - Presentation slides, Nov 1, 2021
https://www.sonomawater.org/media/PDF/About/WAC/2021_11/Presentation-%20Sonoma%20Water%20Resiliency%20Study.pdf
 - Memo, July 29, 2021
https://www.sonomawater.org/media/PDF/About/WAC/2021_08/9.%20SRP%20Drought%20Resiliency%20Project%20WACTAC%20memo.pdf

San Francisco Estuary Institute

- [Laguna de Santa Rosa restoration master plan](#)

Implementation of this supply option would require identification of feasible detention storage and recharge locations, regional coordination and agreements, and possible need for additional water rights. Because many project elements and implementation considerations for regional stormwater would be similar to the local stormwater option above (SW-1 and SW-2), and because the City would effectively be participating in possible future regional stormwater projects implemented by Sonoma Water, this option did not undergo any further separate technical analysis.

3.1.6 Efficiency Programs

E-1: Efficiency Programs

Efficiency measures would not provide a new source of drinking water supply to mitigate the impacts of drought and emergencies, but these programs would reduce demand over time as efficiency measures penetrate the City's customer base. The efficiency program would include a suite of efficiency measures, which are evaluated as a single program, which would be implemented City-wide. These measures are:

- Commercial, industrial, institutional (CII) turf removals,
- Single-family residential (SFR) turf removals,
- Toilet direct installs, and
- Fixture direct installs (kitchen aerators, bathroom aerators, and showerheads).

Along with these aggressive efficiency measures, the City's existing efficiency programs would continue, such as indoor water use efficiency surveys, landscape water use efficiency surveys, and rebates for high-efficiency washing machines, graywater use, and other practices (City of Santa Rosa, 2021). The water savings that can be achieved by the efficiency measures would be limited by factors such as: the number of inefficient toilets and fixtures remaining that could be replaced, the area of turfgrass present, and the extent to which the retrofits/relandscaping could penetrate the market (i.e., number of customers willing/able to participate). For the purposes of this study, program budget was not considered to be a limitation.

The City provided information regarding the estimated costs and water savings that could be achieved via the efficiency program (City of Santa Rosa, 2022) if 100 percent participation were achieved. Full participation voluntarily is unlikely, though the City Code could be updated to mandate changes which may achieve near full participation. In total, up to 5,700 AFY of water savings could be achieved over about the next 40 years with full participation. Descriptions of each efficiency measure, including key assumptions, are summarized below:

- **CII turf removals:** CII turf removals would remove approximately 16.3 million square feet of turf over about 41 years. A replacement rate of 400,000 square feet per year is assumed (based on 100 sites participating per year, removing an average of 4,000 square feet each). The rebate offered would be \$1.50 per square foot of turf removed. Water savings would be about 31 gallons per square foot per year, and the assumed life expectancy of the water savings is 15 years (although this may be higher since customers rarely relandscape back to turf). This measure would yield a lifetime savings of up to 23,000 AF.
- **SFR turf removals:** SFR turf removals would remove approximately 42.7 million square feet of turf over about 43 years. A replacement rate of 1 million square feet per year is assumed (1,200 homes participating per year, removing an average of 833 square feet each). The rebate offered

would be \$1.50 per square foot of turf removed. Water savings would be about 11 gallons per square foot per year and the assumed life expectancy of the water savings is 15 years (although this may be higher since customers rarely relandscape back to turf). This measure would yield a lifetime savings of up to 22,000 AF.

- **Toilet direct installs:** The City would replace existing 1.6 gallons per flush (gpf) or greater toilets customers with 0.8 gpf toilets in Santa Rosa residences. It is assumed that 45,600 toilets could be replaced over 15 years, at a rate of approximately 3,000 toilets per year. The life expectancy of the toilet is assumed to be 15 years. In total, toilet replacements would achieve a lifetime water savings of about 6,219 AF. It is assumed that future toilet replacements by residents would maintain the water savings as plumbing codes continue to require greater water efficiency.
- **Fixture direct installs:** The City would replace/install kitchen faucet aerators, bathroom faucet aerators, and 1.5 gpm showerheads. One set of fixtures would consist of one kitchen sink aerator, two-bathroom sink aerators, and two showerheads. It is assumed that 3,000 sets of fixtures could be installed per year over 15 years (about 45,600 households in total). In total, updated fixtures would achieve a lifetime water savings of about 16,000 AF. It is assumed that future fixture replacements by residents would maintain the water savings as plumbing codes continue to require greater water efficiency.

Efficiency program costs would include costs of turf rebates, toilets, and fixtures, labor costs to install toilets and fixtures, and City staff time to implement the program (including outreach to expand the reach of the program). The total lifetime program cost is approximately \$169 million, with a lifetime water savings of up to 67,000 AF. At the completion of the program, water savings per year would be up to 5,700 AF. However, given the large levels of uncertainty, an annual savings of 2,145 AFY was assumed, based on estimates of anticipated voluntary participation provided by the City.

Additional detail on data sources and assumptions can be found in Appendix A.

3.2 Screening Analysis Results

All potential water supply options were screened using two key criteria: high-level assessments of cost-effectiveness and scalability. Supply options that performed well in the screening analysis were moved forward to undergo more detailed feasibility analysis and to be scored against each criterion identified in the Study Parameters (Section 2.4).

Table 3-25 summarizes the results of the screening analysis. A total of seven water supply options have been selected to move forward for more detailed feasibility analysis.

Table 3-25: Screening Analysis Results Summary

Category	Supply Option	Moving Forward?	Reasoning for Screening Out
Groundwater	GW-1: Add local groundwater extraction wells	Yes	N/A
	GW-2: Convert emergency wells to production wells	Yes	N/A
	GW-3: Add local ASR wells	Yes	N/A
	GW-4: Regional groundwater extraction wells	No	Regional groundwater extraction is unlikely to be accepted without including a recharge element, which would result in a project similar to the local and regional ASR options. Thus, this option is not carried forward on its own.
	GW-5: Regional ASR wells	No	Because many project elements and implementation considerations for Regional ASR would be similar to the local ASR option above, this option would not undergo separate technical analysis.
Purified Recycled Water	PR-1: DPR AWPf at LTP	No	Not cost-effective based on City's current needs.
	PR-2: Satellite DPR AWPf	Yes	Note: Although the option may be less cost-effective than others carried forward, the City desires to further advance a purified recycled water option in order to provide a broader suite of options and greater diversity to potential supplies.
	PR3a: IPR AWPf at LTP via Delta Pond	No	Not cost-effective based on City's current needs.
	PR-3b: IPR AWPf at LTP via Lake Ralphine	No	Not cost-effective based on City's current needs.
	PR-3c: IPR AWPf at LTP via Lake Sonoma	No	Not cost-effective based on City's current needs.
	PR-4: Regional DPR AWPf at LTP	Yes	Note: A regional purified recycled water project appears most promising in terms of cost-effectiveness. Changing technology, supply needs, and partnerships could make this option worth future consideration.

Category	Supply Option	Moving Forward?	Reasoning for Screening Out
Non-potable Recycled Water	RW-1: Expand City’s existing non-potable recycled water system	No	Not cost-effective based on City’s current needs.
Desalination	DE-1: Regional brackish desalination	No	Not cost-effective based on City’s current needs.
	DE-2: Ocean desalination	No	Not cost-effective based on City’s current needs.
Stormwater	SW-1: Capture stormwater and store in aquifer for later potable use	Yes	N/A
	SW-2: Store in enlarged Lake Ralphine (or alternate) and construct water treatment plant for later potable use	No	Not cost-effective based on City’s current need, and yield is questionable..
	SW-3: Regional stormwater	No	Because many project elements and implementation considerations for Regional stormwater would be similar to the local stormwater options above and are being carried forward through other technical teams as present, this option would not undergo separate technical analysis.
Efficiency Programs	E-1: Add aggressive incentives for efficiency programs to reduce demand (in addition to existing programs)	Yes	N/A

3.3 Feasibility Analysis Results

Upon completion of the screening analysis, the feasibility analysis was completed, which included evaluating and scoring the short-listed water supply options. A numerical system was used for rating (scoring) each short-listed option against each criterion and against each other. The numerical system provides a score of 0 through 2, with 2 being most favorable. The score is based on knowledge of the project area, engineering judgment, and experience on past projects. The evaluation criteria scoring rubric used for the evaluation of the short-listed supplemental supply options is summarized in **Table 2-5**, a summary of the shortlist supply scores is shown in **Table 3-26**. Detailed scoring descriptions are found in the following subsections.


Table 3-26: Summary of Supply Option Scores

Criterion	Groundwater			Purified Recycled Water		Stormwater	E-1: Efficiency Programs
	GW-1: Add Extraction Wells	GW-2: Convert Emergency Wells	GW-3: City ASR Wells	PR-2: Satellite DPR	PR-4: Regional DPR	SW-1: Stormwater Storage in Aquifer	
Cost effectiveness * [\$/AF]	2 [\$840/AF]	2 [\$540/AF]	2 [\$1,100/AF]	0 [\$3,900/AF]	0 [\$3,200/AF]	0 [\$3,500/AF]	1 [\$2,800/AF]
Scalability [Yield in AFY]	2 [5,880 - 10,080 AFY]	0 [1,436 - 2,462 AFY]	1 [2,993 - 5,130 AFY]	2 [3,019 - 10,065 AFY]	2 [3,019 - 10,065 AFY]	1 [1,008 - 10,080 AFY]	1 [2,145 AFY]
Resiliency	1	1	2	2	2	1	1
Equity	2	2	2	1	0	1	0
Environmental performance	1	2	1	0	1	1	2
Legal, permitting, and regulatory	1	2	0	0	0	1	2
City control and interagency coordination	2	2	1	2	0	2	2
Multi-benefit	0	0	1	0	0	2	1
Total Unweighted	11	11	10	7	5	9	10
Total Weighted	35	29	32	21	19	19	24

* Costs shown reflect a realistic baseline usage scenario and include both capital and operating costs.

Figure 3-15 shows cost-effectiveness under baseline operations along with maximum yield and incorporates the weighted scores of each supply option in the bubble sizes (as summarized in **Table 3-26**).

Figure 3-15: Cost-Effectiveness vs Max Yield (with Weighted Score)

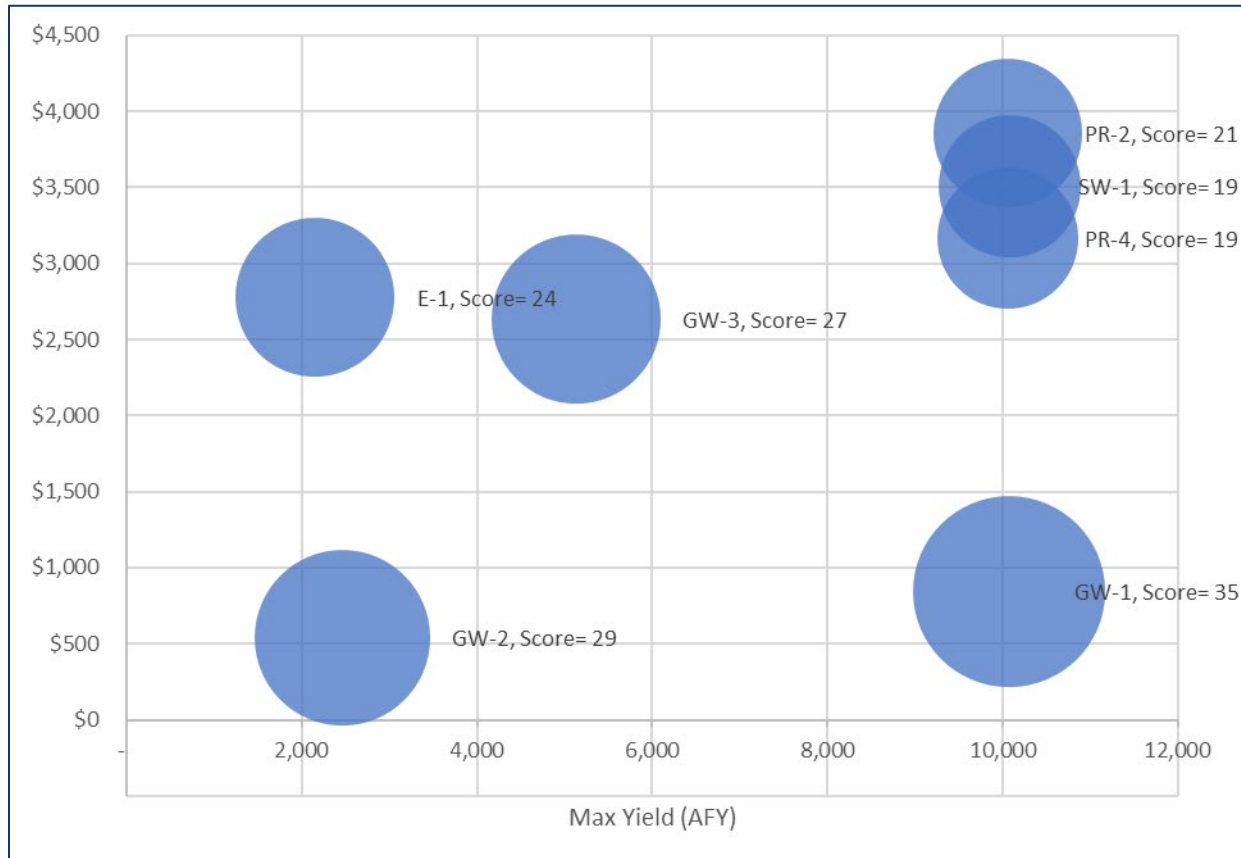

Notes: Water Supply options:

- E-1: Efficiency Programs
- GW-1: Construct Additional Groundwater Extraction Wells
- GW-2: Convert Emergency Wells to Production Wells
- GW-3: Construct Aquifer Storage and Recovery (ASR) Wells
- PR-2: Satellite Direct Potable Reuse (DPR) with Advanced Water Purification Facility (AWPF)
- PR-4: Regional DPR with AWPF at Laguna Treatment Plant
- SW-1: Stormwater Storage in Aquifer

3.3.1 Groundwater Options

The detailed scoring and rationale for the groundwater options are provided in **Table 3-27**, **Table 3-28** and **Table 3-29** on the following pages below.

Table 3-27: Detailed Scoring for Option GW-1

Criterion	Description	Score
Cost effectiveness	Under the baseline scenario, actual costs are estimated at \$843/AF, making this option one of the least expensive studied, and less expensive than the current Sonoma Water supply which is \$1,200/AF.	2
Scalability	As evaluated, this option includes construction of 12 wells to meet the City’s supply goals. However, the City need not construct all 12 wells initially, and could potentially build fewer even in the long run if well yield is higher than estimated. Generally, this option could be scaled or phased to best fit City needs.	2
Resiliency	Moderate resiliency. Pumping costs would increase with rising power costs. Cost-effectiveness could decrease under certain hydrologic conditions, but groundwater availability may not be severely impacted unless there is a long-term change in hydrology.	1
Equity	The additional groundwater supply would have no impact on vulnerable communities. The additional groundwater supply would be available to the City to offset purchased water from Sonoma Water.	2
Environmental performance	The new extraction wells would be located in the City within the City's Greenway Area. Construction of 12 wells would have moderate potential for environmental impacts.	1
Legal, permitting, and regulatory	Well construction would likely require some permitting and regulatory compliance but would not require unusual efforts.	1
City control and interagency coordination	While coordination with Sonoma Water and the other GSAs in Santa Rosa Plain would be required, the scope and timing of the work would be generally at the City’s discretion.	2
Multi-benefit	No other benefits provided.	0

Table 3-28: Detailed Scoring for Option GW-2

Criterion	Description	Score
Cost effectiveness	Based on conceptual analyses, the rehabilitation of the three existing emergency wells would provide up to 2,462 AFY of additional groundwater supply. The baseline scenario average cost of water is approximately \$541/AF, the least expensive of all options studied.	2
Scalability	This option lends itself to phasing since well rehabilitation could occur one well at a time. However, the overall scale of the project would fall far short of the City's 7,500 AFY need.	0
Resiliency	Moderate resiliency. Pumping costs would increase with rising power costs. Cost-effectiveness could decrease under certain hydrologic conditions, but groundwater availability may not be severely impacted unless there is a long-term change in hydrology.	1
Equity	The additional groundwater supply would have no impact on vulnerable communities. The additional groundwater supply would be available to the City to offset purchased water from Sonoma Water.	2
Environmental performance	The rehabilitation of the existing wells would have minimal potential for environmental impacts.	2
Legal, permitting, and regulatory	The City has previously completed similar permitting/ regulatory efforts required for approval to convert from emergency use to active supply (i.e., 2005 Farmer's Lane well).	2
City control and interagency coordination	No interagency coordination would be required.	2
Multi-benefit	No other benefits provided.	0

Table 3-29: Detailed Scoring for Option GW-3

Criterion	Description	Score
Cost effectiveness	Based on conceptual level cost estimates, construction of six ASR wells would provide up to 5,130 AFY of additional groundwater supply. The baseline scenario average cost of water is approximately \$2,632/AF which includes purchase of water ASR.	2
Scalability	The extraction wells included in this option could be constructed in phases to best fit City needs. At buildout, the option could provide most of the City’s supplemental needs.	1
Resiliency	Moderate resiliency. Pumping and injection costs would increase with rising power costs. Cost-effectiveness could decrease under certain hydrologic conditions, but the ability to inject water into the aquifer would improve resiliency relative to extraction-only options.	2
Equity	The additional groundwater supply would have no impact on vulnerable communities. The additional groundwater supply would be available to the City to offset purchased water from Sonoma Water.	2
Environmental performance	The new ASR wells would be located in a less developed area within the City limits. Construction of six wells would have moderate potential for environmental impacts.	1
Legal, permitting, and regulatory	While ASR projects are increasingly common, they pose more significant permitting and regulatory requirements.	0
City control and interagency coordination	Coordination would be required with GSAs in Santa Rosa Plain and with Sonoma Water to coordinate with other ASR programs underway.	1
Multi-benefit	This option would enable conjunctive management of surface water and groundwater, which allows for greater flexibility in optimizing surface water and groundwater use (which represents an additional benefit beyond strict water supply).	1

3.3.2 Purified Recycled Water Options

The detailed scoring and rationale for the purified recycled water options are listed in **Table 3-30** and **Table 3-31**.

Table 3-30: Detailed Scoring for Option PR-2

Criterion	Description	Score
Cost effectiveness	Under the baseline scenario the average cost of water is approximately \$3,854/AF, making it the most expensive option. Additionally, the option involves a financial upfront commitment for capital so even if future circumstances changed the obligation to pay for the project would continue unabated.	0
Scalability	The AWPf included in this option could be constructed in phases to best fit City needs. The AWPf could be scaled down 30% in low demand periods.	2
Resiliency	High resiliency. The ability to purify tertiary treated water into potable supply would improve resiliency, even in times of drought or future hydrologic uncertainty.	2
Equity	The additional purified water supply would have no impact on the City’s vulnerable communities. However, the City would need to consider potential equity issues if purified water were to be delivered to only a portion of its residents.	1
Environmental performance	The satellite DPR AWPf would be located in a less developed area within the City limits. Construction of the AWPf and extensive conveyance facilities may have moderate to high potential for environmental impacts.	0
Legal, permitting, and regulatory	High permitting/regulatory effort would be required as discussed in Section 3.1.2.1.2 . The main challenges in pursuing DPR include the lack of regulatory certainty and the lack of permitting precedents.	0
City control and interagency coordination	No significant interagency coordination would be required.	2
Multi-benefit	This option would provide a potable supply benefit but would reduce tertiary water availability for the Geysers and for the non-potable customers.	0

Table 3-31: Detailed Scoring for Option PR-4

Criterion	Description	Score
Cost effectiveness	Under the baseline scenario the average cost of water is approximately \$3,166/AF, making it among the most expensive options. Additionally, the option involves a financial upfront commitment for capital so even if future circumstances changed the obligation to pay for the project would continue unabated.	0
Scalability	The AWPf included in this option could be constructed in phases to best fit City needs. The AWPf could be scaled down 30% in low demand periods.	2
Resiliency	High resiliency. The ability to purify tertiary treated water into potable supply would improve resiliency, even in times of drought or future hydrologic uncertainty.	2
Equity	The additional purified water supply would have no impact on the City’s vulnerable communities.	0
Environmental performance	The DPR AWPf would be located on the City-owned LTP property. Construction of the AWPf and purified water conveyance facilities would have low to moderate potential for environmental impacts.	1
Legal, permitting, and regulatory	High permitting/regulatory effort would be required as discussed in Section 3.1.2.1.2 . The main challenges in pursuing DPR include the lack of regulatory certainty and the lack of permitting precedents.	0
City control and interagency coordination	Coordination with a regional partner for the paper exchange would be required in addition to continuing coordination with Sonoma Water if its aqueduct were used for distribution.	0
Multi-benefit	This option would provide a potable supply benefit but would reduce tertiary water availability for the Geysers and for the non-potable customers.	0

3.3.3 Stormwater Capture

The detailed scoring and rationale for SW-1 is listed in **Table 3-32**.

Table 3-32: Detailed Scoring for Option SW-1

Criterion	Description	Score
Cost Effectiveness	The baseline scenario average cost of water is approximately \$3,500/AF, making it among the most expensive options.	0
Scalability	While the diversion structure, spreading basins (or injection wells) and extraction wells included in this option could be constructed in phases, the treatment plant, if needed, would require significant cost up-front that could not be recovered even if changes in future conditions reduced the need for the project.	1
Resiliency	Moderate resiliency. While the ability to store water in the aquifer would improve resiliency, there are significant uncertainties in the project’s performance, specifically its yield in drought years.	1
Equity	The additional groundwater supply would have no impact on vulnerable communities. The recharge areas for the project may tend to focus construction impacts on less-developed, less affluent areas.	1
Environmental performance	The new diversion structure, spreading basins and extraction wells would be located in a less developed area within the City limits. Construction of the twelve wells would have moderate potential for environmental impacts.	1
Legal, permitting, and regulatory	Some permitting/regulatory effort would be required, but stormwater diversion projects are increasingly common and would not require outside legal, permitting, or regulatory effort to implement.	1
City control and interagency coordination	No interagency coordination would be required.	2
Multi-benefit	This option would enable conjunctive management of surface water and groundwater, which allows for greater flexibility in optimizing surface water and groundwater use (which represents an additional benefit beyond strict water supply).	2

3.3.4 Efficiency Programs

The detailed scoring and rationale for the Efficiency Programs option is provided in **Table 3-33**.

Table 3-33: Detailed Scoring for Option E-1

Criterion	Description	Score
Cost effectiveness	As summarized above, based on cost estimates provided by the City, efficiency program would provide water savings at a cost of approximately \$2,780/AF under the Baseline Scenario. This makes it less expensive than the options involving major costs for water treatment (e.g., PR-2, PR-4, SW-1) but more expensive than the groundwater options.	1
Scalability	Water savings could be increased depending on the scale of the program and number of customers that could be reached. Once water savings are achieved, they are considered to be relatively secure because they are built into the landscapes/fixtures, which have typically become more efficient with time due to plumbing codes and price signals.	1
Resiliency	Performance of efficiency measures would not degrade with changes in future regulations, energy costs or hydrology. However, the option does not provide “new water” that would help mitigate catastrophic loss of the Sonoma Water supply.	1
Equity	The program might tend to provide benefits mostly to more affluent members of the community, i.e., those who own homes and those who can afford up-front costs associated with reimbursement incentives.	0
Environmental performance	The program would have little to no adverse environmental impact and would provide a potential environmental benefit by reducing water consumption.	2
Legal, permitting, and regulatory	Large-scale construction would not be needed. Physical changes as a result of the project would include toilet and fixture replacements, and relandscaping in existing developed areas. Work would need to be completed by qualified contractors, but additional permitting and regulatory requirements would not be anticipated for this option.	2
City control and interagency coordination	No interagency coordination would be required.	2
Multi-benefit	In addition to providing water savings, the program would provide a cost savings to customers by helping them to reduce their water use.	1

3.3.5 Cost Sensitivity Analysis

The screening tool allows the supply option costs to be estimated under a variety of scenarios. The baseline scenario was modified to assess supply option performance under multiple hydrologic scenarios (**Figure 3-16**), and multiple Sonoma Water dry-year reduction levels (**Figure 3-17**). In that figure, scenarios SW-35 and SW-40 represent dry-year reductions of 35 percent and 40 percent respectively, versus a base scenario of 30 percent.

In general, most supply options would be more cost-effective in a drier hydrologic scenario because more water would be produced to meet normal demand during Sonoma Water water shortages. The wetter hydrologic scenario contains more wet years than the baseline, but also contains more dry years (as summarized in **Table 3-34**). Therefore, for some options, the wetter scenario is also more cost-effective than the baseline scenario. All supply options become more cost-effective if greater dry-year Sonoma Water reductions are assumed.

Figure 3-16: Supply Option Cost Performance with Varying Hydrology (\$/AF)


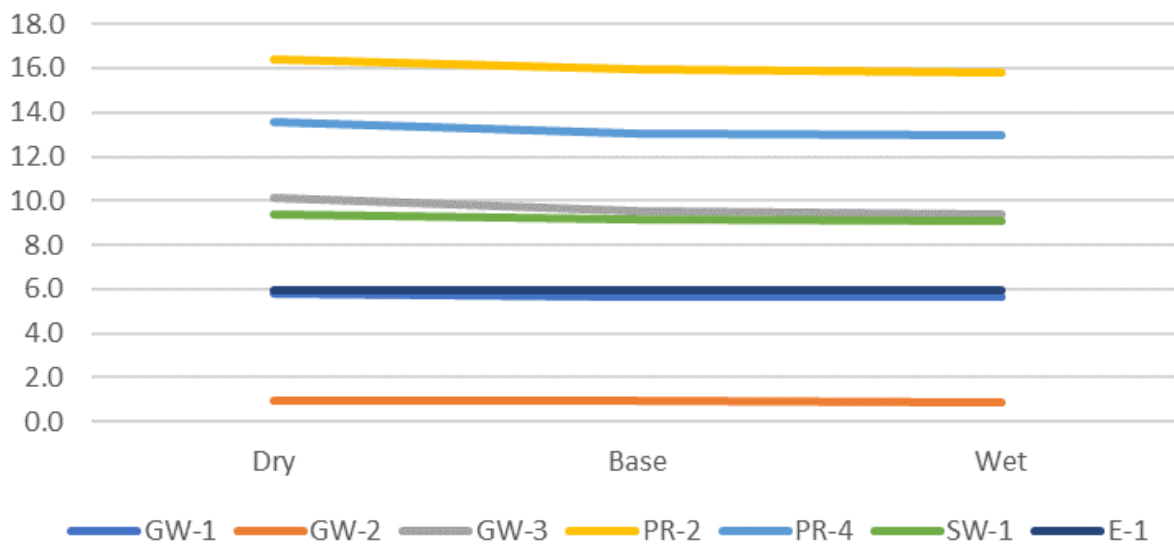


Table 3-34: Distribution of Water Year Types in Hydrologic Scenarios

Hydrologic Scenario	Year Types by Percent		
	Wet	Normal	Dry
Wet	37%	29%	34%
Historic	33%	37%	30%
Dry	23%	30%	47%

Figure 3-17: Supply Option Cost Performance with Varying Sonoma Water Cutbacks (\$M/yr)

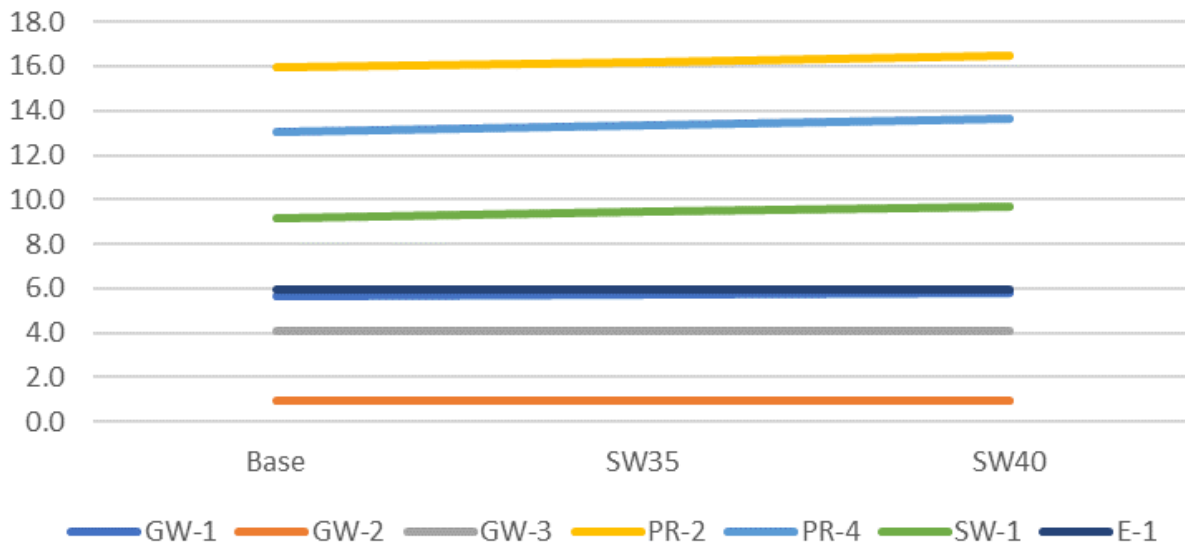

SW35: Scenario in which dry-year Sonoma Water supply reduction is 35% of baseline usage rather than the Base assumption of 30% reduction.

SW40: Scenario in which dry-year Sonoma Water supply reduction is 40% of baseline usage.

Although this analysis focused on hydrologic scenarios and Sonoma Water cutbacks, reflecting the City’s goals of addressing climate change and Sonoma Water reliance, future work could use other variables to test cost-sensitivity (such as price of power, interest rate, and demand reduction percent).

4. CONCLUSIONS

This Feasibility Analysis reveals several key considerations for the City to account for as the Water Supply Plan moves forward:

- Future conditions:** Depending on the City’s assumptions about future hydrology, Sonoma Water supply reductions, cost of Sonoma Water supplies, and customer demand/conservation, the City may reach different conclusions about the potential best fit water supplies. For example, if the City assumes more optimistic future conditions, the amount of new water needed may be relatively modest, in which case the City would be well served by bridging that gap with a small number of new wells, which could be added one by one as the need arises. On the other hand, if the City assumes more pessimistic future conditions in which existing water supplies decrease, a broader range of options could be considered, including options such as potable reuse that would be run continuously once implemented. Options that could be implemented in phases (e.g., rehabilitating one well at a time, rather than 3 at once) may help provide resiliency against that type of uncertainty while minimizing capital outlay.
- Operational assumptions:** This analysis has incorporated reasonable operational assumptions into the baseline scenario. The cost per AF of water is sensitive to those assumptions. Generally,

the cost per AF for a supplemental supply will be reduced as that supply is used more. However, many of the options cost more than the existing Sonoma Water supply.

- **Sensitivity:** This analysis considered the impact of changing hydrology and reduced Sonoma Water dry-year allocations under the baseline scenario. The supply options generally become more cost-effective under more pessimistic scenarios (drier hydrology and higher Sonoma Water cutbacks) because more water is produced via the new options. However, the analysis indicates that the relative rankings of the supply options do not vary substantially with changes to the baseline condition.

The next step of the WSAP will involve a portfolio analysis, which will further assess the water supply options that passed the screening analysis. The portfolio analysis will consider downscaled versions of some supply options and will consider potential groupings of supply options that would allow the City to optimize different areas such as resiliency, supply volume, and cost.

5. REFERENCES

- California Department of Water Resources. (2022, August). The California Department of Water Resources' Statewide Airborne Electromagnetic Survey Project, Report for Survey Area 3.
- City of Santa Rosa. (2007). Incremental Recycled Water Program. August 2007 Update to the Recycled Water Master Plan.
- City of Santa Rosa. (2018, February). Regional Water Reuse System Master Plan.
- City of Santa Rosa. (2021, June). 2020 Urban Water Management Plan.
- City of Santa Rosa. (2022, December). WUE Water Savings (Spreadsheet).
- City of Santa Rosa. (2023, February). Recycled Water Flows - Volume and User Type by Month 2019-2022.
- Marin Municipal Water District. (2021, October 18). Draft Technical Memorandum: MMWD Desalination Supply Study.
- Santa Rosa Plain Groundwater Sustainability Agency. (2021, December). Groundwater Sustainability Plan: Santa Rosa Plain Groundwater Subbasin.
- Sonoma Water. (n.d.). Santa Rosa Plain Drought Resiliency Project. Retrieved from <https://www.sonomawater.org/DroughtResiliency>
- State of California Code of Regulations Title 22, Division 4. Environmental Health, Chapter 3 Water Recycling Criteria.
- State Water Resources Control Board. (2021, August 17). A Proposed Framework of Regulating Direct Potable Reuse in California Addendum, version 8-17-2021.

DRAFT



APPENDIX A: COST DETAILS

Santa Rosa Water Supply Options

July 2023

Option GW-1a: Groundwater Extraction Wells

Basis of estimate:
 Construct additional production wells and wellhead treatment if necessary and tie into the existing distribution system. The no. of wells to meet the demand would be 9 wells for the drought demand of 7,500 AFY and 12 wells for the peak demand of 9 MGD (or 10,000 AFY), based on the well capacity of 500 gpm. The costs were built upon existing City O&M data and well rehab of Leete Well.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
Additional Wells						
New Well Construction	500	gpm	12	per well	\$3,500,000	42,000,000
Product Water Distribution						
Product Water Line	20	in	3,000	per inch-dia LF	\$37	2,225,000
Product Water Pump Station			240	HP	\$6,500	1,560,000
Potable Connection			1	LS	\$100,000	100,000
Raw Construction Cost						45,890,000
Construction Contingency					50%	22,950,000
Total Construction Cost						68,840,000
Implementation Cost					40%	27,540,000
Total Capital Cost						96,380,000

Annual Operations & Maintenance Cost (9 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Product Water Pump Station		6,000	118	1,405,080	\$0.20	281,016
Extraction Wells	10,080				\$54	547,865
Extraction Well Energy Use	10,080				\$182	1,834,401
Fixed O&M					Construction Cost	Unit Cost
Extraction Wells					\$443,119	443,119
Pump Stations			1,560,000		3.0%	46,800
Pipelines			2,225,000		0.5%	11,125
Total Annual Operations & Maintenance Cost						3,164,326
Annualized Capital Cost					0.03526	3,398,000
Total Annualized Cost						6,562,326
					Max Project Yield (AFY)	10,080
					MAX \$/AF	651

Annual Operations & Maintenance Cost (0 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Product Water Pump Station		0	118	0	\$0.20	-
Extraction Wells	0				\$54	-
Extraction Well Energy Use	0				\$182	-
Fixed O&M					Construction Cost	Unit Cost
Extraction Wells					\$443,119	443,119
Pump Stations			1,560,000		3.0%	46,800
Pipelines			2,225,000		0.5%	11,125
Total Annual Operations & Maintenance Cost						501,044
Annualized Capital Cost					0.03526	3,398,000
Total Annualized Cost						3,899,044
					Min Project Yield (AFY)	5,880
					MIN \$/AF	663

Santa Rosa Water Supply Options

July 2023

Option GW-2: Convert existing emergency wells into groundwater extraction wells

Basis of estimate:

Assumes 3 existing emergency wells rehabilitated to become production wells for the City. Assumes the costs to rehabilitate the Leete well. Historic yield for the 3 wells is 2,462 AFY.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
Well Rehabilitation						
Well Construction			3	per well	\$1,440,000	4,320,000
Product Water Distribution						
Product Water Line		in		per inch-dia LF	\$37	-
Product Water Pump Station				HP	\$6,500	-
Potable Connection				LS	\$100,000	-
Iron and Manganese Treatment			2	per well	\$600,000	1,200,000
Raw Construction Cost						5,520,000
Construction Contingency					50%	2,760,000
Total Construction Cost						8,280,000
Implementation Cost					40%	3,310,000
Total Capital Cost						11,590,000

Annual Operations & Maintenance Cost (2.19 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
				0	\$0.20	-
Extraction Wells	2,462				\$54	133,814
Extraction Well Energy Use	2,462				\$182	448,045
Fixed O&M						
					Construction Cost	Unit Cost
Wells					\$110,780	110,780
Pump Stations				-	3.0%	-
Pipelines				-	0.5%	-
Treatment			1,200,000		1.0%	12,000
Total Annual Operations & Maintenance Cost						704,639
Annualized Capital Cost					0.03526	409,000
Total Annualized Cost						1,113,639
Max Project Yield (AFY)						2,462
MAX \$/AF						452

Annual Operations & Maintenance Cost (0 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Product Water Pump Station		0	118	0	\$0.20	-
Extraction Wells	0				\$54	-
Extraction Well Energy Use	0				\$182	-
Fixed O&M						
					Construction Cost	Unit Cost
Extraction Wells					\$110,780	110,780
Pump Stations				-	3.0%	-
Pipelines				-	0.5%	-
Total Annual Operations & Maintenance Cost						110,780
Annualized Capital Cost					0.03526	409,000
Total Annualized Cost						519,780
Min Project Yield (AFY)						1,436
MIN \$/AF						362

Santa Rosa Water Supply Options

July 2023

Option GW-3: ASR Wells

Basis of estimate:

Constructs six ASR wells in Delta Pond area and wellhead treatment if necessary and tie into the existing distribution system. The costs were built upon existing City O&M data and well rehab of Leete Well.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
ASR						
New Well Construction			6	per well	\$5,000,000	30,000,000
Product Water Distribution						
Product Water Line	16	in	12,000	per inch-dia LF	\$37	7,120,000
Product Water Pump Station			210	HP	\$6,500	1,365,000
Potable Connection			1	LS	\$100,000	100,000
Raw Construction Cost						38,590,000
Construction Contingency					50%	19,300,000
Total Construction Cost						57,890,000
Implementation Cost					40%	23,160,000
Total Capital Cost						81,050,000

Annual Operations & Maintenance Cost (4.6 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Product Water Pump Station		3,180	118	744,660	\$0.20	148,932
ASR Well	5,130				\$65	334,589
ASR Well Energy Use	5,130				\$218	1,120,295
Fixed O&M	Qty	Unit	Construction Cost		Unit Cost	
Pump Stations			1,365,000		3.0%	40,950
Pipelines			7,120,000		0.5%	35,600
ASR Well					\$44,312	44,312
Total Annual Operations & Maintenance Cost						1,724,678
Annualized Capital Cost					0.03526	2,858,000
Total Annualized Cost						4,582,678
Max Project Yield (AFY)						5,130
MAX \$/AF						893

Annual Operations & Maintenance Cost (0 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Product Water Pump Station		0	118	0	\$0.20	-
ASR Well	5,130				\$65	334,589
ASR Well Energy Use	5,130				\$218	1,120,295
Fixed O&M	Qty	Unit	Construction Cost		Unit Cost	
Pump Stations			1,365,000		3.0%	40,950
Pipelines			7,120,000		0.5%	35,600
ASR Well					\$44,312	44,312
Total Annual Operations & Maintenance Cost						1,575,746
Annualized Capital Cost					0.03526	2,858,000
Total Annualized Cost						4,433,746
Min Project Yield (AFY)						2,993
MIN \$/AF						1,482

Santa Rosa Water Supply Options

July 2023

Option PR-1: DPR at LTP

Basis of estimate:

Option PR-1 would convey the City's tertiary effluent to an AWWP located at the LTP and return AWWP waste stream to the LTP headworks. The AWWP would include treatment processes in compliance with future anticipated regulations for treated water augmentation. The purified water would be conveyed to SCWA's 48-inch diameter aqueduct for distribution to the City's potable water system. PR-1 is limited by the reliable volume of tertiary effluent available, assuming the City would be reducing flow to the Geysers by prioritizing recycled water to its existing irrigation customers and the AWWP. For this level of study it was assumed the City would size the AWWP to meet its 9 MGD peak month supply needs and provide any remaining tertiary water to its existing irrigation customers and then to the Geysers.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
Equalization			1,820,000	per gallon	\$1.25	2,275,000
Tertiary to AWWP						
Tertiary Water Line to AWWP	24	in	500	per inch-dia LF	\$37	445,000
Tertiary Pump Station				HP	\$6,500	-
AWTF - DPR						
Ozone	11.4	MGD			\$530,000	6,025,000
BAF	11.4	MGD			\$480,000	5,457,000
MF/UF	10.6	MGD			\$1,940,000	20,510,000
Interprocess Tank			220,000	per gallon	\$1.25	275,000
RO	9.0	MGD			\$2,340,000	21,028,000
Chemicals (Storage and Feed Systems)	9.0	MGD			\$200,000	1,797,000
Sitework/Piping/Structures	9.0	MGD			\$5,050,000	45,381,000
Waste Disposal to Headworks at LTP	10	in	500	per inch-dia LF	\$37	185,400
Brine Disposal						
Zero Liquid Discharge			9.0	per MGD	\$1,194,000	10,730,000
Product Water Distribution						
Product Water Line	20	in	26,330	per inch-dia LF	\$37	19,528,100
Product Water Pump Station			625	HP	\$6,500	4,062,500
Potable Connection			1	LS	\$100,000	100,000
Raw Construction Cost						137,800,000
Construction Contingency				50%		68,900,000
Total Construction Cost						206,700,000
Implementation Cost				40%		82,680,000
Total Capital Cost						289,380,000

Annual Operations & Maintenance Cost (9 mgd production)						Annual O&M
Variable O&M	QTY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Tertiary Pump Station						
Product Water Pump Station		6,241	297	3,669,660	\$0.20	733,932
FAT System				7,157,231	\$0.20	1,431,446
Ozone/ BAF System				2,004,332	\$0.20	400,866
Evaporator				27,178,376	\$0.20	5,435,675
Crystallizer				4,982,702	\$0.20	996,540
FAT System - Chemicals	1				\$326,250	326,250
Ozone/ BAF System - Chemicals	1				\$2,250	2,250
Fixed O&M			Construction Cost		Unit Cost	
Treatment			63,750,000		1.0%	637,500
Storage			2,550,000		0.5%	12,750
Pump Stations			4,062,500		3.0%	121,875
Pipelines			20,158,500		0.5%	100,793
Total Annual Operations & Maintenance Cost						10,199,878
Annualized Capital Cost					0.03526	10,203,000
Total Annualized Cost						20,402,878
					Max Project Yield (AFY)	10,065
					MAX \$/AF	2,027

Annual Operations & Maintenance Cost (2.7 mgd production)						Annual O&M
Variable O&M	QTY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Tertiary Pump Station						-
Product Water Pump Station		1,872	297	1,100,880	\$0.20	220,176
FAT System				2,147,169	\$0.20	429,434
Ozone/ BAF System				601,300	\$0.20	120,260
Evaporator				8,153,513	\$0.20	1,630,703
Crystallizer				1,494,811	\$0.20	298,962
FAT System - Chemicals	1				\$97,875	97,875
Ozone/ BAF System - Chemicals	1				\$675	675
Fixed O&M			Construction Cost		Unit Cost	
Treatment			63,750,000		1.0%	637,500
Storage			2,550,000		0.5%	12,750
Pump Stations			4,062,500		3.0%	121,875
Pipelines			20,158,500		0.5%	100,793
Total Annual Operations & Maintenance Cost						3,671,002
Annualized Capital Cost					0.03526	10,203,000
Total Annualized Cost						13,874,002
					Min Project Yield (AFY)	3,019
					MIN \$/AF	4,595

Santa Rosa Water Supply Options

July 2023

Option PR-2: Satellite DPR

Basis of estimate:

Option PR-2 would convey the City’s tertiary effluent to a satellite AWWP and return AWWP waste stream to the nearest sewer. The AWWP would include treatment processes in compliance with future anticipated regulations for treated water augmentation. The purified water would be conveyed to SCWA’s 48-inch diameter aqueduct for distribution to the City’s potable water system. The satellite AWWP is assumed to be located on City-owned agricultural leased land, Stone Farm for its proximity to the 48-inch aqueduct. For this level of study it was assumed the City would size the AWWP to meet its 9 MGD peak month supply needs and provide any remaining tertiary water to its existing irrigation customers and then to the Geysers.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
Equalization			1,820,000	per gallon	\$1.25	2,275,000
Tertiary to Satellite AWWP						
Tertiary Water Line to DPR	24	in	30,100	per inch-dia LF	\$37	26,789,000
Tertiary Pump Station			510	HP	\$6,500	3,315,000
AWTF - DPR						
Ozone	11.4	MGD			\$530,000	6,025,000
BAF	11.4	MGD			\$480,000	5,457,000
MF/UF	10.6	MGD			\$1,940,000	20,510,000
Interprocess Tank			220,000	per gallon	\$1.25	275,000
RO	9.0	MGD			\$2,340,000	21,028,000
Chemicals (Storage and Feed Systems)	9.0	MGD			\$200,000	1,797,000
Sitework/Piping/Structures	9.0	MGD			\$5,050,000	45,381,000
Waste Disposal to Sewer	10	in	7,330	per inch-dia LF	\$37	2,718,200
Brine Disposal						
Zero Liquid Discharge			9.0	per MGD	\$1,194,000	10,730,000
Product Water Line	20	in	2,050	per inch-dia LF	\$37	1,520,400
Product Water Pump Station			250	HP	\$6,500	1,625,000
Potable Connection			1	LS	\$100,000	100,000
Raw Construction Cost						149,550,000
Construction Contingency				50%		74,780,000
Total Construction Cost						224,330,000
Implementation Cost				40%		89,730,000
Total Capital Cost						314,060,000

Annual Operations & Maintenance Cost (9 mgd production)					Annual O&M
Variable O&M	GPM	TDH (ft)	kwh-yr	Unit Cost	
Tertiary Pump Station	8,056	188	3,005,730	\$0.20	601,000
Product Water Pump Station	6,241	120	1,477,080	\$0.20	295,000
FAT System			7,157,231	\$0.20	1,431,446
Ozone/ BAF System			2,004,332	\$0.20	400,866
Evaporator			27,178,376	\$0.20	5,435,675
Crystallizer			4,982,702	\$0.20	996,540
FAT System - Chemicals			1	\$326,250	326,250
Ozone/ BAF System - Chemicals			1	\$2,250	2,250
Fixed O&M		Construction Cost		Unit Cost	
Treatment		63,750,000		1.0%	637,500
Storage		2,550,000		0.5%	12,750
Pump Stations		4,940,000		3.0%	148,200
Pipelines		31,027,600		0.5%	155,138
Total Annual Operations & Maintenance Cost					10,442,616
Annualized Capital Cost				0.03526	11,073,000
Total Annualized Cost					21,515,616
				Max Project Yield (AFY)	10,065
				MAX \$/AF	2,138

Annual Operations & Maintenance Cost (2.7 mgd production)					Annual O&M
Variable O&M	GPM	TDH (ft)	kwh-yr	Unit Cost	
Tertiary Pump Station	2,417	188	901,710	\$0.20	180,000
Product Water Pump Station	1,872	120	443,160	\$0.20	89,000
FAT System			2,147,169	\$0.20	429,434
Ozone/ BAF System			601,300	\$0.20	120,260
Evaporator			8,153,513	\$0.20	1,630,703
Crystallizer			1,494,811	\$0.20	298,962
FAT System - Chemicals			1	\$97,875	97,875
Ozone/ BAF System - Chemicals			1	\$675	675
Fixed O&M		Construction Cost		Unit Cost	
Treatment		63,750,000		1.0%	637,500
Storage		2,550,000		0.5%	12,750
Pump Stations		4,940,000		3.0%	148,200
Pipelines		31,027,600		0.5%	155,138
Total Annual Operations & Maintenance Cost					3,800,497
Annualized Capital Cost				0.03526	11,073,000
Total Annualized Cost					14,873,497
				Min Project Yield (AFY)	3,019
				MIN \$/AF	4,926

Santa Rosa Water Supply Options

July 2023

Option PR-3a: IPR to Delta Pond (GWA)

Basis of estimate:

Option PR-3a would convey the City's tertiary effluent to an AWPf at LTP and return AWPf waste stream to the headworks at LTP. The AWPf would include treatment processes in compliance with regulations for groundwater recharge. The purified water would be conveyed to a repurposed Delta Pond or a new nearby pond for infiltration; after the minimum retention time of 2-months in the groundwater aquifer, the recharged groundwater could then be extracted. For the 9 MGD supply, 12 new extraction wells would be required. The same assumptions for the GW-1 option were applied for these extraction wells. For this level of study it was assumed the City would size the AWPf to meet its 9 MGD peak month supply needs and provide any remaining tertiary water to its existing irrigation customers and then to the Geysers.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
Equalization			1,820,000	per gallon	\$1.25	2,275,000
Tertiary to AWTF						
Tertiary Water Line to IPR	24	in	500	per inch-dia LF	\$37	445,000
Tertiary Pump Station				HP	\$6,500	-
AWTF - IPR						
Ozone		MGD			\$530,000	-
BAF		MGD			\$480,000	-
MF/UF	10.6	MGD			\$1,940,000	20,568,000
Interprocess Tank			221,000	per gallon	\$1.25	276,000
RO	9.0	MGD			\$2,340,000	21,087,000
Chemicals (Storage and Feed Systems)	9.0	MGD			\$200,000	1,802,000
Sitework/Piping/Structures	9.0	MGD			\$5,050,000	45,509,000
Waste Disposal to Headworks	8	in	500	per inch-dia LF	\$37	148,300
Brine Disposal						
Zero Liquid Discharge			9.0	per MGD	\$1,194,000	10,760,000
Product Water Distribution						
Product Water Line	22	in	41,220	per inch-dia LF	\$37	33,628,700
Product Water Pump Station			490	HP	\$6,500	3,185,000
Potable Connection				LS	\$100,000	-
ASR Wells						
New Well Construction	500	gpm	12	per well	\$5,000,000	60,000,000
Raw Construction Cost						199,680,000
Construction Contingency				50%		99,840,000
Total Construction Cost						299,520,000
Implementation Cost				40%		119,810,000
Total Capital Cost						419,330,000

Annual Operations & Maintenance Cost (9 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Tertiary Pump Station						
Product Water Pump Station		6,241	234	2,892,420	\$0.20	578,000
FAT System				7,157,231	\$0.20	1,431,446
Ozone/ BAF System					\$0.20	-
Evaporator				27,178,376	\$0.20	5,435,675
Crystallizer				4,982,702	\$0.20	996,540
FAT System - Chemicals				1	\$326,250	326,250
Ozone/ BAF System - Chemicals					\$2,250	-
ASR Well	10,065				\$65	656,445
ASR Well Energy Use	10,065				\$218	2,197,955
Fixed O&M			Construction Cost		Unit Cost	
Treatment			52,415,000		1.0%	524,150
Storage			2,551,000		0.5%	12,755
Pump Stations			3,185,000		3.0%	95,550
Pipelines			34,222,000		0.5%	171,110
ASR Wells					\$265,872	265,872
Total Annual Operations & Maintenance Cost						12,691,749
Annualized Capital Cost					0.03526	14,785,000
Total Annualized Cost						27,476,749
					Max Project Yield (AFY)	10,065
					MAX \$/AF	2,730

Annual Operations & Maintenance Cost (2.7 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Tertiary Pump Station						-
Product Water Pump Station		1,872	234	867,690	\$0.20	174,000
FAT System				2,147,169	\$0.20	429,434
Ozone/ BAF System					\$0.20	-
Evaporator				8,153,513	\$0.20	1,630,703
Crystallizer				1,494,811	\$0.20	298,962
FAT System - Chemicals					\$97,875	97,875
Ozone/ BAF System - Chemicals					\$675	-
ASR Well	3,024				\$65	197,232
ASR Well Energy Use	3,024				\$218	660,384
Fixed O&M			Construction Cost		Unit Cost	
Treatment			52,415,000		1.0%	524,150
Storage			2,551,000		0.5%	12,755
Pump Stations			3,185,000		3.0%	95,550
Pipelines			34,222,000		0.5%	171,110
ASR Wells					\$265,872	265,872
Total Annual Operations & Maintenance Cost						4,558,026
Annualized Capital Cost					0.03526	14,785,000
Total Annualized Cost						19,343,026
					Min Project Yield (AFY)	3,019
					MIN \$/AF	6,406

Santa Rosa Water Supply Options

July 2023

Option PR-3c: IPR to Lake Sonoma

Basis of estimate:

Option PR-3c would convey the City’s tertiary effluent to an AWWP at LTP and return AWWP waste stream to the headworks at LTP. The AWWP would include treatment processes in compliance with regulations for surface water augmentation. The purified water would be conveyed to Lake Sonoma through a new purified water line extending to the Lake assuming the existing Geysers’ pipeline corridor/ easement. After the minimum retention time of 2-months in the surface water body, the water could then be recovered using Sonoma Water’s existing infrastructure via the Russian River. For this level of study it was assumed the City would size the AWWP to meet its 9 MGD peak month supply needs and provide any remaining tertiary water to its existing irrigation customers and then to the Geysers.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
Equalization			1,820,000	per gallon	\$1.25	2,275,000
Tertiary to AWWP						
Tertiary Water Line to IPR	24	in	500	per inch-dia LF	\$37	445,000
Tertiary Pump Station				HP	\$6,500	-
AWTF - IPR						
Ozone		MGD			\$530,000	-
BAF		MGD			\$480,000	-
MF/UF	10.6	MGD			\$1,940,000	20,568,000
Interprocess Tank			221,000	per gallon	\$1.25	276,000
RO	9.0	MGD			\$2,340,000	21,087,000
Chemicals (Storage and Feed Systems)	9.0	MGD			\$200,000	1,802,000
Sitework/Piping/Structures	9.0	MGD			\$5,050,000	45,509,000
Waste Disposal to Headworks	8	in	500	per inch-dia LF	\$37	148,300
Brine Disposal						
Zero Liquid Discharge			9.0	per MGD	\$1,194,000	10,760,000
Purified Water Distribution to Lake Sonoma						
Product Water Line	22	in	181,300	per inch-dia LF	\$37	147,910,600
Product Water Pump Station			2,600	HP	\$6,500	16,900,000
Potable Connection				LS	\$100,000	-
Raw Construction Cost						267,680,000
Construction Contingency				50%		133,840,000
Total Construction Cost						401,520,000
Implementation Cost				40%		160,610,000
Total Capital Cost						562,130,000

Annual Operations & Maintenance Cost (9 mgd production)					Annual O&M
Variable O&M	GPM	TDH (ft)	kwh-yr	Unit Cost	
Tertiary Pump Station					
Product Water Pump Station	6,258	1,233	15,278,040	\$0.20	3,056,000
FAT System			7,157,231	\$0.20	1,431,446
Ozone/ BAF System				\$0.20	-
Evaporator			27,178,376	\$0.20	5,435,675
Crystallizer			4,982,702	\$0.20	996,540
FAT System - Chemicals	1			\$326,250	326,250
Ozone/ BAF System - Chemicals				\$2,250	-
0	1			\$837,511	837,511
Fixed O&M		Construction Cost		Unit Cost	
Treatment		52,415,000		1.0%	524,150
Storage		2,551,000		0.5%	12,755
Pump Stations		16,900,000		3.0%	507,000
Pipelines		148,503,900		0.5%	742,520
Total Annual Operations & Maintenance Cost					13,869,847
Annualized Capital Cost				0.03526	19,820,000
Total Annualized Cost					33,689,847
				Max Project Yield (AFY)	10,065
				MAX \$/AF	3,347

Annual Operations & Maintenance Cost (2.7 mgd production)					Annual O&M
Variable O&M	GPM	TDH (ft)	kwh-yr	Unit Cost	
Product Water Pump Station	1,877	1,233	4,583,430	\$0.20	917,000
FAT System			2,147,169	\$0.20	429,434
Ozone/ BAF System				\$0.20	-
Evaporator			8,153,513	\$0.20	1,630,703
Crystallizer			1,494,811	\$0.20	298,962
FAT System - Chemicals	1			\$97,875	97,875
Ozone/ BAF System - Chemicals				\$675	-
0	1			\$587,422	587,422
Fixed O&M		Construction Cost		Unit Cost	
Treatment		52,415,000		1.0%	524,150
Storage		2,551,000		0.5%	12,755
Pump Stations		16,900,000		3.0%	507,000
Pipelines		148,503,900		0.5%	742,520
Total Annual Operations & Maintenance Cost					5,747,820
Annualized Capital Cost				0.03526	19,820,000
Total Annualized Cost					25,567,820
				Min Project Yield (AFY)	3,019
				MIN \$/AF	8,468

Santa Rosa Water Supply Options

July 2023

Option PR-4: DPR at LTP

Basis of estimate:

Option PR-4 would convey the City's tertiary effluent to an AWPf located at the LTP and return AWPf waste stream to the LTP headworks. The AWPf would include treatment processes in compliance with future anticipated regulations for treated water augmentation. The purified water would be conveyed to SCWA's 48-inch diameter aqueduct for regional distribution south of the City. PR-4 is limited by the reliable volume of tertiary effluent available, assuming the City would be reducing flow to the Geysers by prioritizing recycled water to its existing irrigation customers and the AWPf. For this level of study it was assumed the City would size the AWPf to meet its 9 MGD peak month supply needs and provide any remaining tertiary water to its existing irrigation customers and then to the Geysers.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
Equalization			1,820,000	per gallon	\$1.25	2,275,000
Tertiary to AWPf						
Tertiary Water Line to AWPf	24	in	500	per inch-dia LF	\$37	445,000
Tertiary Pump Station				HP	\$6,500	-
AWTF - DPR						
Ozone	11.4	MGD			\$530,000	6,025,000
BAF	11.4	MGD			\$480,000	5,457,000
MF/UF	10.6	MGD			\$1,940,000	20,510,000
Interprocess Tank			220,000	per gallon	\$1.25	275,000
RO	9.0	MGD			\$2,340,000	21,028,000
Chemicals (Storage and Feed Systems)	9.0	MGD			\$200,000	1,797,000
Sitework/Piping/Structures	9.0	MGD			\$5,050,000	45,381,000
Waste Disposal to Headworks at LTP	10	in	500	per inch-dia LF	\$37	185,400
Brine Disposal						
Zero Liquid Discharge			9.0	per MGD	\$1,194,000	10,730,000
Product Water Distribution						
Product Water Line	20	in	2,200	per inch-dia LF	\$37	1,631,700
Product Water Pump Station			270	HP	\$6,500	1,755,000
Potable Connection			1	LS	\$100,000	100,000
Raw Construction Cost						117,600,000
Construction Contingency				50%		58,800,000
Total Construction Cost						176,400,000
Implementation Cost				40%		70,560,000
Total Capital Cost						246,960,000

Annual Operations & Maintenance Cost (9 mgd production)						Annual O&M
Variable O&M	QTY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Tertiary Pump Station						
Product Water Pump Station		6,241	128	1,587,780	\$0.20	317,556
FAT System				7,157,231	\$0.20	1,431,446
Ozone/ BAF System				2,004,332	\$0.20	400,866
Evaporator				27,178,376	\$0.20	5,435,675
Crystallizer				4,982,702	\$0.20	996,540
FAT System - Chemicals	1				\$326,250	326,250
Ozone/ BAF System - Chemicals	1				\$2,250	2,250
Fixed O&M			Construction Cost		Unit Cost	
Treatment			63,750,000		1.0%	637,500
Storage			2,550,000		0.5%	12,750
Pump Stations			1,755,000		3.0%	52,650
Pipelines			2,262,100		0.5%	11,311
Total Annual Operations & Maintenance Cost						9,624,795
Annualized Capital Cost					0.03526	8,707,000
Total Annualized Cost						18,331,795
					Max Project Yield (AFY)	10,065
					MAX \$/AF	1,821

Annual Operations & Maintenance Cost (2.7 mgd production)						Annual O&M
Variable O&M	QTY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Tertiary Pump Station						-
Product Water Pump Station		1,872	128	476,370	\$0.20	95,274
FAT System				2,147,169	\$0.20	429,434
Ozone/ BAF System				601,300	\$0.20	120,260
Evaporator				8,153,513	\$0.20	1,630,703
Crystallizer				1,494,811	\$0.20	298,962
FAT System - Chemicals	1				\$97,875	97,875
Ozone/ BAF System - Chemicals	1				\$675	675
Fixed O&M			Construction Cost		Unit Cost	
Treatment			63,750,000		1.0%	637,500
Storage			2,550,000		0.5%	12,750
Pump Stations			1,755,000		3.0%	52,650
Pipelines			2,262,100		0.5%	11,311
Total Annual Operations & Maintenance Cost						3,387,393
Annualized Capital Cost					0.03526	8,707,000
Total Annualized Cost						12,094,393
					Min Project Yield (AFY)	3,019
					MIN \$/AF	4,006

Santa Rosa Water Supply Options		June 2023
Option RW-1: Recycled Water Expansion		
Basis of estimate:		
Complete the nonpotable recycled water expansion project evaluated in the Santa Rosa Urban Reuse Project Feasibility Study.		
		2023 Cost
Santa Rosa Urban Reuse Project		\$ 214,011,000
Total Capital Cost		\$ 214,011,000
Annualized Capital Cost	0.03526	\$ 7,546,000
Annual O&M Cost		\$ 1,270,000
Total Annualized Cost		\$ 8,816,000
	Yield (AFY)	3000
	\$/AF	2939

Santa Rosa Water Supply Options

July 2023

June 2023

Option DE-1: Regional Desalination						Full Project	City Portion
Basis of estimate:							
The cost estimate for this option is based on a recent cost estimate from the 2021 MMWD Desalination Supply Study. This option is for a regional desalination plant to be located the MMWD's Pelican Way Maintenance Yard facility in San Rafael, CA. The MMWD study was based on 15 MGD. It's assumed that Santa Rosa would "buy in" for up to 9 MGD of that 15 MGD and would pay a prorated share of capital and O&M costs.							
	Size	Units	Qty	Unit	Unit Cost	Subtotal	Subtotal
Intake							
Intake Screens, Pipeline and Pumps	15	MGD	1	LS	\$13,236,000	13,236,000	7,941,600
Raw Water Pipe	15	MGD	1	LS	\$394,000	394,000	236,400
Desalination Plant							
Rapid Mix	15	MGD	1	LS	\$2,033,000	2,033,000	1,219,800
Strainers, UF and Building	15	MGD	1	LS	\$17,668,000	17,668,000	10,600,800
Filtrate and Backwash Supply Tanks	15	MGD	1	LS	\$217,000	217,000	130,200
RO Feed Pump Station	15	MGD	1	LS	\$4,025,000	4,025,000	2,415,000
1st pass RO and Building, Permeate Tank	15	MGD	1	LS	\$32,591,000	32,591,000	19,554,600
Chlorine Contact Tank	15	MGD	1	LS	\$993,000	993,000	595,800
Chemical Facilities	15	MGD	1	LS	\$11,134,000	11,134,000	6,680,400
Backwash Equalization Basin	15	MGD	1	LS	\$430,000	430,000	258,000
Gravity Thickener	15	MGD	1	LS	\$2,390,000	2,390,000	1,434,000
Centrifuges	15	MGD	1	LS	\$6,810,000	6,810,000	4,086,000
O&M Building	15	MGD	1	LS	\$5,301,000	5,301,000	3,180,600
Sitework/Piping	15	MGD	1	LS	\$18,861,000	18,861,000	11,316,600
Electrical	15	MGD	1	LS	\$11,208,000	11,208,000	6,724,800
Instrumentation and Controls	15	MGD	1	LS	\$5,604,000	5,604,000	
Brine Disposal							
Brine Pump Station	15	MGD	1	LS	\$3,977,000	3,977,000	2,386,200
Brine Transmission Line	15	MGD	1	LS	\$1,763,000	1,763,000	1,057,800
Distribution							
Distribution Booster Pumps	15	MGD	1	LS	\$4,504,000	4,504,000	2,702,400
Treated Water Line	15	MGD	1	LS	\$328,000	328,000	196,800
Raw Construction Cost						143,470,000	82,720,000
Construction Contingency				50%		71,740,000	41,360,000
Total Construction Cost						215,210,000	124,080,000
Implementation Cost				40%		86,080,000	49,630,000
Total Capital Cost						301,290,000	173,710,000

Annual Operations & Maintenance Cost (15 mgd production)						Annual O&M	Annual O&M
Variable O&M	gpm	TDH	AFY	kwh-yr	Unit Cost		
Desalination Facility			16,800	27,384,000	\$0.20	5,476,800	3,286,080
Distribution Booster Pumps	10,417	200		4,125,600	\$0.20	825,120	495,072
Brine Pump Station	11,111	100		2,200,320	\$0.20	440,064	264,038
Fixed O&M			Construction Cost		Unit Cost		
Treatment			78,291,000		1.0%	782,910	469,746
Storage			430,000		0.5%	2,150	1,290
Pump Stations			21,717,000		3.0%	651,510	390,906
Pipelines			15,721,000		0.5%	78,605	47,163
Total Annual Operations & Maintenance Cost						8,257,159	4,954,295
Annualized Capital Cost					0.03526	10,623,000	6,125,000
Total Annualized Cost						18,880,159	11,079,295
Max Project Yield (AFY)						16,800	10,080
MAX \$/AF						1,124	1,099

Annual Operations & Maintenance Cost (5 mgd production)						Annual O&M	Annual O&M
Variable O&M	gpm	TDH	AFY	kwh-yr	Unit Cost		
Desalination Facility			5,600	9,128,000	\$0.20	1,825,600	1,095,360
Distribution Booster Pumps	3,472	200		1,375,200	\$0.20	275,040	165,024
Brine Pump Station	4,028	100		797,580	\$0.20	159,516	95,710
Fixed O&M			Construction Cost		Unit Cost		
Treatment			78,291,000		1.0%	782,910	469,746
Storage			430,000		0.5%	2,150	1,290
Pump Stations			21,717,000		3.0%	651,510	390,906
Pipelines			15,721,000		0.5%	78,605	47,163
Total Annual Operations & Maintenance Cost						3,340,775	2,004,465
Annualized Capital Cost					0.03526	10,623,000	6,125,000
Total Annualized Cost						13,963,775	8,129,465
Min Project Yield (AFY)						2,240	3,360
MIN \$/AF						6,234	2,419

Santa Rosa Water Supply Options

June 2023

Option DE-2: Ocean Desalination **Full Project**

Basis of estimate:

The cost estimate for this option is based on a recent cost estimate from the 2021 MMWD Desalination Supply Study. This option is for a Santa Rosa owned desalination plant to be located south of Bodega Bay. The MMWD Study was based on 15 mgd, it is assumed Santa Rosa only needs to supply 9mgd, the costs were scaled from the 15 mgd plant down to a 9mgd plant.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
Intake						
Intake Screens, Pipeline and Pumps	9	MGD	1	LS	\$7,942,000	7,942,000
Raw Water Pipe	30	in	2,000	inch-dia LF	\$37	2,225,000
Desalination Plant						
Rapid Mix	9	MGD	1	LS	\$1,220,000	1,220,000
Strainers, UF and Building	9	MGD	1	LS	\$10,601,000	10,601,000
Filtrate and Backwash Supply Tanks	9	MGD	1	LS	\$130,000	130,000
RO Feed Pump Station	9	MGD	1	LS	\$2,415,000	2,415,000
1st pass RO and Building, Permeate Tank	9	MGD	1	LS	\$19,555,000	19,555,000
Chlorine Contact Tank	9	MGD	1	LS	\$596,000	596,000
Chemical Facilities	9	MGD	1	LS	\$6,680,000	6,680,000
Backwash Equalization Basin	9	MGD	1	LS	\$258,000	258,000
Gravity Thickener	9	MGD	1	LS	\$1,434,000	1,434,000
Centrifuges	9	MGD	1	LS	\$4,086,000	4,086,000
O&M Building	9	MGD	1	LS	\$3,181,000	3,181,000
Sitework/Piping	9	MGD	1	LS	\$11,316,000	11,316,000
Electrical	9	MGD	1	LS	\$6,725,000	6,725,000
Instrumentation and Controls	9	MGD	1	LS	\$3,363,000	3,363,000
Brine Disposal						
Brine Pump Station			290	HP	\$6,500	1,885,000
Brine Transmission Line	24	in	2,000	inch-dia LF	\$37	1,780,000
Distribution						
Distribution Pump Station			1,880	HP	\$6,500	12,220,000
Treated Water Line	24	in	92,600	inch-dia LF	\$37	82,414,000
Raw Construction Cost						180,030,000
Construction Contingency					50%	90,020,000
Total Construction Cost						270,050,000
Implementation Cost					40%	108,020,000
Total Capital Cost						378,070,000

Annual Operations & Maintenance Cost (9mgd production)						Annual O&M
Variable O&M	gpm	TDH	AFY	kwh-yr	Unit Cost	
Desalination Facility			10,080	45,964,800	\$0.20	9,192,960
Distribution Pump Station	6,250	893		11,055,060	\$0.20	2,211,012
Brine Pump Station	7,107	122		1,714,410	\$0.20	342,882
Fixed O&M			Construction Cost		Unit Cost	
Treatment			46,975,000		1.0%	469,750
Storage			258,000		0.5%	1,290
Pump Stations			22,047,000		3.0%	661,410
Pipelines			94,361,000		0.5%	471,805
Total Annual Operations & Maintenance Cost						13,351,109
Annualized Capital Cost					0.03526	13,330,000
Total Annualized Cost						26,681,109
					Max Project Yield (AFY)	10,080
					MAX \$/AF	2,647

Annual Operations & Maintenance Cost (5mgd production)						Annual O&M
Variable O&M	gpm	TDH	AFY	kwh-yr	Unit Cost	
Desalination Facility			5,600	25,536,000	\$0.20	5,107,200
Distribution Pump Station	3,472	893		6,141,690	\$0.20	1,228,338
Brine Pump Station	4,028	122		971,550	\$0.20	194,310
Fixed O&M			Construction Cost		Unit Cost	
Treatment			46,975,000		1.0%	469,750
Storage			258,000		0.5%	1,290
Pump Stations			22,047,000		3.0%	661,410
Pipelines			94,361,000		0.5%	471,805
Total Annual Operations & Maintenance Cost						8,134,103
Annualized Capital Cost					0.03526	13,330,000
Total Annualized Cost						21,464,103
					Min Project Yield (AFY)	3,360
					MIN \$/AF	7,941

Santa Rosa Water Supply Options

July 2023

Option SW-1: Divert and store in Aquifer

Basis of estimate:

The cost estimate for this option is based on a recent cost estimate from Del Puerto. This option is for a stormwater diversion structure within Santa Rosa Creek to store water in the aquifer. This option assumes spreading basins for percolation into the aquifer and new extraction wells.

	Size	Units	Qty	Unit	Unit Cost	Subtotal
Santa Rosa Creek Water Diversion						
Diversion Structure, including pumps, spreading basins			10,080	per AF	\$1,800	18,144,000
Conventional Treatment Plant	9	MGD	1	LS	\$41,925,000	41,925,000
Extraction Wells						
New Well Construction	500	gpm	12	per well	\$3,500,000	42,000,000
Product Water Distribution						
Product Water Line	20	in	3,000	per inch-dia LF	\$37	2,225,000
Product Water Pump Station			240	HP	\$6,500	1,560,000
Potable Connection			1	LS	\$100,000	100,000
Raw Construction Cost						105,950,000
Construction Contingency				50%		52,980,000
Total Construction Cost						158,930,000
Implementation Cost				40%		63,570,000
Total Capital Cost						222,500,000

Annual Operations & Maintenance Cost (9 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Diversion Energy Costs	10,080				\$16	163,296
Treatment					\$418,755	418,755
Product Water Pump Station		6,000	118	465,750	\$0.20	93,150
Extraction Wells	10,080				\$236	2,382,266
Fixed O&M					Construction Cost	Unit Cost
Treatment					\$418,755	418,755
Semi-Annual Basin Clearing					\$21,200	21,200
Well Inspections					\$10,000	10,000
Operational Labor Costs					\$10,000	10,000
Extraction Wells					\$443,119	443,119
Pump Stations			1,560,000		3.0%	46,800
Pipelines			2,225,000		0.5%	11,125
Total Annual Operations & Maintenance Cost						4,018,467
Annualized Capital Cost					0.03526	7,845,000
Total Annualized Cost						11,863,467
Max Project Yield (AFY)						10,080
MAX \$/AF						1,177

Annual Operations & Maintenance Cost (0 mgd production)						Annual O&M
Variable O&M	AFY	GPM	TDH (ft)	kwh-yr	Unit Cost	
Diversion Energy Costs	0				\$16	-
Treatment					\$0	-
Product Water Pump Station		0	118	0	\$0.20	-
Extraction Wells	0				\$236	-
Fixed O&M					Construction Cost	Unit Cost
Treatment					\$418,755	418,755
Semi-Annual Basin Clearing*					\$21,200.00	21,200
Well Inspections					\$10,000.00	10,000
Operational Labor Costs					\$10,000.00	10,000
Extraction Wells					\$443,119	443,119
Pump Stations			1,560,000		3.0%	46,800
Pipelines			2,225,000		0.5%	11,125
Total Annual Operations & Maintenance Cost						961,000
Annualized Capital Cost					0.03526	7,845,000
Total Annualized Cost						8,806,000
Min Project Yield (AFY)						1,008
MIN \$/AF						8,736

DRAFT



APPENDIX B: SCREENING TOOL DETAIL (BASELINE SCENARIO)

**Global modeling parameters and assumptions
apply to all scenarios, all options unless otherwise noted.**

Global values

2045 Demand (AF/Y)	25,000	25,000 was given value
Max historic demand	23,993	in 2004, not used in calcs
max active savings	7,584	Table 4-1 UWMP; not used in calcs
Sonom Water nominal allotment (AF/Y)	29,100	should be constant
Sonoma Water peak historic draft (AF/Y)	20,693	just for info, not used in calcs
Current groundwater firm capacity (AF/Y)	1,300	
Default Sonoma Water \$/AF	1,200	
discount rate	2.5%	
price of power (\$/MWh)	\$200	
first year of simulation	2045	
planning horizon (yrs)	50	

Sonoma cutback and state-imposed rationing by year type

Year type	SCWA Cutback	State- imposed Rationing
Wet	0%	0%
Normal	0%	0%
Dry	30%	10%


Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **DN** Do nothing
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr) 0.00 as entered in Options definition
 Fixed OMR (\$M/yr) 0.00 as entered in Options definition
 Fixed capital + OMR (\$M/yr) 0.00 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type: Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing	15	out of 50 years
Years with rationing over state levels	15	
Max rationing	28%	based on nominal demand
Max AFY supplemental supply	0	AF/yr
Avg Sonoma Water	21,567	AF/yr
Avg Sonoma Water Cost	25.9	\$/M/yr
Average AFY supplemental	0	based on scenario usage year-by-year, shown below
Max supplemental AFY	0	
Average marginal OMR \$M/yr	0.00	based on scenario usage year-by-year, shown below
Average total \$M/yr for supp. Supply	0.00	combining with fixed costs shown above
Average \$/AF supplemental	\$0	
Avg total cost including supplement + Sonoma	25.9	\$/M/yr
Average OMR \$/yr	0.00	sum of fixed and marginal OMR

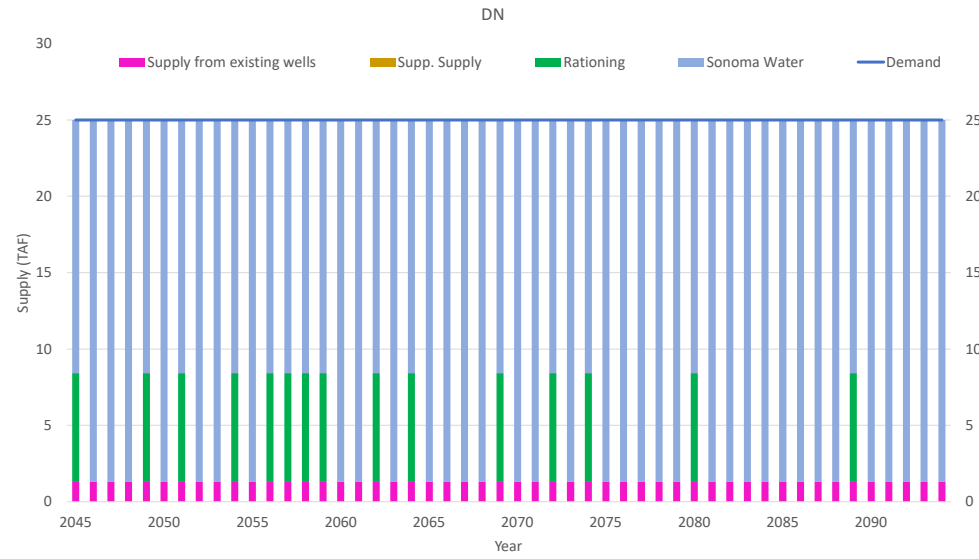

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2046	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2047	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2048	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2049	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2050	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2051	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2052	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2053	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2054	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2055	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2056	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2057	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2058	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2059	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2060	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2061	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2062	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2063	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2064	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2065	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2066	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2067	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2068	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2069	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2070	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2071	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2072	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2073	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2074	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2075	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2076	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2077	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2078	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2079	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2080	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2081	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2082	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2083	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2084	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2085	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2086	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2087	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2088	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2089	Dry	30%	25,000	1,300	0	0	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	0	4,610	28%	28%	7,110	0
2090	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2091	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2092	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2093	Normal	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2094	Wet	0%	25,000	1,300	0	0	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0


Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **GW-1** Add groundwater extraction wells
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr) 3.40 as entered in Options definition
 Fixed OMR (\$M/yr) 0.50 as entered in Options definition
 Fixed capital + OMR (\$M/yr) 3.90 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type: Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing	15	out of 50 years
Years with rationing over state levels	0	
Max rationing	10%	based on nominal demand
Max AFY supplemental supply	8,726	AF/yr
Avg Sonoma Water	16,216	AF/yr
Avg Sonoma Water Cost	19.5	\$/M/yr
Average AFY supplemental	6,734	based on scenario usage year-by-year, shown below
Max supplemental AFY	8,726	
Average marginal OMR \$M/yr	1.78	based on scenario usage year-by-year, shown below
Average total \$M/yr for supp. Supply	5.68	combining with fixed costs shown above
Average \$/AF supplemental	\$843	
Avg total cost including supplement + Sonoma	25.1	\$/M/yr
Average OMR \$/yr	2.28	sum of fixed and marginal OMR

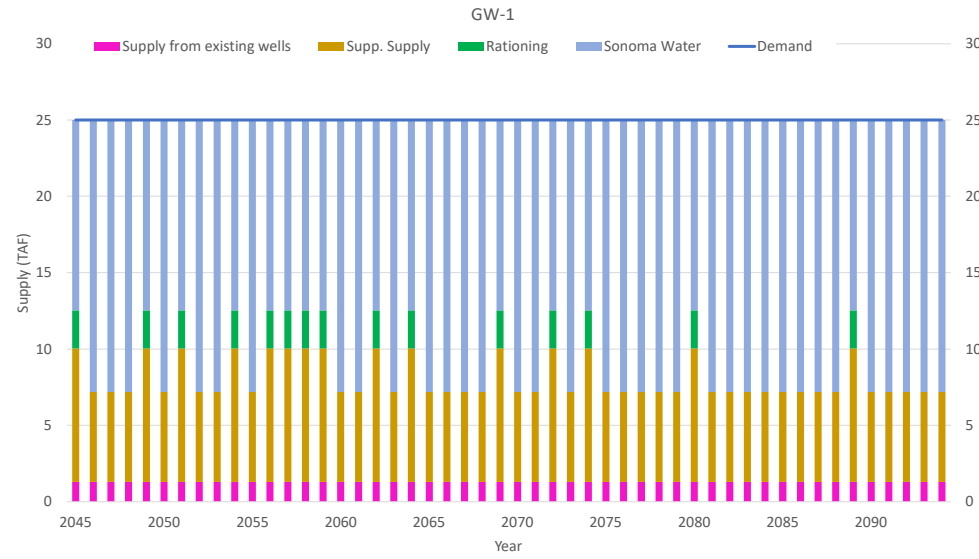

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2046	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2047	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2048	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2049	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2050	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2051	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2052	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2053	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2054	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2055	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2056	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2057	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2058	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2059	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2060	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2061	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2062	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2063	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2064	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2065	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2066	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2067	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2068	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2069	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2070	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2071	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2072	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2073	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2074	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2075	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2076	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2077	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2078	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2079	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2080	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2081	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2082	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2083	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2084	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2085	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2086	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2087	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2088	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2089	Dry	30%	25,000	1,300	5,880	10,080	17,820	12,474	10%	22,500	12,474	15.0	8,726	\$264	8,726	0	5%	10%	2,500	8,726
2090	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2091	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2092	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2093	Normal	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880
2094	Wet	0%	25,000	1,300	5,880	10,080	17,820	17,820	0%	25,000	17,820	21.4	5,880	\$264	5,880	0	0%	0%	0	5,880


Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **GW-2** Convert emergency wells to production wells
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr) 0.41 as entered in Options definition
 Fixed OMR (\$M/yr) 0.12 as entered in Options definition
 Fixed capital + OMR (\$M/yr) 0.53 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type: Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing 15 out of 50 years
 Years with rationing over state levels 15
 Max rationing 23% based on nominal demand
 Max AFY supplemental supply 2,462 AF/yr
 Avg Sonoma Water 20,260 AF/yr
 Avg Sonoma Water Cost 24.3 \$M/yr
 Average AFY supplemental 1,744 based on scenario usage year-by-year, shown below
 Max supplemental AFY 2,462
 Average marginal OMR \$M/yr 0.41 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply 0.94 combining with fixed costs shown above
 Average \$/AF supplemental \$541
 Avg total cost including supplement + Sonoma 25.3 \$M/yr
 Average OMR \$/yr 0.53 sum of fixed and marginal OMR

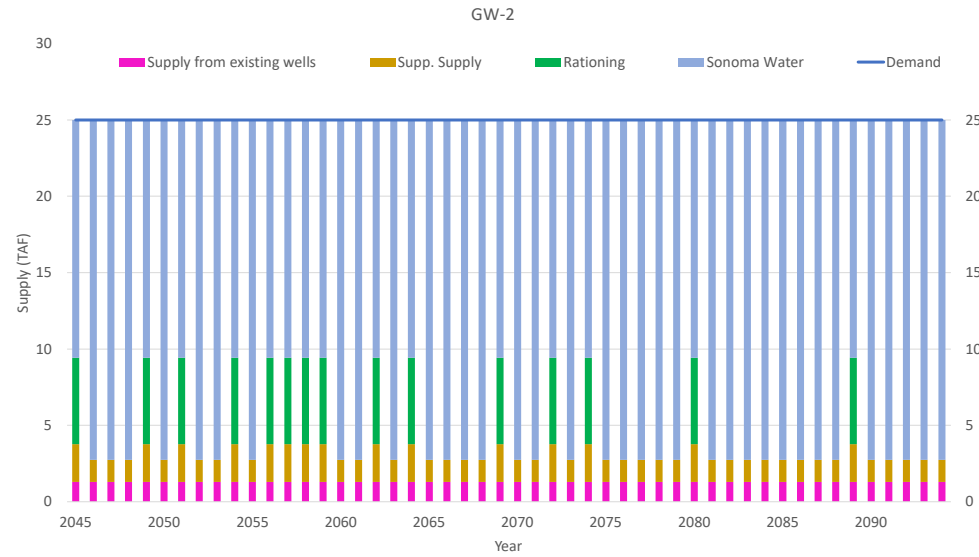

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2046	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2047	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2048	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2049	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2050	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2051	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2052	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2053	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2054	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2055	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2056	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2057	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2058	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2059	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2060	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2061	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2062	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2063	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2064	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2065	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2066	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2067	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2068	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2069	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2070	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2071	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2072	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2073	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2074	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2075	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2076	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2077	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2078	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2079	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2080	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2081	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2082	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2083	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2084	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2085	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2086	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2087	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2088	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2089	Dry	30%	25,000	1,300	1,436	2,462	22,264	15,585	10%	22,500	15,585	18.7	5,615	\$236	2,462	3,153	23%	23%	5,653	2,462
2090	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2091	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2092	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2093	Normal	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436
2094	Wet	0%	25,000	1,300	1,436	2,462	22,264	22,264	0%	25,000	22,264	26.7	1,436	\$236	1,436	0	0%	0%	0	1,436

Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!


Option : GW-3 Add ASR wells
 Storage (AF): 5,000 as entered in Options definition
 Storage threshold (\$/AF): 500 supplemental supply is only used for discretionary storage puts when
 Capital cost (\$M/yr): 2.86 as entered in Options definition
 Fixed OMR (\$M/yr): 0.12 as entered in Options definition
 Fixed capital + OMR (\$M/yr): 2.98 sum of amortized capital plus fixed OMR

Scenario: 2 Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type: Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing: 15 out of 50 years
 Years with rationing over state levels: 15 based on nominal demand
 Max rationing: 16%
 Max AFY supplemental supply: 5,130 AF/yr
 Avg Sonoma Water: 18,844 AF/yr
 Avg Sonoma Water Cost: 22.6 \$M/yr

Average AFY supplemental: 3,634 based on scenario usage year-by-year, shown below
 Max supplemental AFY: 5,130
 Average marginal OMR \$M/yr: 6.59 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply: 9.57 combining with fixed costs shown above
 Average \$/AF supplemental: \$2,632
 Avg total cost including supplement + Sonoma: 32.2 \$M/yr
 Average OMR \$/yr: 6.71 sum of fixed and marginal OMR

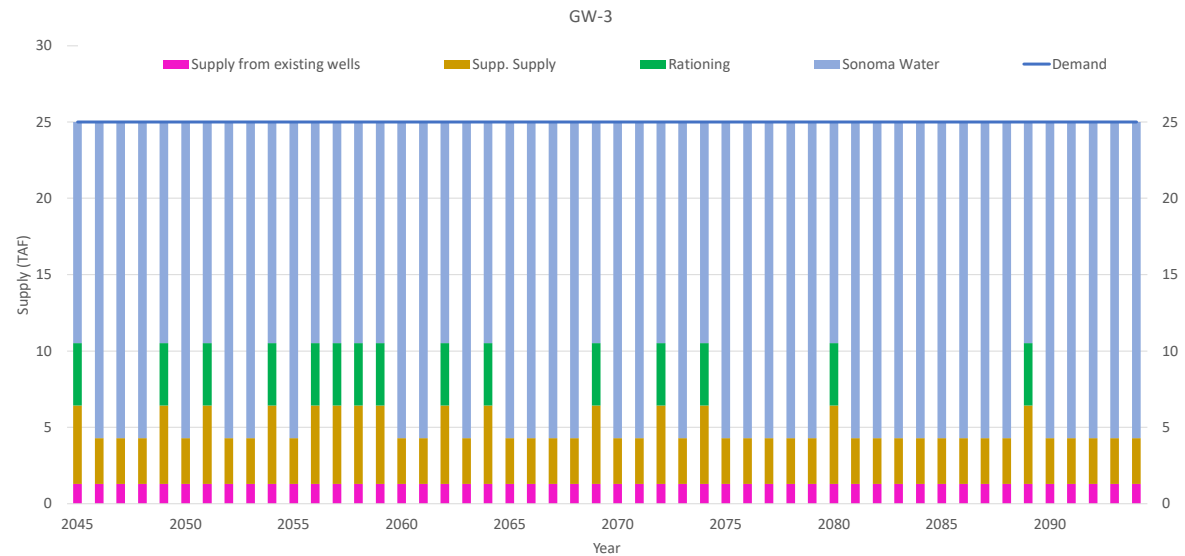

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply	Supplemental Supply Marginal Cost \$M	Take from storage (AF)
2045	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2046	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2047	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2048	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2049	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2050	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2051	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2052	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2053	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2054	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2055	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2056	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2057	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2058	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2059	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2060	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2061	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2062	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2063	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2064	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2065	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2066	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2067	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2068	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2069	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2070	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2071	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2072	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2073	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2074	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2075	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2076	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2077	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2078	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2079	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2080	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2081	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2082	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2083	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2084	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2085	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2086	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2087	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2088	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2089	Dry	30%	25,000	1,300	2,993	5,130	20,708	14,495	10%	22,500	14,495	17.4	6,705	\$1,813	5,130	1,575	16%	16%	4,075	5,130	9.30	0
2090	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2091	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2092	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2093	Normal	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0
2094	Wet	0%	25,000	1,300	2,993	5,130	20,708	20,708	0%	25,000	20,708	24.8	2,993	\$1,813	2,993	0	0%	0%	0	2,993	5.42	0


Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **PR-1** DPR at Laguna Treatment Plant
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr) 10.20 as entered in Options definition
 Fixed OMR (\$M/yr) 0.87 as entered in Options definition
 Fixed capital + OMR (\$M/yr) 11.08 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type:
 Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing 15 out of 50 years
 Years with rationing over state levels 0
 Max rationing 10% based on nominal demand
 Max AFY supplemental supply 6,724 AF/yr
 Avg Sonoma Water 18,819 AF/yr
 Avg Sonoma Water Cost 22.6 \$M/yr
 Average AFY supplemental 4,131 based on scenario usage year-by-year, shown below
 Max supplemental AFY 6,724
 Average marginal OMR \$M/yr 3.83 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply 14.90 combining with fixed costs shown above
 Average \$/AF supplemental \$3,608
 Avg total cost including supplement + Sonoma 37.5 \$M/yr
 Average OMR \$/yr 4.70 sum of fixed and marginal OMR

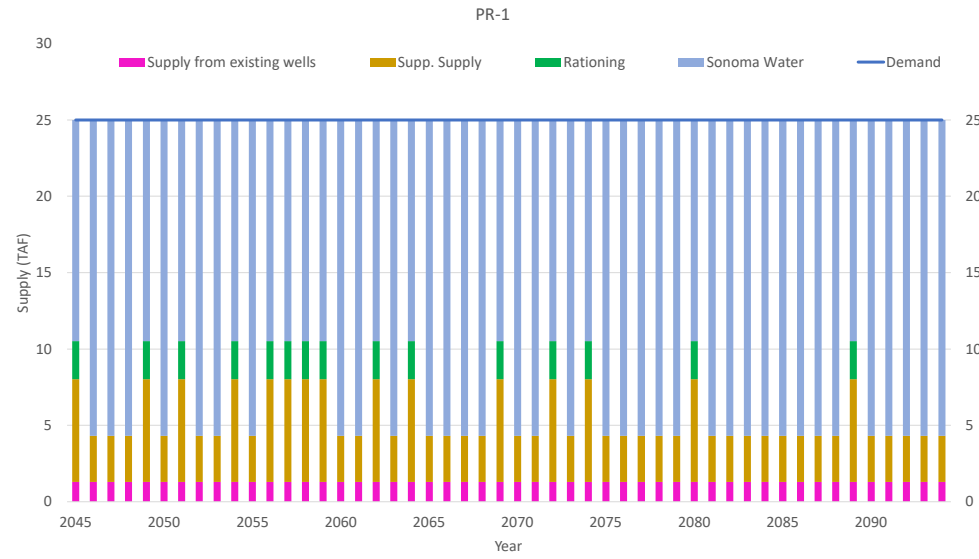

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2046	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2047	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2048	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2049	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2050	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2051	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2052	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2053	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2054	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2055	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2056	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2057	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2058	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2059	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2060	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2061	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2062	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2063	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2064	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2065	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2066	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2067	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2068	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2069	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2070	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2071	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2072	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2073	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2074	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2075	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2076	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2077	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2078	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2079	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2080	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2081	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2082	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2083	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2084	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2085	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2086	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2087	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2088	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2089	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$927	6,724	0	0%	10%	2,500	6,724
2090	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2091	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2092	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2093	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019
2094	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$927	3,019	0	0%	0%	0	3,019

Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **PR-2** Satellite DPR (from RW line)
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr) 11.07 as entered in Options definition
 Fixed OMR (\$M/yr) 0.95 as entered in Options definition
 Fixed capital + OMR (\$M/yr) 12.03 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type:
 Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing 15 out of 50 years
 Years with rationing over state levels 0
 Max rationing 10% based on nominal demand
 Max AFY supplemental supply 6,724 AF/yr
 Avg Sonoma Water 18,819 AF/yr
 Avg Sonoma Water Cost 22.6 \$M/yr
 Average AFY supplemental 4,131 based on scenario usage year-by-year, shown below
 Max supplemental AFY 6,724
 Average marginal OMR \$M/yr 3.89 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply 15.92 combining with fixed costs shown above
 Average \$/AF supplemental \$3,854
 Avg total cost including supplement + Sonoma 38.5 \$M/yr
 Average OMR \$/yr 4.85 sum of fixed and marginal OMR



Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2046	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2047	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2048	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2049	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2050	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2051	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2052	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2053	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2054	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2055	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2056	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2057	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2058	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2059	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2060	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2061	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2062	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2063	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2064	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2065	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2066	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2067	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2068	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2069	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2070	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2071	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2072	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2073	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2074	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2075	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2076	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2077	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2078	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2079	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2080	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2081	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2082	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2083	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2084	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2085	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2086	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2087	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2088	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2089	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$943	6,724	0	0%	10%	2,500	6,724
2090	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2091	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2092	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2093	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019
2094	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$943	3,019	0	0%	0%	0	3,019


Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **PR-3a** IPR to Delta Pond
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr) 14.78 as entered in Options definition
 Fixed OMR (\$M/yr) 1.07 as entered in Options definition
 Fixed capital + OMR (\$M/yr) 15.85 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type:
 Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing 15 out of 50 years
 Years with rationing over state levels 0
 Max rationing 10% based on nominal demand
 Max AFY supplemental supply 6,724 AF/yr
 Avg Sonoma Water 18,819 AF/yr
 Avg Sonoma Water Cost 22.6 \$M/yr
 Average AFY supplemental 4,131 based on scenario usage year-by-year, shown below
 Max supplemental AFY 6,724
 Average marginal OMR \$M/yr 3.87 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply 19.72 combining with fixed costs shown above
 Average \$/AF supplemental \$4,775
 Avg total cost including supplement + Sonoma 42.3 \$M/yr
 Average OMR \$/yr 4.94 sum of fixed and marginal OMR

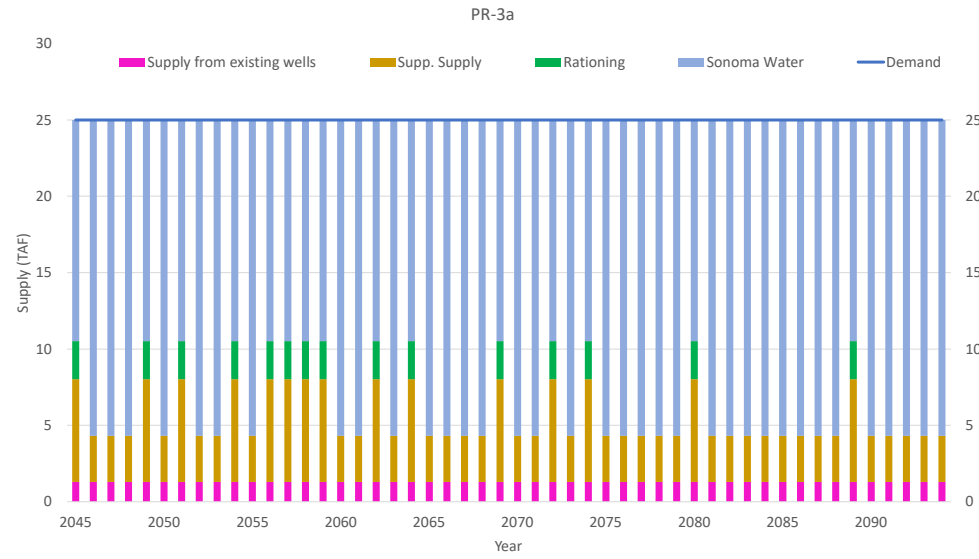

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2046	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2047	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2048	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2049	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2050	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2051	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2052	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2053	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2054	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2055	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2056	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2057	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2058	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2059	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2060	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2061	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2062	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2063	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2064	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2065	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2066	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2067	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2068	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2069	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2070	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2071	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2072	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2073	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2074	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2075	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2076	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2077	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2078	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2079	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2080	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2081	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2082	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2083	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2084	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2085	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2086	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2087	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2088	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2089	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$936	6,724	0	0%	10%	2,500	6,724
2090	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2091	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2092	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2093	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019
2094	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$936	3,019	0	0%	0%	0	3,019


Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **PR-3c** IPR to Lake Sonoma
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr) 19.82 as entered in Options definition
 Fixed OMR (\$M/yr) 1.79 as entered in Options definition
 Fixed capital + OMR (\$M/yr) 21.61 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type:
 Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing 15 out of 50 years
 Years with rationing over state levels 0
 Max rationing 10% based on nominal demand
 Max AFY supplemental supply 6,724 AF/yr
 Avg Sonoma Water 18,819 AF/yr
 Avg Sonoma Water Cost 22.6 \$M/yr
 Average AFY supplemental 4,131 based on scenario usage year-by-year, shown below
 Max supplemental AFY 6,724
 Average marginal OMR \$M/yr 4.96 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply 26.57 combining with fixed costs shown above
 Average \$/AF supplemental \$6,431
 Avg total cost including supplement + Sonoma 49.1 \$M/yr
 Average OMR \$/yr 6.75 sum of fixed and marginal OMR

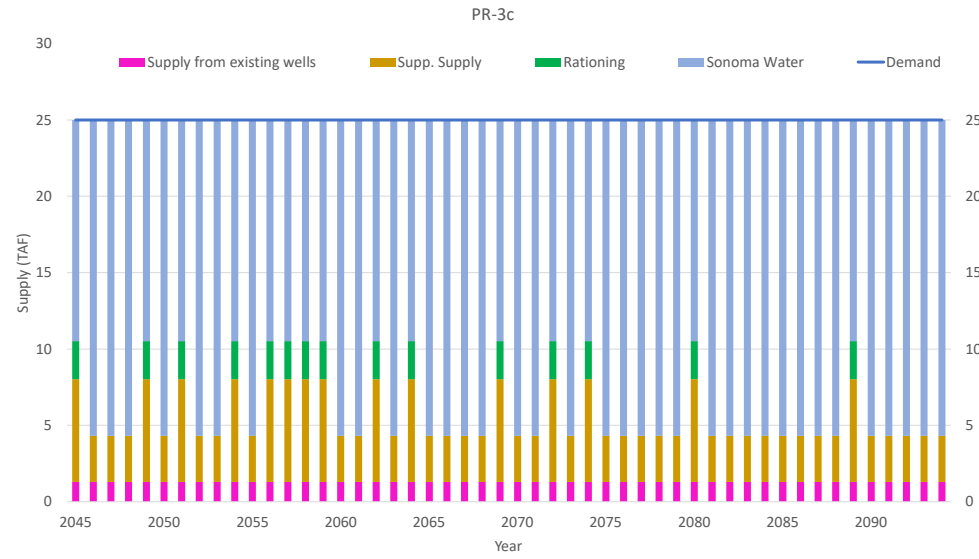

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2046	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2047	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2048	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2049	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2050	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2051	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2052	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2053	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2054	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2055	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2056	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2057	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2058	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2059	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2060	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2061	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2062	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2063	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2064	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2065	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2066	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2067	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2068	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2069	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2070	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2071	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2072	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2073	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2074	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2075	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2076	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2077	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2078	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2079	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2080	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2081	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2082	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2083	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2084	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2085	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2086	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2087	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2088	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2089	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$1,201	6,724	0	0%	10%	2,500	6,724
2090	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2091	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2092	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2093	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019
2094	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$1,201	3,019	0	0%	0%	0	3,019


Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **PR-4** Regional DPR at LTP
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr): 8.71 as entered in Options definition
 Fixed OMR (\$M/yr): 0.71 as entered in Options definition
 Fixed capital + OMR (\$M/yr): 9.42 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type:
 Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing 15 out of 50 years
 Years with rationing over state levels 0
 Max rationing 10% based on nominal demand
 Max AFY supplemental supply 6,724 AF/yr
 Avg Sonoma Water 18,819 AF/yr
 Avg Sonoma Water Cost 22.6 \$M/yr
 Average AFY supplemental 4,131 based on scenario usage year-by-year, shown below
 Max supplemental AFY 6,724
 Average marginal OMR \$M/yr 3.66 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply 13.08 combining with fixed costs shown above
 Average \$/AF supplemental \$3,166
 Avg total cost including supplement + Sonoma 35.7 \$M/yr
 Average OMR \$/yr 4.37 sum of fixed and marginal OMR

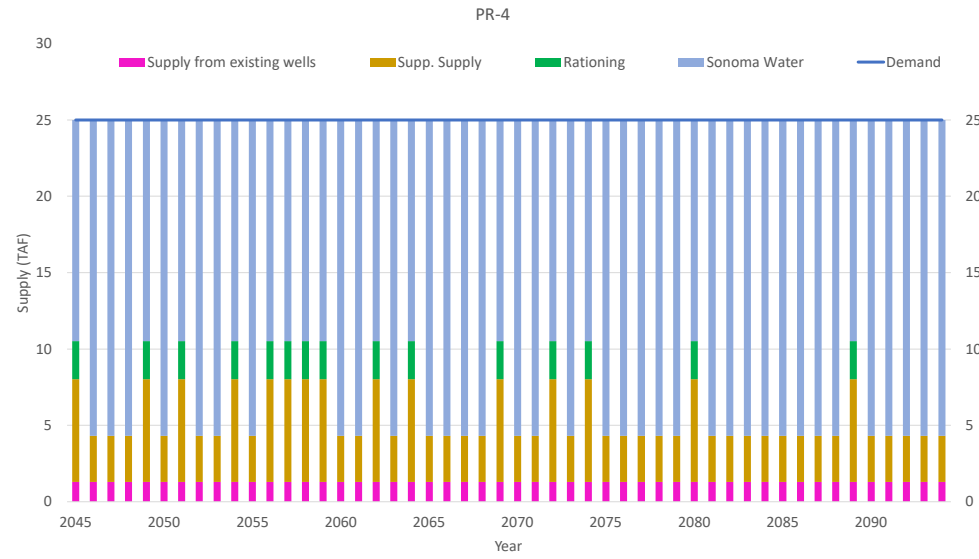

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2046	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2047	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2048	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2049	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2050	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2051	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2052	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2053	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2054	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2055	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2056	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2057	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2058	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2059	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2060	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2061	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2062	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2063	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2064	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2065	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2066	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2067	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2068	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2069	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2070	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2071	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2072	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2073	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2074	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2075	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2076	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2077	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2078	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2079	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2080	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2081	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2082	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2083	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2084	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2085	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2086	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2087	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2088	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2089	Dry	30%	25,000	1,300	3,019	10,065	20,681	14,476	10%	22,500	14,476	17.4	6,724	\$885	6,724	0	0%	10%	2,500	6,724
2090	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2091	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2092	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2093	Normal	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019
2094	Wet	0%	25,000	1,300	3,019	10,065	20,681	20,681	0%	25,000	20,681	24.8	3,019	\$885	3,019	0	0%	0%	0	3,019


Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **RW-1** Nonpotable Recycled Expansion
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr) 7.55 as entered in Options definition
 Fixed OMR (\$M/yr) 1.27 as entered in Options definition
 Fixed capital + OMR (\$M/yr) 8.82 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type:
 Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing 15 out of 50 years
 Years with rationing over state levels 15
 Max rationing 16% based on nominal demand
 Max AFY supplemental supply 3,000 AF/yr
 Avg Sonoma Water 21,567 AF/yr
 Avg Sonoma Water Cost 25.9 \$M/yr
 Average AFY supplemental 900 based on scenario usage year-by-year, shown below
 Max supplemental AFY 3,000
 Average marginal OMR \$M/yr 0.00 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply 8.82 combining with fixed costs shown above
 Average \$/AF supplemental \$9,795
 Avg total cost including supplement + Sonoma 34.7 \$M/yr
 Average OMR \$/yr 1.27 sum of fixed and marginal OMR

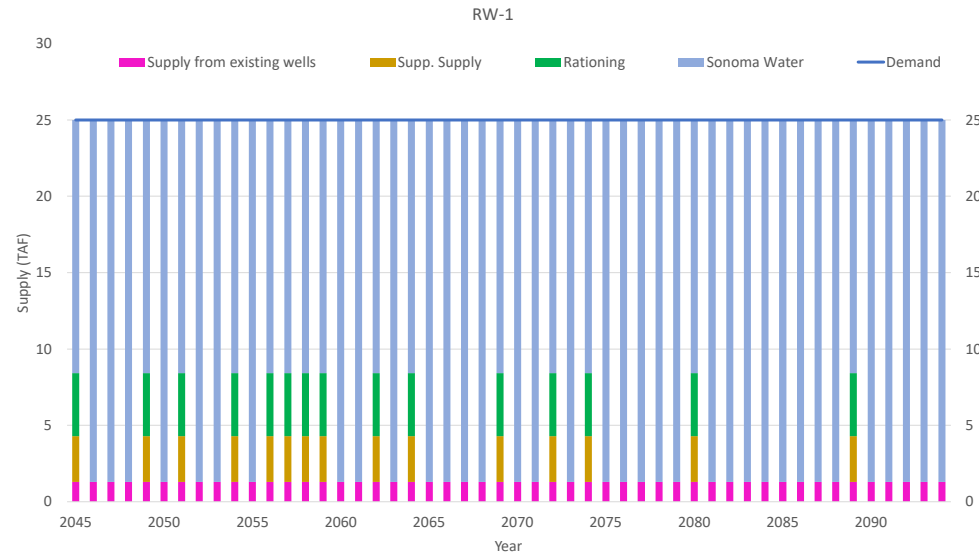

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2046	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2047	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2048	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2049	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2050	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2051	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2052	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2053	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2054	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2055	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2056	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2057	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2058	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2059	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2060	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2061	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2062	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2063	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2064	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2065	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2066	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2067	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2068	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2069	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2070	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2071	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2072	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2073	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2074	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2075	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2076	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2077	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2078	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2079	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2080	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2081	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2082	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2083	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2084	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2085	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2086	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2087	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2088	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2089	Dry	30%	25,000	1,300	0	3,000	23,700	16,590	10%	22,500	16,590	19.9	4,610	\$0	3,000	1,610	16%	16%	4,110	3,000
2090	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2091	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2092	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2093	Normal	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0
2094	Wet	0%	25,000	1,300	0	3,000	23,700	23,700	0%	25,000	23,700	28.4	0	\$0	0	0	0%	0%	0	0


Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **DE-1** Regional Desalination (MMWD)
 Storage (AF): 0 as entered in Options definition
 Storage threshold (\$/AF): 0 (n/a)
 Capital cost (\$M/yr): 6.12 as entered in Options definition
 Fixed OMR (\$M/yr): 0.91 as entered in Options definition
 Fixed capital + OMR (\$M/yr): 7.03 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type: Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS


Years with any rationing 15 out of 50 years
 Years with rationing over state levels 0
 Max rationing 10% based on nominal demand
 Max AFY supplemental supply 6,962 AF/yr
 Avg Sonoma Water 18,509 AF/yr
 Avg Sonoma Water Cost 22.2 \$M/yr
 Average AFY supplemental 4,441 based on scenario usage year-by-year, shown below
 Max supplemental AFY 6,962
 Average marginal OMR \$M/yr 1.78 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply 8.82 combining with fixed costs shown above
 Average \$/AF supplemental \$1,985
 Avg total cost including supplement + Sonoma 31.0 \$M/yr
 Average OMR \$/yr 2.69 sum of fixed and marginal OMR

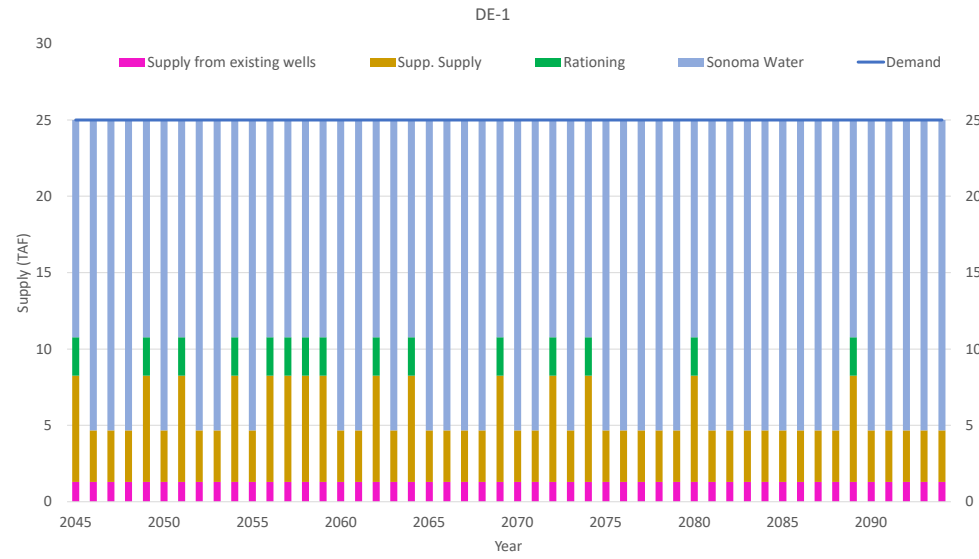

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2046	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2047	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2048	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2049	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2050	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2051	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2052	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2053	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2054	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2055	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2056	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2057	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2058	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2059	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2060	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2061	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2062	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2063	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2064	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2065	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2066	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2067	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2068	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2069	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2070	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2071	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2072	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2073	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2074	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2075	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2076	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2077	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2078	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2079	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2080	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2081	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2082	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2083	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2084	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2085	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2086	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2087	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2088	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2089	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$401	6,962	0	0%	10%	2,500	6,962
2090	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2091	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2092	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2093	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360
2094	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$401	3,360	0	0%	0%	0	3,360

Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : DE-2	Ocean Desalination
Storage (AF): 0	as entered in Options definition
Storage threshold (\$/AF): 0	(n/a)
Capital cost (\$M/yr): 13.33	as entered in Options definition
Fixed OMR (\$M/yr): 1.60	as entered in Options definition
Fixed capital + OMR (\$M/yr): 14.93	sum of amortized capital plus fixed OMR
Scenario: 2 Replay it again Sam, historic hydrology with base year 1920	
Hydrology type: Historic	
Base year: 1920	Base year of historic replay
Synthetic hydrology ID: n/a	
Synthetic hydrology index: n/a	
Sonoma reductions by year type: Wet 0%	
Normal 0%	
Dry 30%	

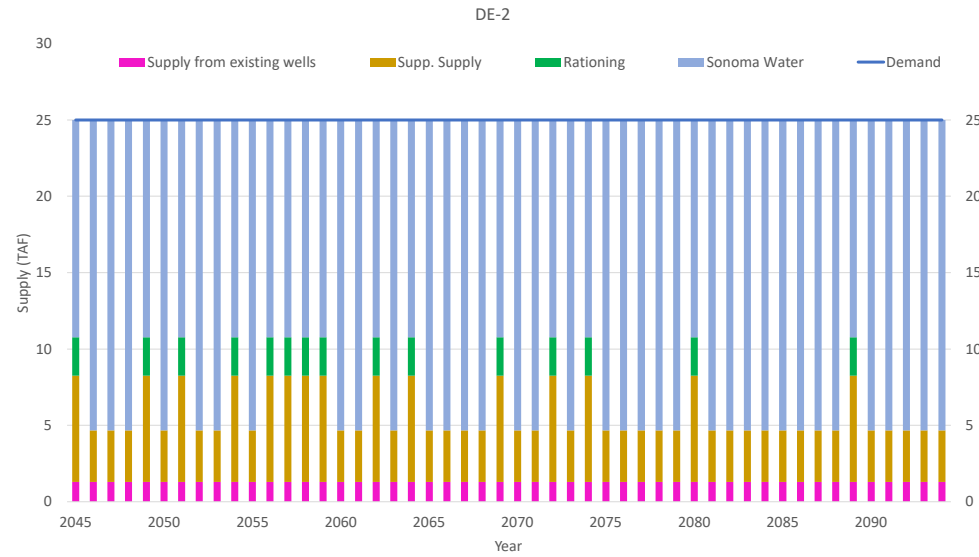

SUMMARY OF RESULTS	
Years with any rationing	15 out of 50 years
Years with rationing over state levels	0
Max rationing	10% based on nominal demand
Max AFY supplemental supply	6,962 AF/yr
Avg Sonoma Water	18,509 AF/yr
Avg Sonoma Water Cost	22.2 \$M/yr
Average AFY supplemental	4,441 based on scenario usage year-by-year, shown below
Max supplemental AFY	6,962
Average marginal OMR \$M/yr	5.17 based on scenario usage year-by-year, shown below
Average total \$M/yr for supp. Supply	20.11 combining with fixed costs shown above
Average \$/AF supplemental	\$4,528
Avg total cost including supplement + Sonoma	42.3 \$M/yr
Average OMR \$/yr	6.78 sum of fixed and marginal OMR

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2046	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2047	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2048	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2049	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2050	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2051	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2052	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2053	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2054	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2055	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2056	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2057	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2058	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2059	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2060	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2061	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2062	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2063	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2064	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2065	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2066	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2067	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2068	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2069	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2070	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2071	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2072	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2073	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2074	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2075	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2076	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2077	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2078	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2079	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2080	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2081	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2082	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2083	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2084	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2085	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2086	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2087	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2088	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2089	Dry	30%	25,000	1,300	3,360	10,080	20,340	14,238	10%	22,500	14,238	17.1	6,962	\$1,165	6,962	0	0%	10%	2,500	6,962
2090	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2091	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2092	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2093	Normal	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360
2094	Wet	0%	25,000	1,300	3,360	10,080	20,340	20,340	0%	25,000	20,340	24.4	3,360	\$1,165	3,360	0	0%	0%	0	3,360

Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : **SW-1** Stormwater stored in aquifer
 Storage (AF): 5,000 as entered in Options definition
 Storage threshold (\$/AF): 500 supplemental supply is only used for discretionary storage puts when
 Capital cost (\$M/yr) 7.84 as entered in Options definition
 Fixed OMR (\$M/yr) 0.54 as entered in Options definition
 Fixed capital + OMR (\$M/yr) 8.39 sum of amortized capital plus fixed OMR

Scenario: **2** Replay it again Sam, historic hydrology with base year 1920
 Hydrology type: Historic
 Base year: 1920 Base year of historic replay
 Synthetic hydrology ID: n/a
 Synthetic hydrology index: n/a
 Sonoma reductions by year type:
 Wet 0%
 Normal 0%
 Dry 30%

SUMMARY OF RESULTS

Years with any rationing 15 out of 50 years
 Years with rationing over state levels 0
 Max rationing 10% based on nominal demand
 Max AFY supplemental supply 6,008 AF/yr
 Avg Sonoma Water 20,650 AF/yr
 Avg Sonoma Water Cost 24.8 \$M/yr
 Average AFY supplemental 2,618 based on scenario usage year-by-year, shown below
 Max supplemental AFY 6,008
 Average marginal OMR \$M/yr 0.79 based on scenario usage year-by-year, shown below
 Average total \$M/yr for supp. Supply 9.18 combining with fixed costs shown above
 Average \$/AF supplemental \$3,507
 Avg total cost including supplement + Sonoma 34.0 \$M/yr
 Average OMR \$/yr 1.34 sum of fixed and marginal OMR




Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2046	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	6,008
2047	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	2,008
2048	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,208
2049	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2050	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,599
2051	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2052	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,677
2053	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,142
2054	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2055	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,586
2056	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2057	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2058	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2059	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2060	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	3,328
2061	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,472
2062	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2063	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,652
2064	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2065	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,688
2066	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,144
2067	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,035
2068	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,013
2069	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2070	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,560
2071	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,118
2072	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2073	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,581
2074	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2075	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,674
2076	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,141
2077	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,035
2078	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,013
2079	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,009
2080	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2081	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,559
2082	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,118
2083	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,030
2084	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,012
2085	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,009
2086	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,008
2087	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,008
2088	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,008
2089	Dry	30%	25,000	1,300	1,008	10,080	22,692	15,884	10%	22,500	15,884	19.1	5,316	\$303	5,316	0	0%	10%	2,500	5,316
2090	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,559
2091	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,118
2092	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,030
2093	Normal	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,012
2094	Wet	0%	25,000	1,300	1,008	10,080	22,692	22,692	0%	25,000	22,692	27.2	1,008	\$303	1,008	0	0%	0%	0	1,009

Choose an option to model, and a scenario to model it against. Those are the only two inputs on this sheet!

Option : E-1	Efficiency programs
Storage (AF): 0	as entered in Options definition
Storage threshold (\$/AF): 0	(n/a)
Capital cost (\$M/yr) 5.96	as entered in Options definition
Fixed OMR (\$M/yr) 0.00	as entered in Options definition
Fixed capital + OMR (\$M/yr) 5.96	sum of amortized capital plus fixed OMR
Scenario: 2 Replay it again Sam, historic hydrology with base year 1920	
Hydrology type: Historic	
Base year: 1920	Base year of historic replay
Synthetic hydrology ID: n/a	
Synthetic hydrology index: n/a	
Sonoma reductions by year type: Wet 0%	
Normal 0%	
Dry 30%	

SUMMARY OF RESULTS

Years with any rationing 15	out of 50 years
Years with rationing over state levels 15	
Max rationing 26%	based on nominal demand
Max AFY supplemental supply 2,145	AF/yr
Avg Sonoma Water 19,615	AF/yr
Avg Sonoma Water Cost 23.5	\$/M/yr
Average AFY supplemental 2,145	based on scenario usage year-by-year, shown below
Max supplemental AFY 2,145	
Average marginal OMR \$M/yr 0.00	based on scenario usage year-by-year, shown below
Average total \$M/yr for supp. Supply 5.96	combining with fixed costs shown above
Average \$/AF supplemental \$2,778	
Avg total cost including supplement + Sonoma 29.5	\$/M/yr
Average OMR \$/yr 0.00	sum of fixed and marginal OMR

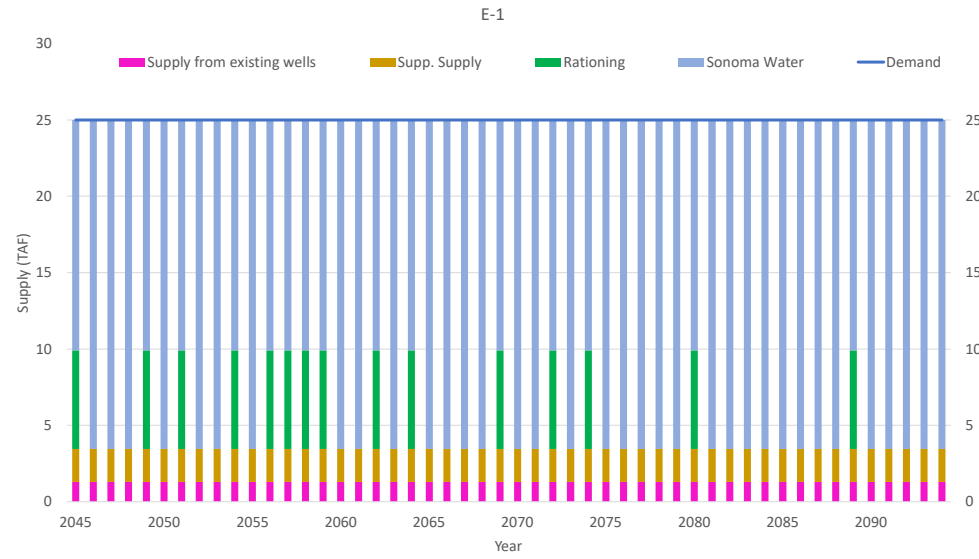

Year	Year type	Sonoma Water % redu for year type	Demand	Supply from existing wells	Min supp AF	Max supp AF	Baseline demand for SW	Sonoma Water max avail (AF)	State-imposed rationing for year type	Eff demand AF	Sonoma Water	Sonoma Water cost \$M	Supp supply deficit AF	Supp supply Marginal cost \$/AF	Supp supply used for demand (AF)	AF Residual shortage (surplus)	Needed rationing based on supply	Actual rationing level	Rationing	Supp. Supply
2045	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2046	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2047	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2048	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2049	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2050	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2051	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2052	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2053	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2054	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2055	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2056	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2057	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2058	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2059	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2060	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2061	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2062	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2063	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2064	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2065	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2066	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2067	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2068	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2069	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2070	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2071	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2072	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2073	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2074	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2075	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2076	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2077	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2078	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2079	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2080	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2081	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2082	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2083	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2084	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2085	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2086	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2087	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2088	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2089	Dry	30%	25,000	1,300	2,145	2,145	21,555	15,088	10%	22,500	15,088	18.1	6,112	\$0	2,145	3,966	26%	26%	6,466	2,145
2090	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2091	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2092	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2093	Normal	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145
2094	Wet	0%	25,000	1,300	2,145	2,145	21,555	21,555	0%	25,000	21,555	25.9	2,145	\$0	2,145	0	0%	0%	0	2,145